

METRIC/INCH-POUND

**KSC-E-165
Revision F**

ELECTRICAL GROUND SUPPORT EQUIPMENT FABRICATION, SPECIFICATION FOR

NOT EXPORT CONTROLLED

This document has been reviewed by the KSC Export Control Office and it has been determined that it does not meet the criteria for control under the International Traffic in Arms Regulations (ITAR) or Export Administration Regulations (EAR).

Reference EDR Log #: 10891 NASA KSC Export Control Office, (321) 867-9209

December 20, 2021

Engineering Directorate

National Aeronautics and
Space Administration
John F. Kennedy Space Center

KSC FORM 16-12 (REV. 6/95) PREVIOUS EDITIONS ARE OBSOLETE (CG 11/95)
KDP-KSC-T-5406 Rev Basic



APPROVED FOR PUBLIC RELEASE – DISTRIBUTION IS UNLIMITED

METRIC/INCH-POUND

**KSC-E-15
Revision F**

**ELECTRICAL
GROUND SUPPORT EQUIPMENT
FABRICATION, SPECIFICATION FOR**

December 20, 2021

JOHN F. KENNEDY SPACE CENTER, NASA

APPROVED FOR PUBLIC RELEASE – DISTRIBUTION IS UNLIMITED

RECORD OF REVISIONS/CHANGES			
REV LTR	CHG NO.	DESCRIPTION	DATE
C		General revision.	April 1, 1982
D		General revision.	February 22, 1995
E		General revision.	February 2, 2009
	E-1	Updated applicable documents. Added an acceptable lubricant and an approved thermal-barrier tape. Clarified requirements for (1) suitable wire/cable for cabinets, enclosures, and terminal distributors, (2) shielding for interior-type connectors, (3) cables terminated on a terminal strip, (4) one-piece ferrules for shield terminations, (5) solder terminations, (6) inspection of standard bulk cables, and (7) inspection of cable assemblies before potting or molding	June 4, 2013
	E-2	Updated applicable documents. Updated standards for crimp-type terminations and for tools for crimping terminal, conductor splices, and shield ferrules. Added acceptable values for torquing rear coupling nuts of connectors or cables for ignitionproofing.	March 26, 2014
	E-3	<ol style="list-style-type: none"> 1. Updated applicable document in §2. 2. Required that welding comply with KSC-DE-512-SM in §3.1.2. 3. Clarified materials for aluminum racks, enclosures, panels, junction boxes, and miscellaneous details in §3.1.6.1. 4. Changed “detailed drawings” to “engineering drawings,” and added guidance for marker tape in §3.4. 5. Clarified requirements for wirewrap wire and premises wiring cables in §3.5.3. 6. Added requirements for the application of cold-shrink tubing in §3.8.1.3. 7. Clarified requirements for thermal protection of cable assemblies and requirements for thermal blankets, sleeves, and hose assemblies in §3.11.9. 8. Added Fyrejacket sleeving and Fyretape as approved products for thermal protection in §3.11.9.2.d. 9. Added NFPA 70, Article 332, as a compliance requirement for mineral-insulated cable in §3.12. 	November 6, 2014

RECORD OF REVISIONS/CHANGES			
REV LTR	CHG NO.	DESCRIPTION	DATE
	E-4	<ol style="list-style-type: none"> 1. Clarified use of connector/mold adapter materials and the use of liquid locking compound in electrical connectors in §3.5.11. 2. Added reference to NASA-STD-8739.4 to §3.5.12. 3. Added information on mold adapter/connectors using dissimilar metals and the use of liquid locking compound to §3.5.13.3.a. 4. Added reference to TM 584, KSC-E-166, and MIL-STD-889 Section A.3.9 to use sealing compound in addition to primer in §3.5.13.3.b. 5. Added the requirement to use liquid locking compound on stainless steel connector/mold interfaces in §3.5.13.3.c. 6. Updated references in §3.6.4 and §3.6.4.1. 7. Replaced text of §3.7.7.1 with revised text. 8. Clarified the use of graphite-free dry film lubricants in §3.10.2.f. 9. Updated reference paragraphs in §3.10.4. 10. Replaced text of §4.3 with revised text. 11. Corrected references in §4.3.1 through §4.3.5. 12. Added Change 4 to all pages changed only by page roll caused by the addition of text in changed paragraphs. 	March 2, 2017
	E-5	<ol style="list-style-type: none"> 1. Deleted reference to 75M13302, Connector Inspection Specification, in §2.1.3. 2. Replaced reference to 75M13302 with NASA-STD-8739.4 in §3.11.3. 3. Deleted references to Space Shuttle and Constellation in §3.11.3.1. 4. Replaced wraparound sleeve with cable jacket repair tape and included instruction on overwrapping each end with vinyl electrical tape in §3.11.7.1. 5. Replaced Wraparound cable sleeve with Cable Jacket Repair Tape as an approved product in §3.11.7.2. 6. Clarified requirement for fabricating agency to forward recorder strips when specified on engineering documentation/drawings in §3.11.10. 7. Revised requirement to perform TDR testing when specified on engineering documentation/drawings in §3.11.10.3.3. 8. Modified section title in §3.11.10.3.3.1. 9. Modified section title in §3.11.10.3.3.2. 10. Added “in accordance with manufacturer’s specifications” in §3.16.7.2 and §3.16.7.3. 	September 5, 2019
F		General revision.	December 20, 2021

CONTENTS

1.	SCOPE	1
2.	APPLICABLE DOCUMENTS	1
2.1	Governmental	1
2.1.1	Specifications	1
2.1.2	Standards	3
2.1.3	Drawings	5
2.1.4	Publications	6
2.2	Non-Governmental	6
2.3	Order of Precedence	12
3.	REQUIREMENTS	12
3.1	Metal and Sheet Metal Assemblies, Subassemblies, and Details	13
3.1.1	Surface Preparation	13
3.1.1.1	Abrasive Blasting	14
3.1.1.2	Degreasing	14
3.1.2	Protective Coatings, Thinners, and Cleaners	15
3.1.2.1	Generic Protective Coatings	15
3.1.2.2	Application of Coatings	15
3.1.2.3	Colors	16
3.1.2.4	Storage, Mixing, and Application Methods	16
3.1.2.5	Coating Finish	16
3.1.2.6	Touchup of Welds and Damaged Coatings	17
3.1.3	Sealants and Caulking	17
3.1.4	Chip-Free Clean-Room Paint	17
3.1.5	Zones of Exposure	18
3.1.6	Aluminum Racks, Enclosures, Panels, Junction Boxes, and Miscellaneous Details	18
3.1.6.1	Materials	18
3.1.6.2	Cleaning, Treating, and Coating	18
3.1.6.2.1	Surface Preparation	18
3.1.6.3	Chromate Coatings	18
3.1.6.4	Protective Coatings	19
3.1.6.5	Finish Colors	19
3.1.7	Steel Racks, Enclosures, Junction Boxes, Assemblies, and Miscellaneous Details	19
3.1.7.1	Materials	19
3.1.7.2	Cleaning, Treating, and Coating	19
3.1.7.3	Finish Colors	19
3.1.8	Fabricated Chassis	19
3.1.8.1	Materials	19
3.1.8.2	Cleaning and Treating	20
3.2	Welding and Brazing	20
3.2.1	Welding	20
3.2.2	Brazing	20
3.3	Fasteners	20
3.3.1	Threaded Fasteners	20

3.3.1.1	Torque Limits for Threaded Fasteners	20
3.3.1.2	Installation of Nuts on Bolts or Screws	21
3.3.1.3	Torque Values for Standard and High-Strength Steel Fasteners	26
3.3.1.3.1	Plated.....	26
3.3.1.3.2	Lubricated	26
3.3.1.4	Torque Values for 300 Series CRES Fasteners	26
3.3.1.4.1	Passivated	26
3.3.1.4.2	Plated.....	26
3.3.1.4.3	Lubricated	26
3.3.1.5	Torque Values for 430 MPa (62 ksi) Tensile Strength Aluminum Alloy Fasteners (2024-T4, 7075-T6)	26
3.3.1.5.1	Anodized	26
3.3.1.5.2	Lubricated	26
3.3.1.6	Lubricants	27
3.3.1.7	Self-Locking Fasteners.....	27
3.3.1.8	Cotter Pin, Lockwire, and Safety Cable Securing	27
3.3.1.9	Safety Cable	28
3.3.1.10	Nonmetallic Fasteners.....	28
3.3.2	Adhesives	28
3.3.3	Rivets.....	28
3.3.3.1	Chips, Burrs, and Foreign Material.....	28
3.3.3.2	Rivet Substitutions	31
3.4	Identification and Marking (of GSE).....	31
3.5	Electrical Harness, Enclosure, Internal	31
3.5.1	Harness Configuration, Internal.....	31
3.5.2	Wire and Cable, Internal.....	32
3.5.3	Routing	32
3.5.4	Grouping	33
3.5.5	Breakouts.....	33
3.5.6	Wire Stripping	33
3.5.7	Terminals	35
3.5.7.1	Modular Terminal Junction Systems.....	35
3.5.7.2	Screw Terminals	35
3.5.7.3	Compression Terminals	35
3.5.7.4	Solder Terminals.....	35
3.5.7.4.1	Terminal Swaging	35
3.5.7.4.2	Rework.....	40
3.5.7.5	Solderless Wrap Terminals	40
3.5.8	Lacing and Tying.....	40
3.5.8.1	Lacing	40
3.5.8.2	Cable Ties and Clamps	42
3.5.9	Termination Order	42
3.5.10	Potting, Electrical Connectors	42
3.5.11	Splicing	42
3.5.12	Terminating and Grounding Shields	43
3.5.12.1	Insulated Shields Over Individual Conductors or Groups of Conductors.....	46
3.5.12.2	Uninsulated Shields Over Individual Conductors or Groups of Conductors.....	47
3.5.12.2.1	Interior Cable Runs	47
3.5.12.3	Shield Terminals	48

3.6	Terminations	48
3.6.1	Compression Type	48
3.6.1.1	Captive Nut or Screw Head	49
3.6.1.2	Clamp or Screw End	52
3.6.2	Crimp Type	52
3.6.3	Friction Type	52
3.6.4	Solder Type.....	52
3.6.4.1	Hand and Machine Soldering	52
3.6.4.2	Soldering Multiple Conductors in a Single Solder Cup.....	52
3.6.5	Bonding and Grounding Type.....	53
3.6.6	DIN Rail-Mounted Terminal Blocks.....	53
3.6.7	Wire Termination Inspection for Terminal Blocks.....	53
3.6.8	Termination Ferrules	55
3.7	Printed Wiring Boards	55
3.7.1	Material	55
3.7.2	Construction.....	55
3.7.2.1	Circuit Pads.....	55
3.7.2.2	Heat Sinks.....	56
3.7.2.2.1	Electrical Insulation	56
3.7.2.2.2	Thermal Resistance	56
3.7.2.3	Eyelets and Tubelets.....	56
3.7.2.4	Workmanship	56
3.7.3	Cleaning.....	57
3.7.4	Rejection Criteria.....	57
3.7.5	Inspection.....	58
3.7.6	Conformal Coating	58
3.7.7	Repair	58
3.7.7.1	Printed Wiring Boards Using Surface-Mount Technology (SMT)	58
3.8	Sealing and Insulating	58
3.8.1	Insulation.....	58
3.8.1.1	Heat-Reactive Tubing.....	59
3.8.1.1.1	Application	59
3.8.1.1.2	Visual Inspection	60
3.8.1.2	Insulation Tubing.....	60
3.8.1.3	Cold-Shrink Tubing	60
3.8.2	Sealing Compound, Electrical	61
3.9	Hazardproofing	61
3.9.1	Intrinsically Safe Equipment	61
3.9.2	Ignitionproofing	61
3.9.2.1	Small Junction Boxes.....	62
3.9.2.2	Electrical Components	62
3.9.2.3	Electrical Connectors and Mated Cables.....	62
3.9.3	Purging and Pressurization	62
3.9.3.1	Equipment.....	62
3.9.3.2	Purge Pressure	63
3.9.3.3	Flow Rate.....	63
3.9.3.4	Purge Media.....	63
3.10	Corrosion Control.....	63
3.10.1	Corrosion-Resistant Materials	64
3.10.2	Dissimilar Metals.....	64
3.10.3	Moisture Exclusion	65

3.10.4	Protective Coatings	66
3.10.5	Lubricants	66
3.11	Cables, External.....	66
3.11.1	Standard Bulk Cable	68
3.11.2	Unique Bulk Cable	68
3.11.2.1	Preferred Cable Construction	68
3.11.2.2	Fabrication Procedure	69
3.11.2.3	Overall Braided Shield Splicing	70
3.11.3	Connectors.....	71
3.11.3.1	D-Subminiature (DB) Connectors.....	72
3.11.4	Jacket Removal.....	73
3.11.5	Conductor and Shield Termination	73
3.11.6	Potting and Molding	73
3.11.6.1	Overall Shields Surrounding the Entire Cable Core	74
3.11.6.1.1	Tinel-Lock Rings	75
3.11.6.1.2	EMI/RFI Foil Tape and Wire Mesh	77
3.11.6.1.3	Exterior Cable Runs	77
3.11.7	Cable Jacket Repair.....	77
3.11.7.1	Sleeves	78
3.11.7.2	Approved Products.....	78
3.11.8	Splicing	78
3.11.8.1	Procedure	78
3.11.8.2	Approved Products.....	80
3.11.9	Thermal Protection.....	80
3.11.9.1	Application	80
3.11.9.2	Approved Products.....	81
3.11.9.3	Splicing, Fyrejacket Sleeving.....	81
3.12	Cable Checkout Post-Fabrication.....	81
3.12.1	Cable Continuity Test.....	82
3.12.2	Cable Dielectric Withstanding Voltage (DWV) Test	82
3.12.3	Cable Insulation-Resistance Tests	83
3.12.4	Radio Frequency Cable Tests	83
3.12.4.1	Continuity Tests	83
3.12.4.2	Insulation-Resistance Test	83
3.12.4.2.1	Coaxial Cable.....	83
3.12.4.2.2	Twin-Axial Cable and Balanced Pairs (T43, Cat5e, or Cat6)	84
3.12.4.3	Time Domain Reflectometer (TDR) Test	84
3.12.4.3.1	Coaxial Cable TDR Testing	84
3.12.4.3.2	Twin-Axial Cable or Balanced Pairs (Cat5e, Cat6, or T43) TDR Testing	88
3.12.4.3.3	Triaxial Cable TDR Test	88
3.13	Mineral-Insulated (MI) Cable	88
3.14	Transducers	88
3.15	Electromagnetic Interference Tests	88
3.16	Fabrication Process Waste Disposal.....	89
3.17	Fiber-Optic Cables	89
3.17.1	Optical-Fiber End Preparation	89
3.17.2	Cleaning.....	90
3.17.3	Splicing	90
3.17.3.1	Presplicing Examination	91
3.17.3.2	Splicing Method.....	91

3.17.3.2.1	Fusion Splicing.....	91
3.17.3.2.2	Mechanical Splicing	91
3.17.3.2.3	Chemical Splicing.....	91
3.17.3.3	Splice Requirements	92
3.17.3.3.1	Location	92
3.17.3.3.2	Protection.....	92
3.17.3.3.3	Strength Member	92
3.17.4	Fiber-Optic Cable Assemblies	92
3.17.4.1	Cable Assembly	92
3.17.4.1.1	Preassembly Verification.....	92
3.17.4.1.2	Preassembly Examination	92
3.17.4.2	Completed Cable Assemblies	93
3.17.5	Fiber-Optic Assemblies	94
3.17.5.1	Fiber-Optic Connector Termination	94
3.17.5.1.1	Preassembly Verification.....	94
3.17.5.1.2	Preassembly Examination.....	94
3.17.5.2	Post-Fiber-Optic-Connector-Termination Inspection.....	94
3.17.5.3	Fiber-Optic Routing	94
3.17.6	Testing	95
3.17.6.1	Fiber-Optic Splices.....	95
3.17.6.2	Fiber-Optic Cable Assemblies	95
3.17.6.3	Fiber-Optic Assemblies	95
3.17.6.4	Optical Time-Domain Reflectometer (OTDR) Test	96
3.17.6.5	OTDR Basic Theory of Operation.....	96
3.17.6.5.1	Attenuation.....	98
3.17.6.5.2	Point Defects.....	100
3.17.7	Fiber-Optic Cable Assembly Installation	102
3.17.7.1	Tensile Load and Vertical Rise.....	102
3.17.7.2	Installation Bend Radius.....	102
3.17.7.3	Installed Bend Radius	103
3.17.7.4	Cable Tying.....	103
3.17.7.5	Dust Caps	103
3.17.7.6	Premating Inspection	103
3.17.7.7	Connector Torque	103
3.17.7.8	Sharp Edges	103
3.18	Ethernet	103
3.18.1	Ethernet Naming Conventions.....	103
3.19	Electrical Assembly Cleanliness.....	104
4.	QUALITY ASSURANCE PROVISIONS.....	104
4.1	Responsibility for Inspection and Test.....	104
4.2	Certification of Personnel	104
4.3	Certification of Tooling and Test Equipment.....	105
4.3.1	Soldering Tools	105
4.3.2	Crimping Tools.....	105
4.3.3	Crimping Tools, Special	106
4.3.4	Torque Wrenches.....	106
4.3.5	Wire Stripping Tools.....	106
4.3.6	Solderless Wrap Tools	106
4.3.7	Test Equipment.....	107

4.4	Electrical Equipment Checkout.....	107
4.4.1	Sequence of Tests	107
4.4.2	Continuity Tests	108
4.4.3	Isolation Checks.....	108
4.4.4	Functional Checks.....	109
4.5	Completion of Tests	109
4.6	Manufacturing Instructions/Documentation.....	109
4.7	Commercial Off-the-Shelf (COTS) Concept.....	109
4.7.1	Modified Off-the-Shelf (MOTS) Items	110
5.	PREPARATION FOR DELIVERY	110
6.	NOTES	111
6.1	Intended Use.....	111
6.2	Definitions	111

FIGURES

Figure 1.	Safety Cable, Tension Tool, Ferrule, and Calibration Unit.....	29
Figure 2.	Typical Safety Cable Installations	30
Figure 3.	Harness or Wire Bundle.....	34
Figure 4.	Rolled Swage Terminals	37
Figure 5.	Elliptical Funnel Swage Terminals	38
Figure 6.	Funnel Swage Terminals	39
Figure 7.	Cable Termination Hardware	43
Figure 8.	Typical Termination Configuration for Overall Shielded Cable with Insulated Conductor Shields	44
Figure 9.	Graphic Representation of Individual Shields from Source, Through Intermediate Break Points, to End Instrument.....	45
Figure 10.	Typical Termination Configuration for Overall Shielded Cable with Uninsulated Conductor Shields.....	46
Figure 11.	Internal 360-Degree Shield Termination	48
Figure 12.	Bridge Bus Terminals	49
Figure 13.	Captive and Noncaptive Nut and Screw Head Terminations.....	50
Figure 14.	Clamp and Screw End Terminations.....	51
Figure 15.	Proper Wire Termination on Spring Clip Style Terminal Blocks.....	54
Figure 16.	Discrepant Wire Termination on Spring Clip Style Terminal Blocks	54
Figure 17.	Application of Heat-Reactive Tubing.....	60
Figure 18.	Unique Bulk Cable Fabrication.....	71
Figure 19.	DB9 and DB25 Connectors.....	72
Figure 20.	DB15 Connectors	72
Figure 21.	MD50 and MD68 Connectors	73
Figure 22.	360-Degree Overall Shield Termination Using a Mold Adapter	75
Figure 23.	Tinel-Lock Rings and an Example of One Type of Adapter.....	75
Figure 24.	Tinel-Lock Ring Resistance Heating Tools.....	76
Figure 25.	Typical Installation of Tinel-Lock Ring.....	76
Figure 26.	TDR Traces for Coaxial Cable	85
Figure 27.	TDR Fault Traces for Twin-Axial Cable (Sheet 1 of 2).....	86
Figure 28.	Typical OTDR Block Diagram	97
Figure 29.	OTDR Trace of an Installed Cable Plant.....	98
Figure 30.	OTDR Measurement Points for Measuring Fiber Attenuation, Using Dead- Zone Fiber	99
Figure 31.	OTDR Trace Showing a Nonreflective Fault with Apparent Gain and a Reflective Fault with No Apparent Loss or Gain	100
Figure 32.	Extrapolation for a Point Defect Showing an Apparent Signal Gain.....	101
Figure 33.	Exaggerated Loss Obtained at Point Defects Exhibiting Gain in One Direction by Conducting the OTDR Measurement in the Opposite Direction	102

TABLES

Table 1.	Torque Values for Steel, Cadmium-Plated, Unlubricated Threaded Fasteners	22
Table 2.	Torque Values for Steel, Lubricated (Plated, Unplated) Threaded Fasteners.....	23
Table 3.	Torque Values for Corrosion-Resistant Steel (CRES) and Aluminum Alloy Threaded Fasteners.....	24
Table 4.	Required Locking Torque at Room Ambient Temperature	25
Table 5.	Minimum Bolt or Screw Thread Protrusion.....	25
Table 6.	Insulation Clearances for Wire	35
Table 7.	Spacing of Lacing from Terminations.....	41
Table 8.	Spacing of Lacing in the Harness	41
Table 9.	Potential Tendency for Galvanic Corrosion.....	65

ABBREVIATIONS, ACRONYMS, AND SYMBOLS

°C	degree Celsius
°F	degree Fahrenheit
µm	micrometer (1×10^{-6} m)
AC	alternating current
AHJ	authority having jurisdiction
AIA	Aerospace Industries Association
ANSI	American National Standards Institute
ASCII	American Standard Code for Information Interchange
ASME	American Society of Mechanical Engineers
ASTM	ASTM International
AWG	American Wire Gage
BHP	Bulkhead Plate
CH ₆ H ₂	methyl hydrazine
COTS	commercial off-the-shelf
CRES	corrosion-resistant steel
CSA	Canadian Standards Association
CSMA/CD	Carrier Sense Multiple Access Collision Detection
DAS	Data Acquisition System
dB	decibel
DB	D-subminiature
DC	direct current
ECA	Electronic Components Association
EIA	Electronic Industries Alliance
EMI	electromagnetic interference
FAC	Florida Administrative Code
FDEP	Florida Department of Environmental Protection
FED	Federal
FOTP	fiber-optic test procedures
ft ³ /min	cubic foot per minute
GP	general publication
GPa	gigapascal (1×10^9 Pa)
GPS	Global Positioning System
GSE	ground support equipment
HD	high density
HGDS	Hazardous Gas Detection System
IEC	International Electrotechnical Commission
IEEE	Institute of Electrical and Electronics Engineers, Inc.
in	inch
in-lb	inch-pound
IR	infrared
ISO	International Organization for Standardization
JSC	Lyndon B. Johnson Space Center
km	kilometer (1×10^3 m)
km/h	kilometer per hour

KNPR	Kennedy NASA Procedural Requirements
KSC	John F. Kennedy Space Center
ksi	kip (1,000 pounds) per square inch
L	liter
L/s	liter per second
LO ₂	liquid oxygen
m	meter
m/s	meter per second
Mbps	megabit (1,000 bits) per second
MD	micro DB
MEK	methyl ethyl ketone
MHz	megahertz (1×10^6 Hz)
MI	mineral-insulated
MIL	military
mm	millimeter (1×10^{-3} m)
MMH	monomethylhydrazine
MPa	megapascal (1×10^6 Pa)
mph	mile per hour
MS	military standard
MSFC	George C. Marshall Space Flight Center
MΩ	megohm (1×10^6 Ω)
N·m	newton meter
N ₂ O ₂	nitrogen dioxide
N ₂ O ₄	nitrogen tetroxide
NAS	National Aerospace Standards
NASA	National Aeronautics and Space Administration
NATO	North Atlantic Treaty Organization
NEC	National Electrical Code
NEMA	National Electrical Manufacturers Association
NFPA	National Fire Protection Association
NIOSH	National Institute of Occupational Safety and Health
nm	nanometer (1×10^{-9} m)
no.	number
NPR	NASA Procedural Requirements
OSHA	Occupational Safety and Health Administration
OTDR	optical time domain reflectometry/reflectometer Pa
Pa	pascal
PC	personal computer
PCB	printed circuit board
PDS	Premise Distribution System
PNCR	Product Nonconformance Report
PTFE	polytetrafluoroethylene
PVC	polyvinyl chloride
ref	reference
RF	radio frequency
RFI	radio frequency interference
RH	relative humidity

RIO	remote input/output
RS	Recommended Standard
RTV	room-temperature vulcanizing
s	second
SAE	Society of Automotive Engineers
SCSI	Small Computer System Interface
SOW	statement of work
SPEC	specification
SSPF	Space Station Processing Facility
STD	standard
TCLP	Toxicity Characteristic Leaching Procedure
TD	Terminal Distributor
TDR	time domain reflectometer
TIA	Telecommunications Industry Association
TJS	terminal junction system
TM	technical manual
typ	typical
UL	Underwriters Laboratories, Inc.
UTS	ultimate tensile strength
UV	ultraviolet
V	volt
VDC	volt direct current
WAD	Work Authorization Document
Ω	ohm

1. SCOPE

This document specifies parts, materials, and processes used in the fabrication, maintenance, repair, and procurement of electrical and electronic control and monitoring equipment associated with ground support equipment (GSE) at the John F. Kennedy Space Center (KSC).

2. APPLICABLE DOCUMENTS

The following documents form a part of this document to the extent specified herein. When this document is used for procurement, including solicitations, or is added to an existing contract, the specific revision levels, amendments, and approval dates of said documents shall be specified in an attachment to the solicitation/statement of work/contract.

2.1 Governmental

2.1.1 Specifications

John F. Kennedy Space Center (KSC), NASA

120E3100001	Specification for Heavy Duty GSE Cable, General
120E3100003	GSE Cable Fabrication Specification
75M11300	Marker Tape
KSC-E-166	Installation and Assembly, Electrical Ground Support Equipment (GSE), Specification for
KSC-SPEC-E-0002	Modular Electrical Enclosures, Racks, Consoles, and Accessories, Specification for
KSC-SPEC-E-0024	Cable, Electrical, Shielded, Jacketed, for Harness Assemblies, General Specification for
KSC-SPEC-E-0031	Cables, Electrical, Specification for

Lyndon B. Johnson Space Center (JSC), NASA

SE-S-0073	Space Shuttle Specification, Fluid Procurement and Use Control
-----------	--

Federal

A-A-59125	Terminal Boards, Molded, Barrier Screw and Stud Types and Associated Accessories
-----------	--

A-A-59126	Terminals, Feedthru (Insulated) and Terminals, Stud (Insulated and Noninsulated)
A-A-59298	Tape, Pressure-Sensitive Adhesive
A-A-59551	Wire, Electrical, Copper (Uninsulated)
A-A-59569	Braid, Wire (Copper, Tin-Coated, Silver-Coated, or Nickel-Coated, Tubular or Flat)

Military

MIL-A-22262	Abrasive Blasting Media: Ship Hull Blast Cleaning
MIL-DTL-17	Cables, Radio Frequency, Flexible and Semirigid, General Specification for
MIL-DTL-5541	Chemical Conversion Coatings on Aluminum and Aluminum Alloys
MIL-DTL-16878	Wire, Electrical, Insulated, General Specification for
MIL-DTL-22992	Connectors, Plugs and Receptacles, Electrical, Waterproof, Quick Disconnect, Heavy Duty Type, General Specification for
MIL-DTL-24308	Connectors, Electric, Rectangular, Nonenvironmental, Miniature, Polarized Shell, Rack and Panel, General Specification for
MIL-DTL-26482	Connectors, Electrical (Circular, Miniature, Quick Disconnect, Environment Resisting), Receptacles and Plugs, General Specification for
MIL-DTL-38999	Connectors, Electrical Circular, Miniature, High Density, Quick Disconnect (Bayonet, Threaded and Breech Coupling), Environment Resistant, Removable Crimp and Hermetic Solder Contacts, General Specification for
MIL-DTL-55302	Connectors, Printed Circuit Subassembly and Accessories
MIL-DTL-83513	Connectors, Electrical, Rectangular, Microminiature, Polarized Shell, General Specification for
MIL-P-85891	Plastic Media for Removal of Organic Coatings

MIL-PRF-46010	Lubricant, Solid Film, Heat Cured, Corrosion Inhibiting
MIL-T-713	Twine, Fibrous: Impregnated, Lacing and Tying
QPL-46058-87 Notice 1	Insulating Compound, Electrical (for Coating Printed Circuit Assemblies)

2.1.2 Standards

National Aeronautics and Space Administration (NASA)

NASA-STD-5005	Standard for the Design and Fabrication of Ground Support Equipment
NASA-STD-5008	Protective Coating of Carbon Steel, Stainless Steel, and Aluminum on Launch Structures, Facilities, and Ground Support Equipment
NASA-STD-6001	Flammability, Offgassing, and Compatibility Requirements and Test Procedures
NASA-STD-8739.1	Workmanship Standard for Polymeric Application on Electronic Assemblies
NASA-STD-8739.4	Crimping, Interconnecting Cables, Harnesses, and Wiring
NASA-STD-8739.5	Fiber Optic Terminations, Cable Assemblies, and Installation

John F. Kennedy Space Center (KSC), NASA

KSC-DE-512-SM	Facility Systems, Ground Support Systems, and Ground Support Equipment General Design Requirements
KSC-STD-132	Potting and Molding Electrical Cable Assembly Terminations, Standard for
KSC-STD-E-0002	Hazardproofing of Electrically Energized Equipment, Standard for
KSC-STD-E-0012	Facility Grounding and Lightning Protection, Standard for
KSC-STD-E-0015	Marking of Ground Support Equipment, Standard for

KSC-STD-E-0021 KSC Telecommunication Premises Distribution Systems, Design of, Standard for

KSC-STD-E-0022 Bonding, Grounding, Shielding, Electromagnetic Interference, Lightning, and Transient Protection, Design Requirements for Ground Systems

George C. Marshall Space Flight Center (MSFC), NASA

MSFC-STD-156 Riveting, Fabrications and Inspection, Standard for

MSFC-STD-486 Threaded Fasteners, Torque Limits for, Standard

Federal

CFR Title 29, Part 1910 Occupational Safety and Health Standards

CFR Title 40, Parts 260–282 Protection of Environment

CFR Title 49 Transportation

FED-STD-595 Colors Used in Government Procurement

State

FAC FDEP Division 62 Florida Administrative Code (FAC), Florida Department of Environmental Protection (FDEP), Division 62

Military

MIL-STD-129 Military Marking for Shipment and Storage

MIL-STD-202 Test Method Standard: Electronic and Electrical Component Parts

MIL-STD-461 Requirements for the Control of Electromagnetic Interference Characteristics of Subsystems and Equipment

MIL-STD-464 Electromagnetic Environmental Effects, Requirements for Systems

MIL-STD-889 Dissimilar Metals

MIL-STD-2073-1 Standard Practice for Military Packaging

MS27466 Connectors, Receptacle, Electrical, Wall Mounting Flange, Crimp Type, Bayonet Coupling, Series I

2.1.3 Drawings

John F. Kennedy Space Center (KSC), NASA

75M02047	Plate, Calibrated Bleed
75M05218	Complex 39 Cast Chassis
75M13676	Shield Rings
79K04613	Electrical Cable Shield Termination
79K06110	MI Cable Termination
79K07416	Cable and Harness Assembly, Fabrication Details
79K07491	Installation, Purge Hardware
79K13308	Printed Wiring Board Assembly, Electronic Control Module
79K14177	Instructions for Potting and Molding Connector Assemblies
79K19600	Electrical Cable Fabrication Requirements
79K22638	Solderless Electrical Connections (Supersedes 75M05668)
82K03874	Miscellaneous Cable Fabrication Details, Specification for
82K03878	Intrabuilding Control, Signal, and Communication Cable Specification for SSPF and Related Buildings for Kennedy Space Center
82K04459	Electrical Connectors Termination Details

2.1.4 Publications

National Aeronautics and Space Administration (NASA)

NPR 8715.3C NASA General Safety Program Requirements

John F. Kennedy Space Center (KSC), NASA

GP-777 Handbook for Exterior Electrical Enclosures

KNPR 8500.1 KSC Environmental Requirements

KNPR 8715.3-1 KSC Safety Procedural Requirements, Volume 1,
Safety Procedural Requirements for Civil
Servants/NASA Contractors

KNPR 8730.1 KSC Metrology and Calibration Procedural
Requirements

KSC-GP-864, Volume IIA Electrical Ground Support Equipment Cable
Handbook

KSC-NE-9187 Sensors, Transducers and Signal Conditioning
Systems Selection Process

KSC-TM-584 Corrosion Control and Treatment Manual

(Copies of specifications, standards, drawings, and publications required by suppliers in connection with specified procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Non-Governmental

Aerospace Industries Association (AIA)/National Aerospace Standards (NAS)

AIA/NAS NASM25027 Nut, Self-Locking, 250 Deg. F, 450 Deg. F, and 800
Deg. F

AIA/NAS NASM33540 Safety Wiring, Safety Cabling, Cotter Pinning,
General Practices for

AIA/NAS NASM35333 Washer, Lock, Flat-Internal Tooth

American Society of Mechanical Engineers (ASME)

ASME B107.14 Hand Torque Tools (Mechanical)

KSC-E-165
Revision F

ISO 10012

Measurement management systems – Requirements
for measurement processes and measuring
equipment

IPC – Association Connecting Electronics Industries

IPC 2221	Generic Standard on Printed Board Design
IPC 2222	Sectional Design Standard for Rigid Organic Printed Boards
IPC 6011	Generic Performance Specification for Printed Boards
IPC 6012	Qualification and Performance Specification for Rigid Printed Boards
IPC 7711/7721	Rework, Modification, and Repair of Electronic Assemblies
IPC-HDBK-001	Handbook and Guide to Supplement J-STD-001 (Requirements for Soldered Electrical and Electronic Assemblies)
IPC J-STD-001	Requirements for Soldering Electrical and Electronic Assemblies
IPC J-STD-001S	Space Applications Electronic Hardware Addendum to IPC J-STD-001E
IPC/WHMA-A-620	Requirements and Acceptance for Cable and Wire Harness Assemblies

National Aerospace Standards (NAS)

NAS 1744	Splice, Conductor, Solder Style, Hot Air or Infrared, Shrinkable, Insulated, Immersion Resistant
----------	--

National Conference of Standards Laboratories (NCSL)

NCSL Z540.3	Requirements for the Calibration of Measuring and Test Equipment
-------------	--

National Electrical Manufacturers Association (NEMA)

NEMA VE 2	Cable Tray Installation Guidelines
NEMA WC 63.1	Performance Standard for Twisted Pair Premise Voice and Data Communications Cables

NEMA WC 66	Standard for Category 6 and 6A, 100 Ohm, Individually Unshielded Twisted Pairs, Indoor Cables (With or Without an Overall Shield) for Use in LAN Communication Wiring Systems
------------	---

National Fire Protection Association (NFPA)

NFPA 496	Standard for Purged and Pressurized Enclosures for Electrical Equipment
NFPA 497	Recommended Practice for the Classification of Flammable Liquids, Gases, or Vapors and of Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas
NFPA 70	National Electrical Code

Society for Protective Coatings

SSPC-AB 1	Mineral and Slag Abrasives
SSPC-SP 1	Solvent Cleaning
SSPC-SP 3	Power Tool Cleaning
SSPC-SP 5/NACE No. 1	White Metal Blast Cleaning

Society of Automotive Engineers (SAE)

SAE AIR6151	Torque, Threaded Application, Electrical Connector, Accessory and Terminal Board Installation
SAE AMS 2518	Thread Compound, Anti-Seize, Graphite-Petrolatum
SAE AMS 2695C	Connections, Electrical, Solderless, Wire-Wrapped
SAE AMS-DTL-23053	Insulation Sleeving, Electrical, Heat Shrinkable, General Specification for
SAE AMS-DTL-23053/1	Insulation Sleeving, Electrical, Heat Shrinkable, Crosslinked Chlorinated Polyolefin, Flexible
SAE AMS-DTL-23053/5	Insulation Sleeving, Electrical, Heat Shrinkable, Polyolefin, Flexible, Crosslinked
SAE AMS-DTL-23053/15	Insulation Sleeving, Electrical, Heat Shrinkable, Polyolefin, Heavy-Wall, Coated, Flexible, Outer Wall Crosslinked

SAE AMS-I-7444	Insulation Sleeving, Electrical, Flexible
SAE AMS-I-23053/2	Insulation Sleeving, Electrical, Heat Shrinkable, Polyvinyl Chloride Flexible, Crosslinked and Non-Crosslinked
SAE AS 1072	Sleeve, Hose Assembly, Fire Protection
SAE AS 7928	Terminals, Lug: Splices, Conductors: Crimp Style, Copper, General Specification for
SAE AS 8660	Silicone Compound NATO Code Number S-736
SAE AS 18121	Ferrules, Outer, Insulated, Shield Terminating, Type II, Two-Piece, Class I, for Shielded Cable
SAE AS 21608	Ferrule, Shield Terminating, Crimp Style
SAE AS 21980	Ferrules, Outer, Uninsulated, Shield Terminating, Type I, Two-Piece, Class I, for Shielded Cable
SAE AS 21981	Ferrule, Inner, Uninsulated, Shield Terminating, Type I, Two-Piece, Class I, for Shielded Cable
SAE AS 22520	Crimping Tools, Wire Termination, General Specification for
SAE AS 25036	Terminal, Lug, Crimp Style, Copper, Insulated, Ring Tongue, Bell-Mouthed, Type II, Class 1 (for 105 °C Total Conductor Temperature)
SAE AS 27212	Terminal Board Assembly, Molded-In-Stud, Electric
SAE AS 50151	Connectors, Electrical, Circular Threaded, AN Type, General Specification for
SAE AS 50861	Wire, Electric, Polyvinyl Chloride Insulated, Copper or Copper Alloy
SAE AS 81714	Terminal Junction Systems (TJS), Environment Resistant, General Specification for
SAE AS 81822	Wire, Electrical, Solderless Wrap, Insulated and Uninsulated, General Specification For (Stabilized Type)
SAE AS 81824/1	Splice, Electric, Permanent, Crimp Style Copper, Insulated Environment Resistant, Class 1

SAE AS 83519 Shield Termination, Solder Style, Insulated, Heat-Shrinkable, Environment Resistant, General Specification for

Telecommunications Industry Association (TIA)

TIA/EIA-455-78 FOTP-78 IEC 60793-1-40 Optical Fibres – Part 1–40: Measurement Methods and Test Procedures – Attenuation

TIA-440-B Fiber Optic Terminology

TIA-455-133-A FOTP-133 IEC-60793-1-22 Optical Fibres – Part 1–22: Measurement Methods and Test Procedures – Length Measurement

Underwriters Laboratories Inc. (UL)/Canadian Standards Association (CSA)

UL 444/CSA C22.2 Standard for Safety: Communications Cables

UL486F Standard for Safety: Bare and Covered Ferrules

UL508A Standard for Safety: Industrial Control Panels

2.3 Order of Precedence

In the event of conflict between the documents referenced herein and the contents of this document, the contents of this document shall supersede except where otherwise noted. The applicable NASA contract or purchase/procurement order shall take precedence over the contents of this document in the event of conflicting requirements. Nothing in this document supersedes applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

The requirements of this specification apply to the fabrication, maintenance, repair, and procurement of all electrical and electronic control and monitoring equipment associated with GSE at KSC. The contractor shall be responsible for adhering to the provisions of this specification. The contractor is also responsible for adhering to all local, state, and Federal safety regulations during performance of work specified in this document, including but not limited to, KNPR 8715.3-1, NPR 8715.3C, and CFR Title 29, Part 1910 (OSHA). The contracting officer shall be responsible for interpreting the provisions and verifying compliance with this specification. No substitutions of items shall be allowed unless approved by the contracting officer or the designated representative. If this specification is used for contracts for maintenance and repair, the responsibility for interpreting the provisions of and verifying compliance with this specification shall belong to the Government technical contact (NASA systems engineer, sustaining engineer, etc.).

3.1 Metal and Sheet Metal Assemblies, Subassemblies, and Details

Where required, all metal and sheet metal assemblies, subassemblies, and details shall be fabricated as specified by the applicable drawings and specifications in accordance with this specification, using methods that will ensure an end product of high-quality standards and appearance. Protective coatings for carbon steel, stainless steel, and aluminum shall be applied in accordance with the following paragraphs and NASA-STD-5008. Equipment racks shall be in accordance with KSC-SPEC-E-0002 and shall be designed to maintain the panel and chassis slide mounting dimensions specified in KSC-SPEC-E-0002 so standard panels and hardware may be used. The dimensions of standard 483-millimeter (mm) (19-inch [in]) panels shall be in accordance with EIA/ECA-310. Commercial off-the-shelf (COTS) racks and enclosures will comply with KSC-SPEC-E-0002.

3.1.1 Surface Preparation

All surfaces to be coated shall be clean, dry, and free from oil, grease, dirt, dust, corrosion, peeling paint, caulking, weld spatter, and any other surface contaminants. All surfaces that will become inaccessible after fabrication, erection, or installation shall be prepared and coated while accessible. Surface preparation and coating operations shall be sequenced so that freshly applied coatings will not be contaminated by dust or foreign matter. All equipment and adjacent surfaces that are not to be coated shall be protected from contamination during surface preparation.

Surfaces shall be masked before painting to leave unpainted conductive contact areas where designated. Working mechanisms shall be protected against an intrusion of abrasive material. All surfaces shall be degreased, as required, before more surface preparation work is done or protective coatings are applied, or both. Additional metal-specific surface preparation shall be performed in accordance with NASA-STD-5008.

NOTES

1. Only aggregates that are free of crystalline silica shall be selected for use at NASA. Exemptions to this policy shall be coordinated with the local Occupational Health Office.
2. Blasting aggregate for abrasion-sensitive hardware (such as bellows, gimbal joints, and other thin-walled components) shall be materials that produce no additional surface profile. Blasting operations shall not produce holes, cause distortion, remove metal, or cause thinning of the substrate.

3.1.1.1 Abrasive Blasting

The abrasive blasting system shall comply with Occupational Safety and Health Administration (OSHA), American National Standards Institute (ANSI), and National Institute of Occupational Safety and Health (NIOSH) configurations. The blasting system shall be designed to produce the specified cleanliness level and profile when coupled with the available compressed air supply.

Blasting aggregates shall be clean and dry, and made of approved materials in accordance with MIL-A-22262 or SSPC-AB 1, Type I or II, Class A, or steel grit. Only materials approved in the QPL attached to MIL-A-22262 shall be used. The abrasive grade selected must produce the required surface profile and possess physical properties that are compatible with the requirements of this standard. The steel grit shall be a neutral (6.0 to 8.0 pH), rust-free, oil-free, dry, commercial-grade blasting grit with a hardness of 40 to 50 Rockwell C. The size shall be selected to produce the required anchor profile. For removing paint or cleaning aluminum, stainless steel, and fiberglass, in accordance with MIL-P-85891, plastic media may be used as an alternate.

Abrasive residues shall be removed from the surface, leaving it clean and dry before the coatings are applied. The particulate emissions generated during abrasive blasting operations shall be contained. The containment system shall comply with all applicable Federal, state, and local regulations as well as all NASA policies. Exemptions to this requirement shall be coordinated with the local environmental management office.

Care shall be taken in identifying and selecting the aggregate to use in preparing abrasive-sensitive hardware such as bellows, gimbal joints, and other thin-walled components.

3.1.1.2 Degreasing

Degreasing shall be done by cleaning with solvents, washing with detergent, or steam-cleaning in accordance with SSPC-SP 1. This procedure shall be followed when cleaning steel, galvanized steel, or stainless steel. NASA policy prohibits the use of chlorofluorocarbon solvents. Solvents shall be selected in accordance with all applicable Federal, state, and NASA environmental policies. Hardware shall be washed with water when high levels of chloride or other undesirable contaminants are found on the surfaces. This shall be accomplished using standard industrial pressure cleaners with a pressure-versus-volume-output balance that will provide thorough cleaning. High-pressure water cleaning shall not be used as a cleaning method if the existing paint film on a surface exceeds any of the characteristics for toxicity listed in the Toxicity Characteristic Leaching Procedure (TCLP). No chemical shall be added to the water used for the paint blasting/removal operation, and no discharge shall be directed to surface waters. A 40-micrometer (μm) filter mesh shall be used to screen wastewater discharge on operations performed over pervious surfaces. Points of discharge shall be identified before water blasting operations are performed over impervious surfaces. All discharges shall then be channeled to pervious areas by using sandbags and a 40 μm filter mesh. Any residues generated in water blasting operations shall be disposed of in accordance with local environmental regulations. All records of water blasting operations shall be submitted to the local environmental management office. The cleaned surface shall be free of loose coating material, chlorides, dirt, dust, mildew, grinding/welding/cutting debris, and visible contaminants. The surface shall be clean and dry before abrasive blasting is done and coatings are applied.

3.1.2 Protective Coatings, Thinners, and Cleaners

Minimum requirements for each generic type of protective coating specified in 3.1.2.1 are listed in NASA-STD-5008. Thinners and cleaners for each coating shall be procured from the manufacturer of the coating, except for potable water epoxy as specified in NASA-STD-5008. To ensure intercoat compatibility, coating systems consisting of more than one coat shall be products of the same manufacturer, except for inorganic and polysiloxane topcoats. Additional metal-specific protection requirements shall be met in accordance with NASA-STD-5008.

Continuity of use of the coating manufacturer's system shall be maintained for the duration of an individual project.

All coatings must possess physical properties and handling characteristics that are compatible with the application requirements of this standard, and all coatings must be self-curing.

3.1.2.1 Generic Protective Coatings

- a. Inorganic zinc coatings
- b. Primer and/or intermediate coatings
 - (1) Inhibitive polyimide epoxy coatings
 - (2) Noninhibitive polyimide epoxy coatings
 - (3) Water-reducible intermediate coatings
- c. Finish coatings
 - (1) Aliphatic polyurethane coatings
 - (2) Water-reducible topcoats
 - (3) Inorganic topcoats
 - (4) Polysiloxane topcoats
- d. Epoxy mastic coatings
- e. Coal tar epoxy coatings
- f. Potable water epoxy coatings
- g. Nonskid coatings

3.1.2.2 Application of Coatings

All prepared surfaces shall be coated within 6 hours after the surface preparation has been completed and before corrosion or recontamination occurs. Surfaces prepared under temperature and humidity control may be coated after 6 hours but only after a reinspection of the surface preparation confirms that the surface is at the specified cleanliness level.

No coating shall be applied when contamination from rainfall is imminent or when the temperature or humidity is outside limits recommended by the coating manufacturer. To prevent

condensation while the coating is being applied, the surface temperature must be at least degrees Celsius (°C) (5 degrees Fahrenheit [°F]) above the dewpoint. Wind speed shall not exceed 25 kilometers per hour (km/h) (15 miles per hour [mph]) in the immediate coating area when using spray application methods.

NOTES

1. Relative humidity (RH) limitations using certain coatings shall be followed:
2. <40% RH solvent-based inorganic zinc coatings, PSX 700, and inorganic topcoats shall not be applied.
3. <40% or >80% RH water-based inorganic zinc coatings shall not be applied.

Any surface that shows corrosion or contamination, regardless of the length of time after preparation, shall be prepared again. The application and handling characteristics of coatings will vary. To obtain optimum performance, adequate written instructions from the manufacturer are essential and must be closely followed in conjunction with the requirements defined in this specification. The manufacturer's recommendations for thinning, mixing, handling, and applying the product shall be strictly followed. Coatings shall be thoroughly worked into all joints, crevices, and open spaces. Newly coated surfaces shall be protected from damage. Any item of equipment or adjacent surface that is not to be coated shall be protected from overspray and splattered coatings. The particulate emissions from spray painting operations shall be contained while the work is being done. The containment system shall be designed to comply with Federal, state, and local regulations as well as NASA policies. Exemptions to this requirement shall be coordinated with the local environmental management organization.

3.1.2.3 Colors

Rack and enclosure colors shall be in accordance with NASA-STD-5008 and FED-STD-595. In some operational areas, textured finishes and colors other than those specified herein have become standard. Racks and enclosures in these areas should receive a matching color and texture.

3.1.2.4 Storage, Mixing, and Application Methods

Storage, mixing, and application methods of coating materials shall be in accordance with NASA-STD-5008.

3.1.2.5 Coating Finish

Each coat of material applied shall be free of runs, sags, blisters, bubbles, and mudcracking; variations in color, gloss, and texture; holidays (missed areas); excessive film buildup; foreign contaminants; dry overspray; etc. Special care shall be taken to ensure complete coverage and

proper thickness on welds, corners, crevices, sharp edges, bolts, nuts, and rivets. Each coat of applied material shall be rendered clean, dry, and free from surface contaminants before the next layer of coating is applied.

3.1.2.6 Touchup of Welds and Damaged Coatings

Touchup of welds and damaged coatings shall be in accordance with NASA-STD-5008.

The coating manufacturer's recommended drying and curing times for handling, recoating, and topcoating shall be followed. Coating manufacturer's recommendations shall be followed to test the coating for proper curing. Proper curing of solvent-based inorganic zinc-rich coatings must be verified by ASTM D 4752-03 prior to further coating. Water-based inorganic zinc-rich coatings must be verified for curing, in accordance with the same procedure, but water must be substituted as the solvent.

NOTE

The cure rate of solvent-based inorganic zinc coatings can be accelerated by rinsing or spraying them with fresh water after an initial overnight drying. The number and frequency of rinse cycles can vary with environmental conditions. Check with the material's manufacturer for recommended procedures.

3.1.3 Sealants and Caulking

Sealants shall be self-curing, single-component, polysulfide rubber or polyurethane material only, conforming to ASTM C 920, Type S, Grade NS, Class 25, use NT, A, and O. If not topcoated, the caulking shall match the color of the joint surface being caulked. If caulking is to be used in a clean-room environment, an approved material with low off-gassing properties shall be selected.

The perimeter of all faying surfaces, joints open less than 13 mm (0.5 in), and skip-welded joints shall be completely sealed. For inorganic zinc primers on carbon steel, apply the sealant to the joint with a caulking gun after applying the primer. For topcoated zinc primers, apply the caulking after applying an intermediate epoxy coat; and for coatings on stainless steel, galvanized steel, and aluminum, apply the caulking before applying the topcoat. The bead shall have a smooth and uniform finish and shall be cured (tacky to the touch) before the topcoat is applied.

3.1.4 Chip-Free Clean-Room Paint

Paint systems for metal substrates in clean rooms shall pass tests for adhesion, off-gassing, flammability, and hypergolic compatibility at the NASA Spaceport Technology Development Office, Kennedy Space Center, Florida. Approved systems are listed in NASA-STD-5008.

3.1.5 Zones of Exposure

Coating system requirements for surfaces located in specific environments are defined in NASA-STD-5008.

3.1.6 Aluminum Racks, Enclosures, Panels, Junction Boxes, and Miscellaneous Details

3.1.6.1 Materials

Aluminum racks, enclosures, junction boxes, and miscellaneous details shall be fabricated from 5000-series or 6000-series aluminum alloys in accordance with KSC-SPEC-E-0002,

ASTM B209, or ASTM B221; and material specified on the applicable drawings and specifications. Aluminum panels fabricated from 3.2 mm (0.125 in)-thick 6061-T6 aluminum are preferred, and aluminum 6063- and 5052-type alloys are acceptable.

3.1.6.2 Cleaning, Treating, and Coating

Aluminum castings shall be cleaned in accordance with NASA-STD-5008. Aluminum racks, enclosures, panels, junction boxes, and miscellaneous details shall be cleaned, treated, and coated in accordance with the following paragraphs.

3.1.6.2.1 Surface Preparation

Surface preparation shall be in accordance with NASA-STD-5008.

CAUTION

Some aluminum configurations are susceptible to distortion and/or destruction when they are cleaned by abrasive blasting. Special care shall be taken to prevent metal damage by choosing the proper abrasive aggregate, reducing the blast nozzle pressure, and increasing the distance from the nozzle to the surface as necessary. In some cases, such as in the surface preparation of light-gage sheets, these precautions may not be sufficient to prevent distortion and an alternate procedure, such as abrading or mechanical cleaning, must be used to remove corrosion or roughen the surface.

3.1.6.3 Chromate Coatings

Where maximum conductivity is desired (such as in panels), chromate coatings shall be in accordance with MIL-DTL-5541, class 3 (clear chromate is preferred). All other aluminum fabrications, especially those made of softer forming alloys, should be class 1A, yellow

chromate. Thorough chemical or mechanical cleaning shall be done before chromate coatings are applied.

3.1.6.4 Protective Coatings

Protective coatings shall be applied to aluminum surfaces as required for each zone of exposure as described in NASA-STD-5008. Surfaces that will be underground, submerged, or continuously wetted shall be coated with coal tar epoxy conforming to NASA-STD-5008.

3.1.6.5 Finish Colors

The topcoat colors for electrical panels shall be in accordance with FED-STD-595 color number 26440, light gray. The interior surfaces of junction boxes shall be finished with FED-STD-595 color number 27875, white. Unless otherwise specified, all other parts and assemblies shall be finish-painted with FED-STD-595 color number 26251, dark gray.

3.1.7 Steel Racks, Enclosures, Junction Boxes, Assemblies, and Miscellaneous Details

3.1.7.1 Materials

Steel racks, enclosures, junction boxes, and miscellaneous details shall be fabricated from the material specified on the applicable drawings and specifications, and in accordance with KSC-SPEC-E-0002.

3.1.7.2 Cleaning, Treating, and Coating

All carbon steel and stainless-steel surfaces shall be treated in accordance with NASA-STD-5008. Topcoat systems shall be applied according to the zone of exposure as defined in NASA-STD-5008.

3.1.7.3 Finish Colors

Unless otherwise specified, topcoat colors shall be in accordance with FED-STD-595 color number 26251, dark gray, except for the interior back panel surfaces, which shall be FED-STD-595 color number 27875, white.

3.1.8 Fabricated Chassis

3.1.8.1 Materials

Chassis shall be fabricated in accordance with 75M05218. Cast chassis shall be used in all propellant applications. Aluminum alloy 5052-H32, or its equivalent, is preferred for items with formal bends.

3.1.8.2 Cleaning and Treating

Aluminum chassis shall be cleaned and given a chromate coating in accordance with 3.1.6.3. No chassis shall be given a topcoat over the chromate unless specified on the applicable engineering drawing.

3.2 Welding and Brazing

3.2.1 Welding

The welding of all assemblies, subassemblies, and detail parts shall be in accordance with the drawing requirements and KSC-DE-512-SM.

3.2.2 Brazing

The brazing of all assemblies, subassemblies, and detail parts shall be in accordance with drawing requirements and KSC-DE-512-SM. Brazing shall be performed only by operators who have met the requirements of AWS B2.2.

NOTE

The only electrical connections that can be brazed are ground connections.

3.3 Fasteners

Metallic fasteners shall be chosen to minimize dissimilar metal corrosion. When it is not possible to avoid joining dissimilar metals, select metals/alloys as close together as possible in the galvanic series, with the fastener material having a higher electric potential than the mating surface. If corrosion subsequently occurs, the replaceable fastener hardware will be affected rather than the base metal. Refer to GP-777 for the criteria governing the choice of fasteners.

3.3.1 Threaded Fasteners

3.3.1.1 Torque Limits for Threaded Fasteners

Unless otherwise specified, torque values for fastener systems used in shear applications shall not exceed 60 percent of the values shown in Table 1, Table 2, and Table 3. A tolerance of +0 percent and -15 percent shall apply to the specified fastener types.

In circumstances where the nut strength varies from the bolt strength, the torque requirement of the lower strength component shall apply. Torque values for bolts with countersunk heads and threaded fasteners nos. 2 through 10 are specified in MSFC-STD-486. All compression-type electrical connections, such as terminal strips, shall be properly tightened and checked for any indications of looseness.

3.3.1.2 Installation of Nuts on Bolts or Screws

Nuts on bolts or screws shall be installed as follows:

- a. Only sockets and wrenches that have no sharp edges or burrs that could damage the fastener plating or coating shall be used.
- b. Whenever clearance is a problem, torquing shall be from the bolt head side to the high side of the torque range as specified in [Table 1](#), [Table 2](#), and [Table 3](#).
- c. The nut shall not engage any incomplete threads adjacent to the bolt or screw shank.
- d. Any identification mark on the washer used under the nut shall be placed opposite the face of the nut.
- e. When a self-locking nut is installed or removed, the locking or breakaway torque shall comply with the applicable torque value shown in [Table 4](#).
- f. Bolts or screws shall be installed to extend through nuts to comply with the thread minimum protrusion requirement in [Table 5](#).

Table 1. Torque Values for Steel, Cadmium-Plated, Unlubricated Threaded Fasteners

Fastener Size (mm [in])		Grade						Ultimate Tensile Strength					
		SAE2		SAE5		SAE8		862 MPa (125 ksi)		1.10 GPa (160 ksi)		1.24 GPa (180 ksi)	
		N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb
5.000	10-32	1.4	12	2.7	24	3.8	34	3.1	27	4.2	37	5.9	52
6.350	0.2500	6.2	55	9.0	80	11.5	102	10.2	90	13.0	115	16.4	145
7.938	0.3125	11.9	105	17.0	150	25.4	225	17.5	155	26.9	238	36.2	320
9.525	0.3750	20.3	180	29.9	265	42.4	375	31.1	275	45.8	405	59.9	530
11.113	0.4375	31.1	275	54.2	480	68.9	610	56.5	500	84.8	750	97.2	860
12.700	0.5000	47.5	420	68.9	610	102.3	905	78.0	690	107.4	950	142.4	1260
14.288	0.5625	70.1	620	101.7	900	151.9	1344	113.0	1000	158.7	1404	217.0	1920
15.875	0.6250	99.4	880	138.3	1224	207.5	1836	146.4	1296	237.3	2100	284.8	2520
19.050	0.7500	155.9	1380	264.4	2340	339.0	3000	282.0	2496	508.5	4500	474.6	4200
22.225	0.8750	210.2	1860	318.7	2820	542.4	4800	433.9	3840	711.9	6300	759.4	6720
25.400	1.0000	318.7	2820	589.9	5220	817.7	7236	623.8	5520	1017.0	9000	1166.2	10320
28.575	1.1250	508.5	4500	854.3	7560	1301.8	11520	901.7	7980	1573.0	13920	1844.2	16320
31.750	1.2500	711.9	6300	1179.7	10440	1789.9	15840	1247.5	11040	2373.0	21000	2562.8	22680

Notes:

1. These torque values apply to coarse and fine threads.
2. A tolerance of +0% and -15% is applicable.
3. Add locking torque of self-locking devices to torque values specified on the drawing.
4. Torque values are for tension applications. Torque values for shear applications shall not exceed 60% of the values shown unless otherwise specified.

Table 2. Torque Values for Steel, Lubricated (Plated, Unplated) Threaded Fasteners

Fastener Size (mm [in])		Grade						Ultimate Tensile Strength					
		SAE2		SAE5		SAE8		862 MPa (125 ksi)		1.10 GPa (160 ksi)		1.24 GPa (180 ksi)	
		N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb
5.000	10-32	1.0	9	2.0	18	3.4	30	3.1	27	3.7	33	4.4	39
6.350	0.2500	4.7	42	8.1	72	10.2	90	8.8	78	11.2	99	11.6	103
7.938	0.3125	8.8	78	14.9	132	22.4	198	16.3	144	23.7	210	27.1	240
9.525	0.3750	15.3	135	25.8	228	37.3	330	27.1	240	40.7	360	44.7	396
11.113	0.4375	23.7	210	40.7	360	61.0	540	44.1	390	65.1	576	73.2	648
12.700	0.5000	35.6	315	61.0	540	89.3	790	65.1	576	93.8	830	106.2	940
14.288	0.5625	53.1	470	89.3	790	122.0	1080	97.2	860	135.6	1200	162.7	1440
15.875	0.6250	74.6	660	122.0	1080	183.1	1620	135.6	1200	195.3	1728	217.0	1920
19.050	0.7500	122.0	1080	183.1	1620	298.3	2640	217.0	1920	325.4	2880	359.3	3180
22.225	0.8750	162.7	1440	311.9	2760	474.6	4200	345.8	3060	508.5	4500	569.5	5040
25.400	1.0000	244.1	2160	474.6	4200	718.7	6360	522.1	4620	781.1	6912	881.4	7800
28.575	1.1250	372.9	3300	637.3	5640	1152.6	10200	813.6	7200	1220.4	10800	1383.1	12240
31.750	1.2500	535.6	4740	895.0	7920	1593.3	14100	1139.0	10080	1708.6	15120	1925.5	17040

Notes:

1. These torque values apply to coarse and fine threads.
2. A tolerance of +0% and -15% is applicable.
3. Add locking torque of self-locking devices to torque values specified on the drawing.
4. Torque values are for tension applications. Torque values for shear applications shall not exceed 60% of the values shown unless otherwise specified.

Table 3. Torque Values for Corrosion-Resistant Steel (CRES) and Aluminum Alloy Threaded Fasteners

Fastener Size (mm [in])		CRES 300 Series [552 MPa (80 ksi) Minimum UTS]						Aluminum Alloy [427 GPa (62 ksi) Minimum UTS]			
		Passivated		Silver Plated		Lubricated		Anodized		Lubricated	
		N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb	N·m	in-lb
5.000	10-32	3.4	30	2.7	24	2.0	18	1.6	14	1.0	9
6.350	0.2500	7.9	70	6.3	56	4.7	42	5.1	45	2.8	25
7.938	0.3125	14.7	130	11.8	104	8.8	78	9.0	80	5.1	45
9.525	0.3750	25.4	225	20.3	180	15.3	135	16.4	145	9.6	85
11.113	0.4375	42.4	375	33.9	300	25.4	225	26.0	230	15.3	135
12.700	0.5000	56.5	500	45.2	400	33.9	300	36.2	320	21.5	190
14.288	0.5625	79.1	700	63.3	560	47.5	420	52.0	460	28.3	250
15.875	0.6250	113.0	1000	90.4	800	67.8	600	74.0	655	48.6	430
19.050	0.7500	162.7	1440	130.0	1150	97.2	860	106.2	940	65.5	580
22.225	0.8750	257.6	2280	203.4	1800	154.6	1368	162.7	1440	97.2	860
25.400	1.0000	352.6	3120	284.8	2520	210.2	1860	217.0	1920	130.0	1150
28.575	1.1250	528.8	4680	420.4	3720	318.7	2820	325.4	2880	189.8	1680
31.750	1.2500	650.9	5760	522.1	4620	393.2	3480	406.8	3600	244.1	2160

Notes:
1. These torque values apply to coarse and fine threads.
2. A tolerance of +0% and -15% is applicable.
3. Add locking torque of self-locking devices to torque values specified on the drawing.
4. Torque values are for tension applications. Torque values for shear applications shall not exceed 60% of the values shown unless otherwise specified.

Table 4. Required Locking Torque at Room Ambient Temperature

Fastener Size		Pitch (mm)	Threads per Inch	Maximum Locking Torque, Installation or Removal		Minimum Breakaway Torque, Removal	
mm	in			N·m	in-lb	N·m	in-lb
4.76	0.1875	0.8	32	2	18	0.2	2.0
6.350	0.2500	1.0	28	3.5	30	0.4	3.5
7.938	0.3125	1.5	24	7	60	0.7	6.5
9.525	0.3750	1.5	24	9	80	1.1	9.5
11.113	0.4375	1.75	20	11	100	1.6	14.0
12.700	0.5000	1.75	20	17	150	2.0	18.0
14.288	0.5625	2.0	18	23	200	2.7	24.0
15.875	0.6250	2.0	18	34	300	3.6	32.0
19.050	0.7500	2.5	16	45	400	5.7	50.0
22.225	0.8750	3.0	14	68	600	7.9	70.0
25.400	1.0000	4.0	12	90	800	10.2	90.0
28.575	1.1250	4.0	12	102	900	13.2	117.0
31.750	1.2500	4.0	12	113	1000	16.2	143.0
34.925	1.3750	4.0	12	124	1100	18.6	165.0
38.100	1.5000	4.0	12	141	1250	22.0	195.0

Table 5. Minimum Bolt or Screw Thread Protrusion

Pitch (mm)	Threads per Inch	Protrusion	
		mm	in
0.8	32	1.57	0.062
1.0	28	1.80	0.071
1.5	24	2.11	0.083
1.75	20	2.54	0.100
2.0	18	2.82	0.111
2.5	16	3.18	0.125
3.0	14	3.63	0.143
4.0	12	4.24	0.167

3.3.1.3 Torque Values for Standard and High-Strength Steel Fasteners

3.3.1.3.1 Plated

Torque values for tightening clean, cadmium-plated, unlubricated steel fasteners shall be in accordance with [Table 1](#).

3.3.1.3.2 Lubricated

Torque values for tightening steel fasteners lubricated with an approved lubricant (see [3.3.1.6](#)) shall be in accordance with [Table 2](#).

3.3.1.4 Torque Values for 300 Series CRES Fasteners

3.3.1.4.1 Passivated

Torque values for tightening clean, passivated CRES fasteners shall be in accordance with [Table 3](#).

3.3.1.4.2 Plated

Torque values for tightening clean, silver-plated CRES fasteners shall be in accordance with [Table 3](#).

3.3.1.4.3 Lubricated

Torque values for tightening CRES fasteners lubricated with an approved lubricant (see [3.3.1.6](#)) shall be in accordance with [Table 3](#).

3.3.1.5 Torque Values for 430 MPa (62 ksi) Tensile Strength Aluminum Alloy Fasteners (2024-T4, 7075-T6)

3.3.1.5.1 Anodized

Torque values for tightening clean, anodized aluminum fasteners shall be in accordance with [Table 3](#).

3.3.1.5.2 Lubricated

Torque values for tightening aluminum fasteners lubricated with an approved lubricant (see [3.3.1.6](#)) shall be in accordance with [Table 3](#).

3.3.1.6 Lubricants

Unless otherwise specified, lubricants equal to or interchangeable with those listed below may be used when necessary to prevent galling or other damage to fastener threads or bearing surfaces. Any lubricant used in liquid oxygen (LO₂) systems or gaseous systems that are used in pressurizing or purging LO₂ systems shall meet the compatibility requirements of NASA-STD-6001.

- a. Everlube 811 (Everlube Corporation)
- b. Drilube 701 (Drilube Company, 711 West Broadway St., Glendale, CA 91204 [CAGE 06186])
- c. Molykote Z (Alpha Molykote Corporation)
- d. EC1730 (Acheson Colloid Company, 1600 Washington Ave., P.O. Box 11747, Pt. Huron, MI 48061 [CAGE 70079])
- e. KEL-F-90 (Minnesota Mining and Manufacturing Company)
- f. Lubricants that are applied to fasteners qualified under NASM 25027
- g. SAE AMS 2518, thread compound, antiseize, graphite-petrolatum
- h. MIL-PRF-46010, lubricant, solid film, heat-cured, corrosion-inhibiting
- i. HD Calcium Grease No. 2 (Continental Oil Company)
- j. CERAN XM 460 (Total Lubricants USA, Inc.) Extreme Pressure, Water Resistant, High Temperature, Calcium Sulfonate Complex Grease

NOTE

When specified on drawings for space vehicles and equipment, grease shall be applied to the structure and shank, threads, and washers of the fastener system. After torquing, excess grease shall be removed with a lint-free cloth or paper towel.

3.3.1.7 Self-Locking Fasteners

The measured locking torque of self-locking fasteners shall be added to the specified torque to obtain the final applied torque.

3.3.1.8 Cotter Pin, Lockwire, and Safety Cable Securing

When securing fasteners with cotter pins, safety cable, or lockwire, tightening may continue beyond the specified torque to permit slot and hole alignment provided the final torque does not exceed the specified torque by more than 10 percent. AIA/NAS NASM 33540 lists the specifications and requirements for installation of cotter pins, lockwire, or safety cable.

3.3.1.9 Safety Cable

A safety cable system consists of one tool for tensioning, crimping, and cutting. After a cable is threaded through the fasteners and a loose ferrule inserted, the calibrated crimping tool tensions the assembly, crimps the loose ferrule, and cuts the excess cable flush to the ferrule. [Figure 1](#) is a diagram of a tension tool, ferrule, and calibration unit. [Figure 2](#) illustrates typical safety cable installations.

3.3.1.10 Nonmetallic Fasteners

Nonmetallic fasteners are useful in applications requiring good thermal and electrical insulation and good corrosion resistance. They shall not be used in applications requiring high-tensile or shear strength or those operating in high temperatures.

3.3.2 Adhesives

Adhesives shall not be used to mount items normally subject to replacement or to secure parts requiring removal when equipment is serviced.


3.3.3 Rivets

Although rivets were previously used at KSC, they are no longer approved for use in mounting items normally subject to replacement or to secure parts that must be removed when equipment is serviced. If rivets are used in new design, they shall be installed in accordance with MSFC-STD-156 unless otherwise specified on the applicable drawings.

3.3.3.1 Chips, Burrs, and Foreign Material

Before parts are riveted together, all chips, burrs, and foreign material shall be removed from the mating surfaces. Burrs may be removed from rivet holes by chamfering to a depth not to exceed 10 percent of the stock thickness or 0.81 mm (0.032 in), whichever is less.

Terminator™ Tool
(pkg. 1 per box)

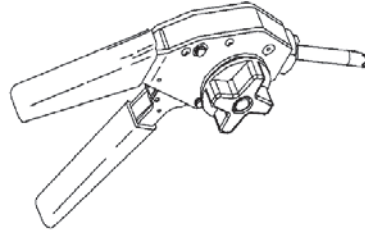

Part No.	Nom. Dia.	Nose Length
BM203	.020"	3"
BM323	.032"	3"
BM325	.032"	5"
BM327	.032"	7"



Safety Cable™ Kit

(kit consists of one cable and one ferrule)
(part number applies to one kit)
(package contains 50 kits)




Safety Cable™ Cable

(part number applies to one cable)
(package contains 50 cables)



Safety Cable™ Ferrule

(part number applies to one ferrule)
(package contains 50 ferrules)



MPT-200A-SC

lab model electronic load
tester for tension and
ferrule pull-off tests

Choose a length that allows the cable to route through the pattern and then into the tool using the formula: **LONGEST PATTERN LENGTH + TOOL NOSE LENGTH + 7" = CABLE LENGTH**

SAFETY CABLE™ KIT; .032" DIAMETER; 18", TYPE 321 CRES.



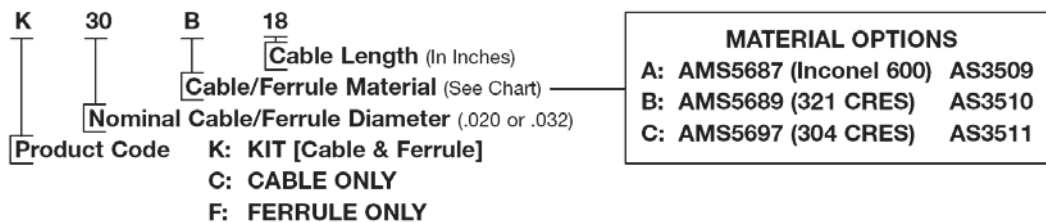



Figure 1. Safety Cable, Tension Tool, Ferrule, and Calibration Unit

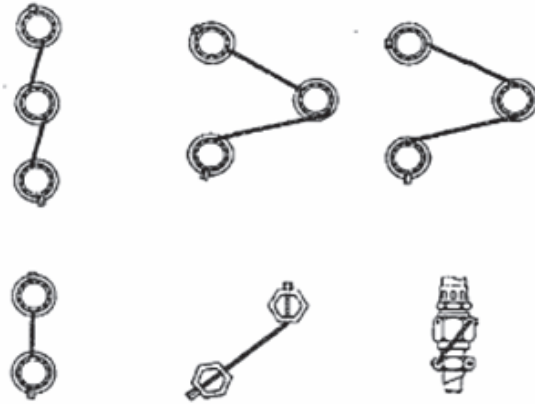

Safety Cable, Typical Installation (Standard Hardware)

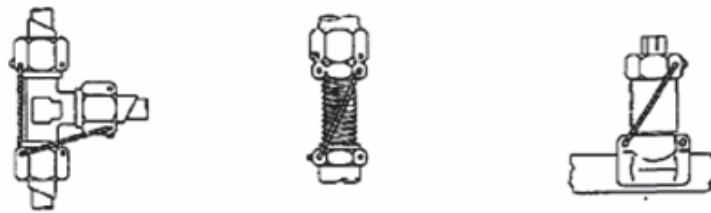

Safety Cable, Typical Installation (Tube Couplings)

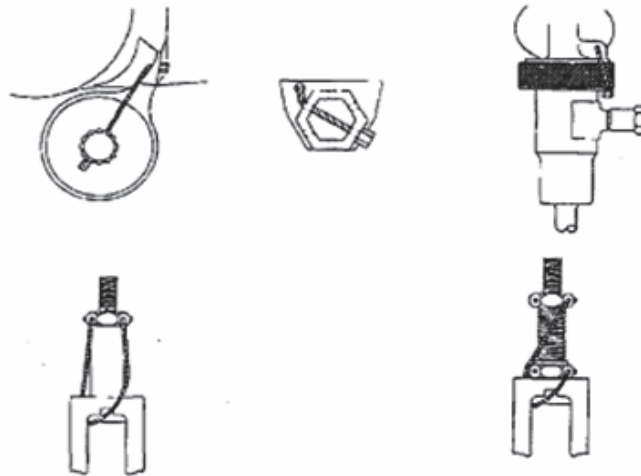

Safety Cable, Typical Installation (Other Installations)

Figure 2. Typical Safety Cable Installations

3.3.3.2 Rivet Substitutions

Rivet substitutions shall not be made without the prior approval of the contracting officer except when a buildup of tolerances makes it necessary to use longer or shorter rivets than specified. In this case, the assembler may make a substitution without requesting approval.

3.4 Identification and Marking (of GSE)

Markings shall be specified on the engineering drawings and in accordance with KSC-STD-E-0015. This includes, but is not limited to, silk screening, engraving, rubber stamping, stenciling, die stamping, photoetching, hot stamping, thermal transfer, computer printing, identification plates, welding, and cast or forged markings. All identification markings shall be above the component, if possible, unless otherwise specified on the drawing. The finished product shall display a professional appearance; and the marking shall not have ragged edges, unbalanced characters, or excess paint (the latter is applicable to silk screening only).

Markings for shipment shall be in accordance with MIL-STD-129. Marker tape shall be in accordance with 75M11300.

3.5 Electrical Harness, Enclosure, Internal

All wiring interior to enclosures, racks and terminal distributors shall be installed in accordance with applicable engineering drawings, NFPA 70, the National Electrical Code (NEC), and the following paragraphs.

3.5.1 Harness Configuration, Internal

The configuration of an internal harness, used to bring electrical circuits/power from external sources to internal enclosure components (terminal blocks, PLCs, other end items), shall be comprised of a connector receptacle, connector backshell and associated wire conductors. Connectors shall be jam nut-style receptacles in accordance with SAE AS 50151 (MS3454) or MIL-DTL-38999 (D3899/24) or commercial equivalent. Connector shell material shall be selected based on enclosure location. Corrosion-resistant stainless steel shall be selected for exterior installations and nickel-plated aluminum for interior compartment locations. The use of Cadmium plating shall not be used for new designs. For enclosures located outdoors or in a hazardous location (ex, Class I, Div 2 area), the receptacle backshell shall be potted using a potting adapter. For enclosures located within environmentally controlled areas (e.g., ML Base), the backshell shall be a standard strain relief type. Backshell material and plating similar to the connector is preferred.

The cable subassembly drawing shall list the materials, instructions, notes, and schematics necessary to fabricate harness.

3.5.2 Wire and Cable, Internal

Wire used to connect between enclosure penetrations (receptacles) and interior end items (terminal blocks, switches, breakers, etc) or as jumpers shall meet the following. Wire sizes 1.27 mm (AWG 16) or less in diameter shall be in accordance with NEMA HP 7, Type B (600V, 105 Deg C, tin-coated/polyvinyl-chloride [PVC]-insulated), or equivalent, for normal usage. Silver-coated HP 7 wire may be used for high speed applications. Wire sizes 1.63 mm (AWG 14) or more in diameter shall conform to SAE AS 50861/1 (600V, 105 Deg C, tin-coated/polyvinyl-chloride [PVC]-insulated, nylon jacketed) or /2 (600V, 105 Deg C, tin-coated/polyvinyl-chloride [PVC]-insulated, PVC-glass-nylon jacketed), or equivalent.

Cable (two or more conductors, jacketed) used to connect between enclosure penetrations and interior end items (terminal blocks, switches, breakers, etc.) shall meet the following. For unshielded cables, stranded, tin, silver or nickel-coated copper conductors, PVC insulation, PVC jacket is preferred. Shielded cable shall be of similar construction along with, at a minimum, 100% foil shield and drain wire. Proper termination of the shield and drain wire within an enclosure shall be detailed on the cable subassembly drawing.

All conductors shall be stranded unless otherwise specified by the applicable engineering drawing. Wirewrap wire shall conform to SAE AS 81822 and the applicable engineering drawing. Uninsulated (tinned copper) bus wire shall conform to A-A-59551, type S (soft). NEMA WC 63.1 defines the minimum electrical performance and allowable conductor sizes, stranding, and shielding for premise wiring cables for voice and data applications including unshielded and shielded 100-ohm (Ω) twisted pairs, Category 5e, and 150 Ω shielded twisted pair cables. The material and mechanical characteristics for these cables are covered under UL 444/CSA C 22.2, No. 214. NEMA WC 66 defines the minimum electrical performance and allowable conductor sizes, stranding, and shielding for premise wiring cables for voice and data applications for Category 6, Category 6A, and unshielded twisted pair cables. The material, mechanical, and physical characteristics for these cables are also covered under UL-444/CSA 22.2, No. 214.

3.5.3 Routing

Routing and connection of wires within an enclosure, rack or terminal distributor shall be either in accordance with the applicable wiring tabulation drawings, schematics, and fabrication drawings or, if no drawings apply, in a logical fashion that gives consideration to avoiding interferences and for installing any associated wiring required. Wires and cables shall be placed and protected so that they are not in contact with rough surfaces or sharp edges and so that they have enough clearance from heat-emitting parts to avoid damage or deterioration. Signal and power cable bundles shall be routed separately whenever possible. Fiber-optic cables should not be routed beneath large bundles of cables or with excessive bends in the fiber-optic cable to preclude deformation or damage to the cable jacket, cladding, or glass core.

3.5.4 Grouping

Unless otherwise specified, wires shall be placed so that they lie parallel in groups where possible, and crossovers shall be held to a minimum. Harnesses in panels, boxes, and similar locations shall be divided neatly into groups. The harnesses shall be divided into groups according to their functions (signal, power, etc.). Signal wires and power wires shall be grouped separately whenever possible (see [Figure 3](#)).

3.5.5 Breakouts

Wires and cables shall be properly supported and secured to prevent undue stress on conductors and terminals. Unless otherwise specified, each wire shall be tied to the bundle at the point of breakout. When breaking out from a group of wires to a terminal strip, the bundle shall have adequate clearance from the terminal lug so that a service loop may be formed. The service loop shall be long enough to allow the wire to be cut, stripped, and terminated two additional times (see [Figure 3](#)). Unless otherwise specified, breakouts of wires shall be perpendicular to the bundle. Plastic cableway, metallic conduit, and metallic trays are acceptable for use in wiring breakouts. If a wiring duct is used, the service loop shall be left in the wiring duct at each point of the breakout.

3.5.6 Wire Stripping

Insulation stripping tools and procedures shall be in accordance with IPC/WHMA-A-620 and [Table 6](#).

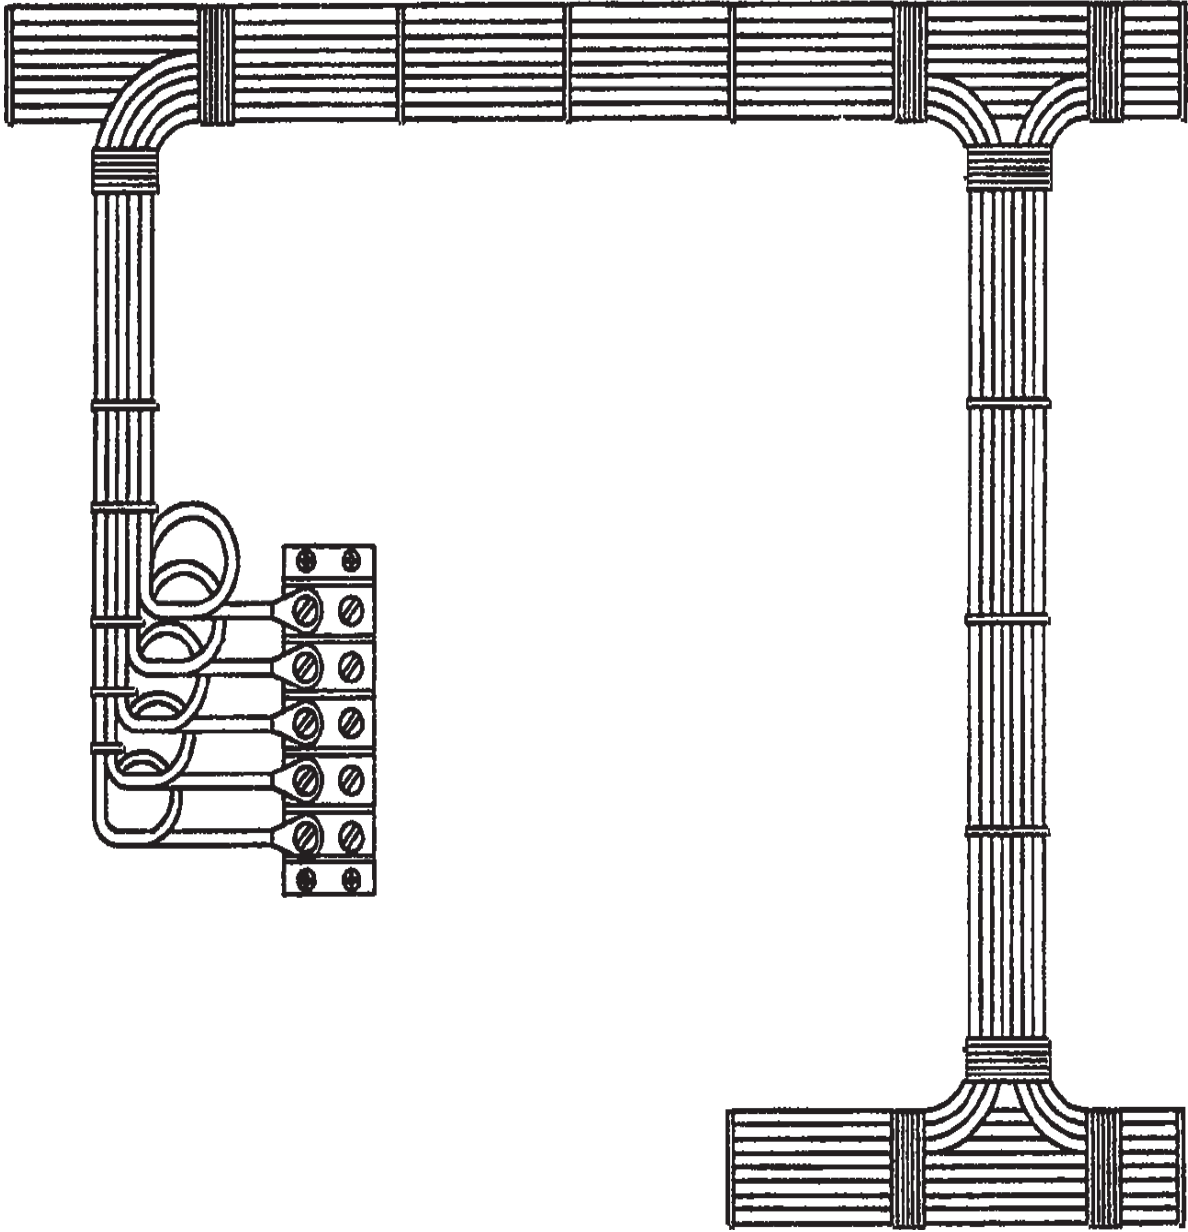


Figure 3. Harness or Wire Bundle

Table 6. Insulation Clearances for Wire

Wire Diameter (mm [AWG Size])	Clearance	
	Minimum (mm [in])	Maximum (mm [in])
Smaller than 0.8 (#20)	Visible clearance	1.5 (0.060)
0.8 (#20) through 2.6 (#10)	0.8 (0.03)	Two times diameter of insulation
3.3 (#8) through 6.6 (#2)	0.8 (0.03)	9.5 (0.38)
7.3 (#1) and larger	0.8 (0.03)	12.7 (0.50)
Coaxial and special wires	According to engineering drawing	

3.5.7 Terminals

Terminations shall be in accordance with 3.6 of this specification. Terminals shall be in accordance with the following paragraphs unless otherwise specified on the detail drawings.

3.5.7.1 Modular Terminal Junction Systems

Modular terminal junction systems shall be in accordance with SAE AS 81714.

3.5.7.2 Screw Terminals

Molded barrier terminal boards shall be in accordance with A-A-59125 or SAE AS 27212. Other types shall be in accordance with 3.6.1.1 of this specification. In accordance with SAE AS 7928, terminal lugs shall be used to terminate the wire wherever the screw terminal is not captive or where stranded wire is used. After wiring, the screw terminals shall be torqued to the values given by the applicable specification or 3.3.1 (or tightened snugly if the torque value is not specified).

3.5.7.3 Compression Terminals

Compression terminals shall be in accordance with 3.6.1.

3.5.7.4 Solder Terminals

Solder terminals shall be in accordance with A-A-59126.

3.5.7.4.1 Terminal Swaging

Swaging has been used historically at KSC to provide termination to terminal boards and printed wiring and/or printed circuit boards (PCBs). If swage repair of legacy terminal boards, wiring boards, and/or PCBs is required, the swage repair shall be accomplished in accordance with the following paragraphs. Terminals may be slightly deformed when they are installed. Swaged terminals shall not be loose after soldering.

- a. Tool selection: A rolled swage tool shall be used when the swage is terminated directly to the terminal board or the noncircuit side of a printed wiring board or PCB. A full funnel swage tool shall be used when the swage is formed in contact with a printed conductor pattern. An elliptical funnel swage tool shall be used when the swage is formed in contact with a printed conductor pattern having a plated through-hole.
- b. Press adjustment: A separate press adjustment shall be made for each type of terminal to be swaged on the production board.
- c. Rolled swage: Press adjustment for a rolled swage shall be made as follows:
 - (1) Install the tools into the press and vertically align the punch and anvil.
 - (2) Maintaining the base of the terminal in contact with the board surface, adjust the press until the rolled swage produced on the terminal is complete and uniform (see [Figure 4](#), View A).
 - (3) Install as many terminals as necessary in the preproduction sample until the press adjustment is visually acceptable.
 - (4) Using a production-type device suitable for soldering the terminals being tested, heat each terminal on the preproduction sample to $260\text{ }^{\circ}\text{C} \pm 28\text{ }^{\circ}\text{C}$ ($500\text{ }^{\circ}\text{F} \pm 50\text{ }^{\circ}\text{F}$) for a minimum of 15 seconds.
 - (5) Apply a minimum torque of 0.14 newton meter (Nm) (20 inch-ounces) to each terminal to ensure tightness.
 - (6) Visually inspect the rolled swage preproduction sample to the acceptance criteria specified in [3.5.7.4.1.f](#).
- d. Funnel swage: Press adjustment for a full or an elliptical funnel swage (see [Figure 5](#)) shall be accomplished as follows:
 - (1) Install swaging tools capable of producing a funnel swage having an included angle of 36 degrees to 60 degrees into the press and vertically align the punch and anvil.
 - (2) Maintaining the base of the terminal in contact with the board surface, adjust the press until the swage tool enters the terminal shank far enough so the angle of the funnel swage produced on the terminal begins at the circuitry (see [Figure 6](#), View A).
 - (3) Visually inspect the funnel swage preproduction sample to the acceptance criteria specified in [3.5.7.4.1.f](#).

NOTE

All gold-plated PCB surfaces shall be properly prepared for soldering prior to swaging.

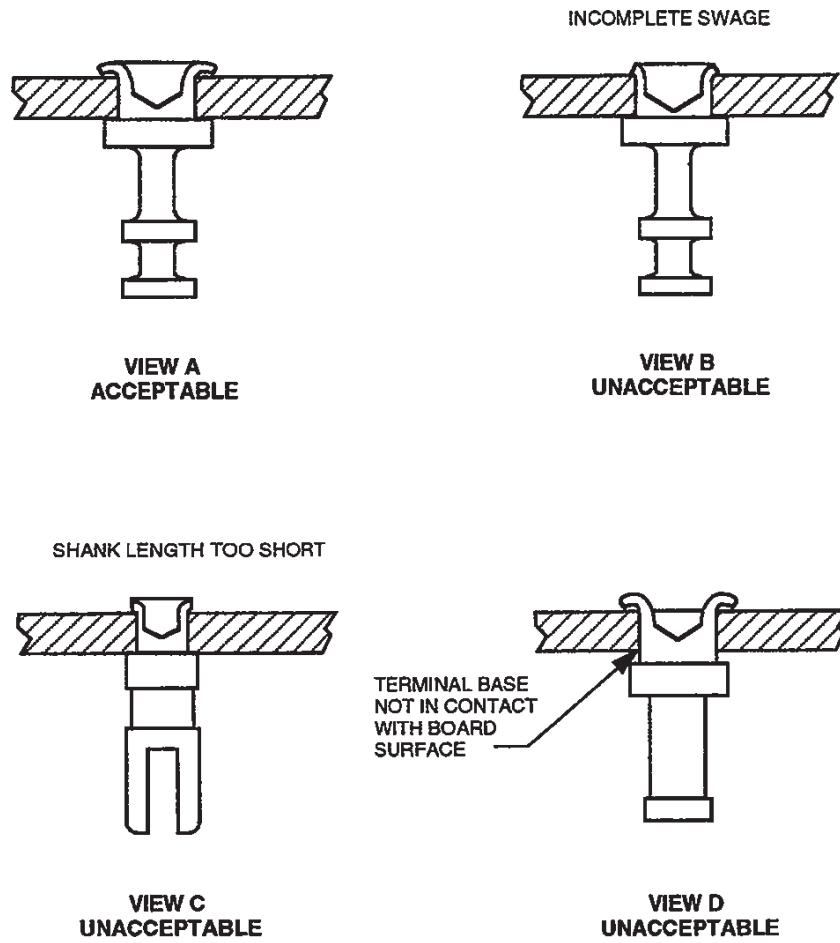


Figure 4. Rolled Swage Terminals

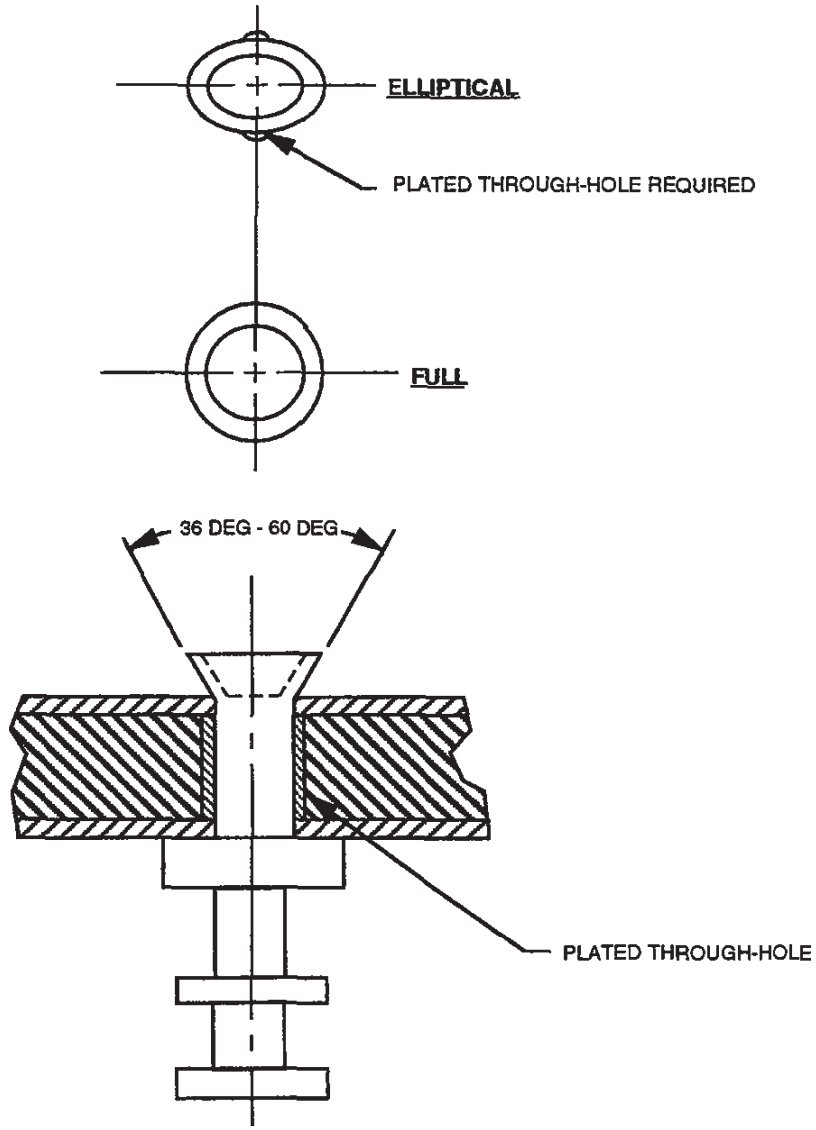


Figure 5. Elliptical Funnel Swage Terminals

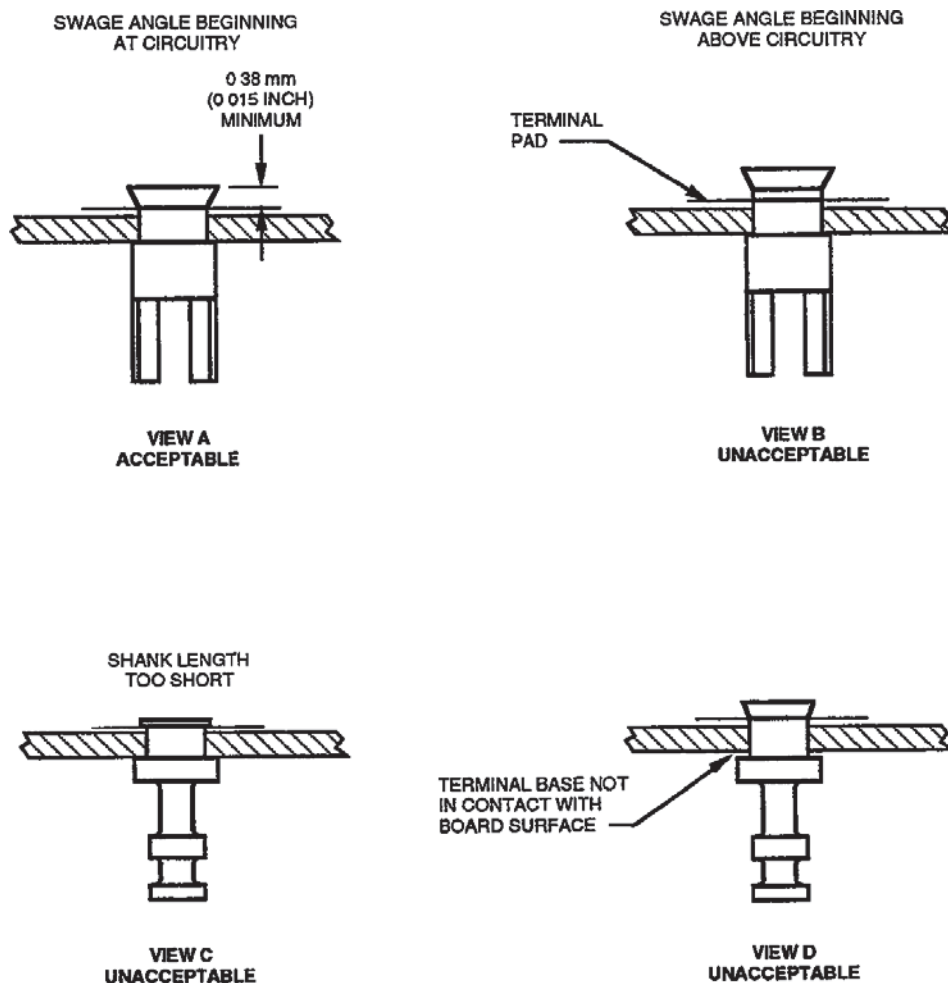


Figure 6. Funnel Swage Terminals

- e. Inspection: A first article inspection shall be performed on a production board before proceeding with a production run and each time thereafter when a change in press adjustment is made. Each completed production board shall be inspected for conformance to the design drawing and the acceptance criteria specified in 3.5.7.4.1.f, using 7-power to 10-power magnification. None of the rejection characteristics specified in 3.5.7.4.1.g shall be visible.
- f. Acceptance criteria: Swaged terminals shall be accepted if they meet the following criteria:
- (1) Terminals are oriented in accordance with the design drawings.
 - (2) The terminal base is in 360-degree contact with the board surface or conductor pattern, as applicable.
 - (3) The rolled swage is complete and uniform.
 - (4) The funnel swage, beginning at the conductor pattern, has an included angle of 36 degrees to 60 degrees and extends 0.38 mm (0.015 in) minimum beyond the conductor surface.

- g. Rejection criteria: Swaged terminals and terminal boards shall be rejected for any of the following criteria:
- (1) Terminals are visibly bent.
 - (2) Terminals have cracks, nicks, or peeled or damaged plating with the base metal exposed.
 - (3) Terminals or board material is damaged by misaligned, improperly fitted, or worn swaging tools, etc.
 - (4) Terminals are not approved by the procuring activity.
 - (5) The board material has continuous discoloration between adjacent terminals, between adjacent electrical conductor paths, or between terminals and adjacent electrical conductor paths.
 - (6) The board material is mealed at the base of the terminal.
 - (7) The conductor pattern is delaminated at the base of the terminal.
 - (8) Radial movement of rolled swage terminals is visible after applying a minimum torque of 0.14 N·m (20 inch-ounces).
 - (9) Terminals have cuts, scratches, or other damage that could entrap moisture or contamination.

3.5.7.4.2 Rework

A rejected terminal board shall be reworked to correct any fault other than those listed in [3.5.7.4.1.g](#) (5), (6), and (7). After rework, the rejected board shall be reinspected.

3.5.7.5 Solderless Wrap Terminals

Solderless wrap terminals shall conform to SAE AMS 2695C.

3.5.8 Lacing and Tying

Lacing and tying of cable harnesses and bundles has typically been done with twine. According to MIL-T-713, “The twine is intended for lacing and tying telephone switchboard cable forms, hookup wires, cable ends, aircraft cable bundles, electrical and electronic equipment, and electrical wire-harness.”

Lacing and tying of GSE electrical harnesses and bundles shall be in accordance with NASA-STD-8739.4 and the following paragraphs.

3.5.8.1 Lacing

Lacing twine shall be in accordance with MIL-T-713, type P, class 2, using black or a contrasting color. Lacing operations shall be in accordance with [Table 7](#) and [Table 8](#).

Table 7. Spacing of Lacing from Terminations

Harness-Bundle Diameter		Distance Between Terminals or Connectors and Lacing	
mm	in	mm	in
Less than 13	Less than 0.5	50	2
13 to 25	0.5 to 1	75	3
25 or larger	1 or larger	100	4

Table 8. Spacing of Lacing in the Harness

Harness-Bundle Diameter		Stitching Interval	
mm	in	mm	in
Less than 13	Less than 0.5	19	0.75
13	0.5	38	1.5
25	1	50	2
Larger than 25	Larger than 1	75	3

Lacing bars shall be used as necessary to support wiring groups and harnesses. If a harness assembly or wire bundle contains branches or conductor breakouts, the following procedures shall apply:

- a. The main trunk of the wire bundle or harness shall be laced between connectors or components (see [Figure 3](#) shown previously).
- b. A terminating serve shall be constructed on the main truck of the harness or wire bundle at the beginning of a wye branch.
- c. The branch shall be continuously laced, beginning with a serve at the junction of the wye.
- d. Terminating serves shall be placed on both sides of a tee junction.
- e. Unless otherwise specified, a lacing stitch shall not be placed between each wire breakout. A double lock-stitch locked with a square knot shall be used when wires in a bundle are routed to a mounted component or component receptacle.
- f. A branch that runs between two main trucks shall be served at both the junctions.
- g. Spacing shall be in accordance with [Table 7](#) and [Table 8](#).

WARNING

Cut ends of cable ties shall not protrude to the extent that the sharp edges may injure a person.

3.5.8.2 Cable Ties and Clamps

Plastic cable ties and approved cable clamps may be used on harness or wire bundles at the discretion of the design activity. The ties shall be mounted snugly on the assembled conductor and shall be capable of being locked to prevent loosening or opening. When installing wires, cables, or harness bundles in vertical or horizontal cable tray systems, NEMA VE 2 (NEMA Standards Publication VE 2-2006) advises, "Cables may be fastened to the cable tray by means of cable clamps or cable ties. Generally, cables are fastened every 450 mm (18 in) on vertical runs. Although not required by the NEC, single conductor cables can be fastened on horizontal runs to maintain spacing, prevent movement due to fault-current magnetic forces, and ensure that the cable is confined within the cable fill area. When using cable clamps, the clamps should be sized correctly and only tightened enough to secure the cable without indenting the jacket. The same precaution should be observed with cable ties, and they should be applied with a pressure limiting device. Extremely long vertical drops introduce a new set of problems requiring special considerations. The weight per meter (foot) of the cable multiplied by the number of meters (feet) in the vertical drop will, in many cases, exceed the load carrying capacity of the cable tray component, such as the one or two rungs supporting this weight, and could exceed the allowable cable tension. The cable weight should be supported in such a manner as to prevent damage to the cable tray or cable during this type of installation. As the cable is installed, intermediate supports should be installed on the vertical drop to break the cable load into segments supported at multiple places." Plastic cable ties and approved cable clamps shall be installed on harness or wire bundles in accordance with NASA-STD-8739.4.

3.5.9 Termination Order

Unless otherwise specified, the wiring of connector contacts to terminal board terminals shall proceed pin-to-terminal in corresponding numerical or alphabetical order (e.g., pin A or 1 on the connector goes to terminal number 1, pin B or 2 goes to terminal number 2). The wiring between terminal boards shall maintain the numbering sequence on each end of the connecting cable (i.e., a conductor wired to terminal number 1 on one end of the cable shall be wired to terminal number 1 on the board at the other end).

3.5.10 Potting, Electrical Connectors

All internal enclosure harness receptacles, located outdoors or in hazardous locations, shall be potted per KSC-STD-132.

3.5.11 Splicing

Splicing shall be in accordance with NASA-STD-8739.4. The splicing of conductors and/or shields shall not be permitted unless specified by the applicable drawing or approved by the

contracting officer. When approval is given, one of the following splices should be used: (1) soldered sleeve splices in accordance with NAS 1744 are acceptable for use, (2) insulated crimp splices in accordance with SAE AS 7928A are preferred, or (3) for applications where environmental sealing and small size and light weight are important, splices in accordance with SAE AS 81824. See 82K03874 for splicing instructions.

3.5.12 Terminating and Grounding Shields

Metallic shields shall be employed in cables to reduce the electromagnetic coupling between electrical circuits and their environment. Terminating and grounding shields shall be installed in accordance with NASA-STD-8739.4. A variety of shielding configurations are used in instrumentation systems at KSC, but all will be included in one of the following categories.

These procedures apply to cables used for transmitting direct current (DC) and alternating current (AC) power and low-frequency analog and digital signals with harmonics of significant power not exceeding approximately 1 megahertz (MHz).

At higher frequencies, radiation and other high-frequency phenomena may require a departure from the termination methods in this specification. Coaxial and balanced-pair cables used for radio frequency (RF) and video transmission and data communication cables are specifically excluded (see Figure 7 through Figure 10 for typical terminations). Specific termination configurations for overall shielded cables may be found in the cable subassembly drawing specified in the statement of work (SOW). See 120E3100003, 79K04613, or 82K03874 for shield termination instructions and/or details.

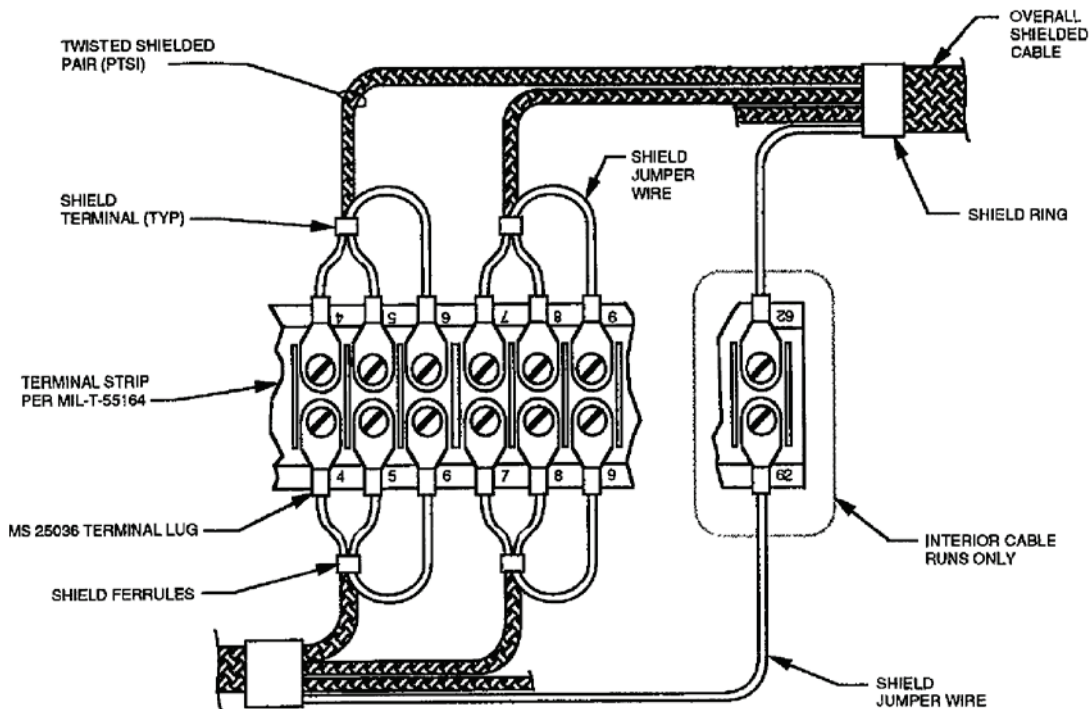


Figure 7. Cable Termination Hardware

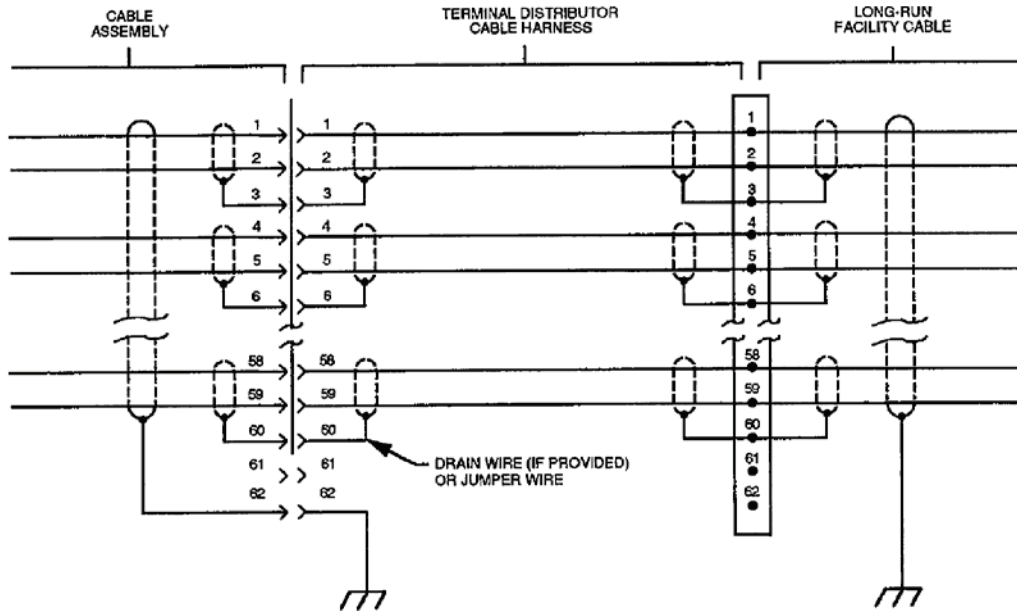


Figure 8. Typical Termination Configuration for Overall Shielded Cable with Insulated Conductor Shields

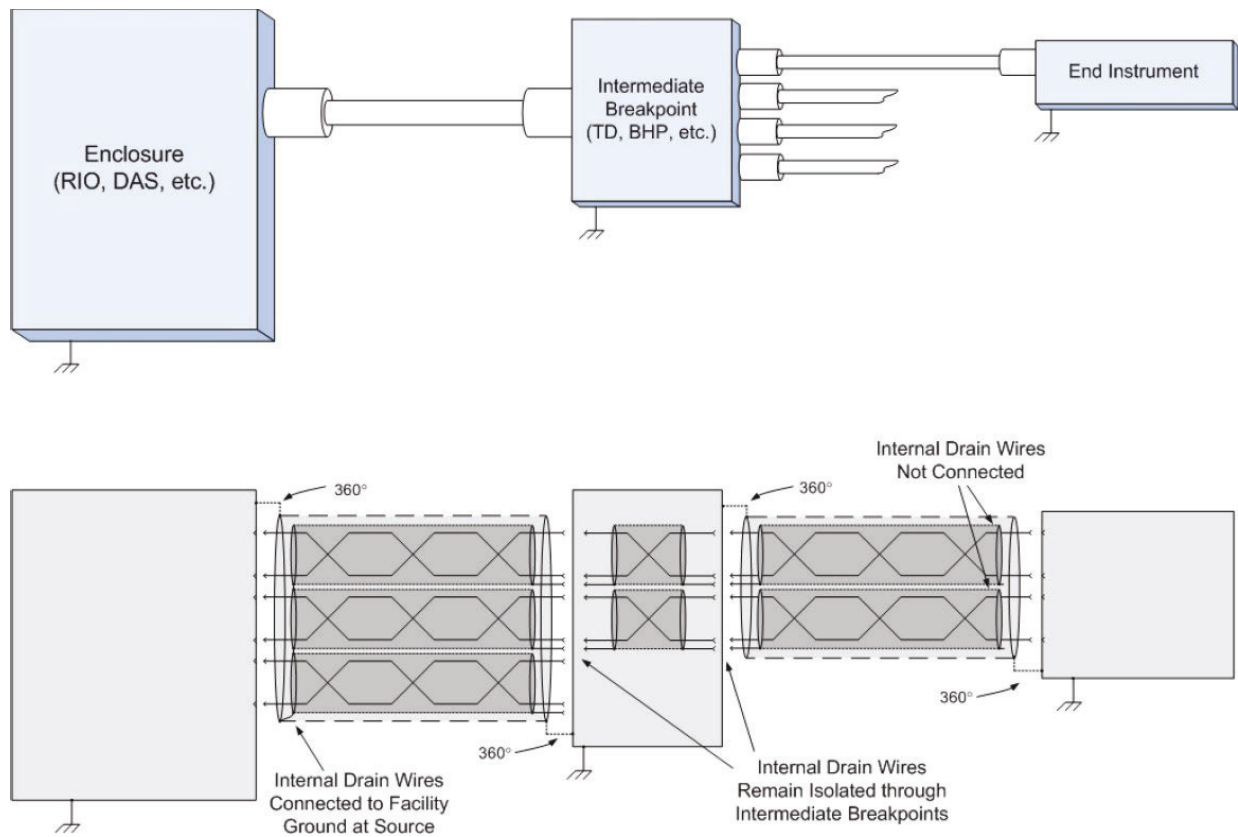


Figure 9. Graphic Representation of Individual Shields from Source, Through Intermediate Break Points, to End Instrument

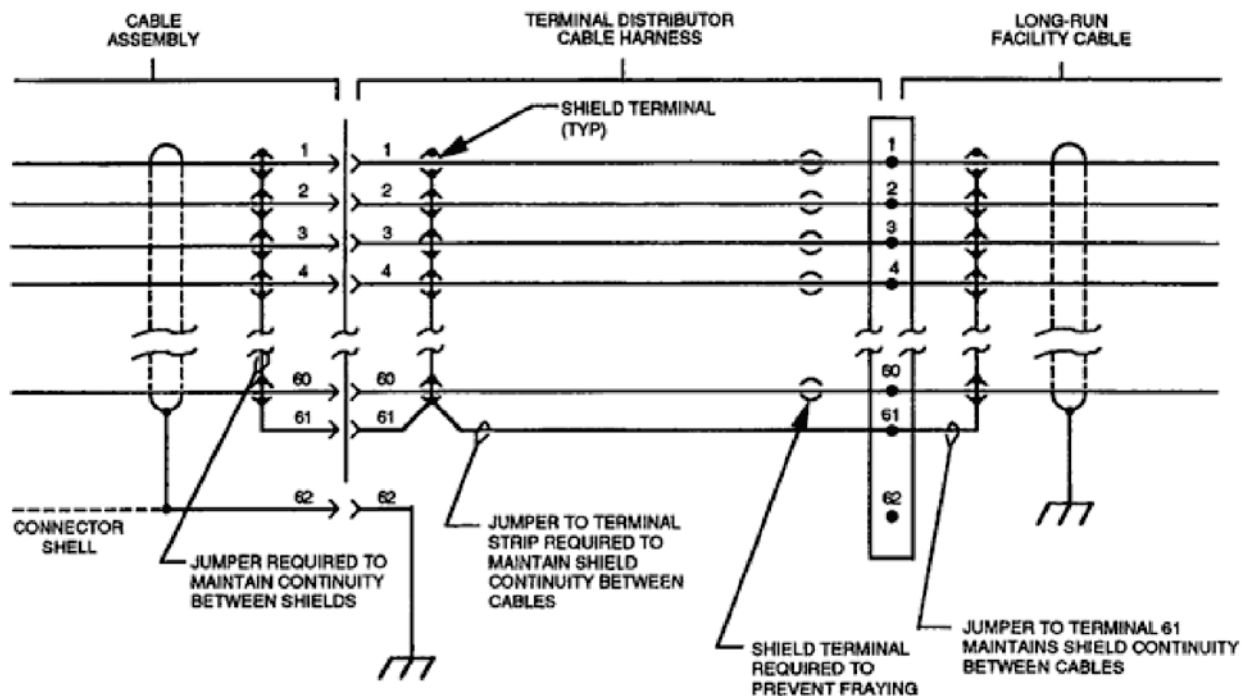


Figure 10. Typical Termination Configuration for Overall Shielded Cable with Uninsulated Conductor Shields

3.5.12.1 Insulated Shields Over Individual Conductors or Groups of Conductors

Insulated shields over individual conductors or groups of conductors shall be terminated in a manner that provides electrical isolation between individual shields and between shields and ground and electrical continuity of the shields from end terminal point to end terminal point except at an instrument, sensor, transducer, or other end item, as described below:

- a. When the cable terminates on a terminal strip, the shields shall be terminated with shield terminals and each shield connected to the strip terminal point adjacent to the last conductor of the conductor grouping common to the shield.
- b. When the cable terminates in a connector and sufficient space exists within the connector, the shields shall be terminated with insulated shield terminals. Each shield shall be connected to the connector pin or socket adjacent to the last conductor or conductor grouping common to the shield (see Figure 8). The exception would be if the connector interfaces with an end item. In this case, the insulated shields over individual conductors or groups of conductors shall be floated within the end item connector to isolate them from the end item connector, from each other, from the conductors, and from the overall shield.
- c. Insulated shields over individual conductors or groups of conductors shall be carried from racks and enclosures through intermediate breakpoints and be floated at instrument, sensor, transducer, or other end item, as specified in engineering drawings and documentation. See Figure 9 for details.

In accordance with NASA-STD-8739.4, individually isolated conductor shields may be grouped together and terminated at a common pin in a connector or to a common ground if specified in an engineering drawing. No more than four shields and one drain wire may be terminated at/in the common point.

3.5.12.2 Uninsulated Shields Over Individual Conductors or Groups of Conductors

Uninsulated shields over individual conductors or groups of conductors shall be terminated in a manner that provides electrical isolation of the shields from ground and electrical continuity of the shields from end terminal point to end terminal point, except at an instrument, sensor, transducer, or other end item as described below:

- a. When the cable terminates on a terminal strip, the shields shall be terminated with shield terminals jumpered together and connected to the strip terminal point adjacent to the last cable conductor. The terminal strip ends of harness shields shall be terminated with shield terminals to prevent fraying but do not require jumpers between shields and are not connected to the terminal strip (see [Figure 10](#)).
- b. When the cable terminates in a connector, the shields shall be collected under a common shield terminal and connected to the connector pin or socket adjacent to the last cable conductor, maintaining electrical isolation between the conductor shields and the overall shield and connector shell. The exception would be if the connector interfaces with an end item. In this case, the uninsulated shields over individual conductors or groups of conductors shall be floated within the end item connector to isolate them from the end item connector, from the conductors, and from the overall shield. The method of terminating harness shields in connectors shall be the same as specified for cables, except that a wire shall be extended from the common shield terminal back to the terminal strip and from there shall be connected to the strip terminal point to which the cable conductor shields are connected (see [Figure 10](#)).

3.5.12.2.1 Interior Cable Runs

When the cable terminates on a terminal strip, the overall shield shall be terminated with a shield terminal and connected to the last terminal point on the terminal strip. A jumper shall be provided between this terminal point and the ground (see [Table 7](#)).

In some configurations due to the close proximity of EMI sensitive devices to noisy sources, capacitive and inductive coupling can occur within enclosure's internal wiring. Use of overall shielded cable and 360-degree shield termination are recommended and common practice to provide EMI protection against noise coupling. [Figure 11](#) illustrates the shield bonded to the inside of the enclosure all around its circumference.

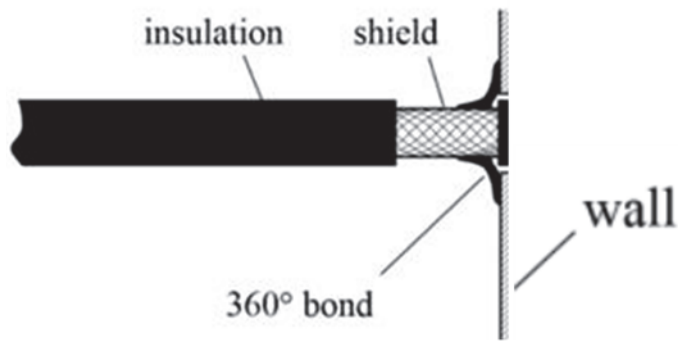


Figure 11. Internal 360-Degree Shield Termination

3.5.12.3 Shield Terminals

Shield terminals shall be in accordance with one of the following or its equivalent:

- a. Inner or outer shield rings according to 75M13676 (includes larger sizes necessary to terminate cable overall shields).
- b. Two-piece shield termination ferrules qualified under SAE AS 21608-A1, including inner ferrules according to SAE AS 21981 and outer ferrules according to SAE AS 18121 and SAE AS 21980, and terminated in accordance with 79K04613, as applicable.
- c. One-piece ferrules (i.e., SAE AS 85049/26 Shield Rings).
- d. Solder sleeve shield terminators in accordance with SAE AS 83519A or NASA-approved.

Tools for crimping shield terminals shall be in accordance with 4.3.2 of this specification.

3.6 Terminations

Wire-type terminations shall be in accordance with the following paragraphs. Wire stripping tools and procedures and insulation clearance shall be in accordance with 3.5.6. There shall be no more than three wires per terminal and two wires per lug on a part (see Figure 12).

3.6.1 Compression Type

Compression-type terminals shall be suitable lugs, pressure connectors, or clamps (see Figure 13 and Figure 14) and shall be in accordance with the following paragraphs (see also 3.5.7.3).

Sealing compound, where specified, shall be used after tightening to prevent all types of compression connections from becoming loose as a result of vibration.

3.6.1.1 Captive Nut or Screw Head

Only solid wires may be terminated under screw heads unless the screw head or washer mates into a cupped or formed surface that prevents frayed strands from protruding from the terminal areas. The wire shall be wrapped in a clockwise direction beneath the screw head or between washers under the screw head, with the wire forming an eye on the end.

A distance equal to one diameter of the conductor shall remain between the end of the wire and the formed loop (see Figure 13). Only one wire may be compressed between any two surfaces of the terminal assembly. Terminal lugs conforming to SAE AS 7928 shall be used in all cases where the nut or screw head is not captive.

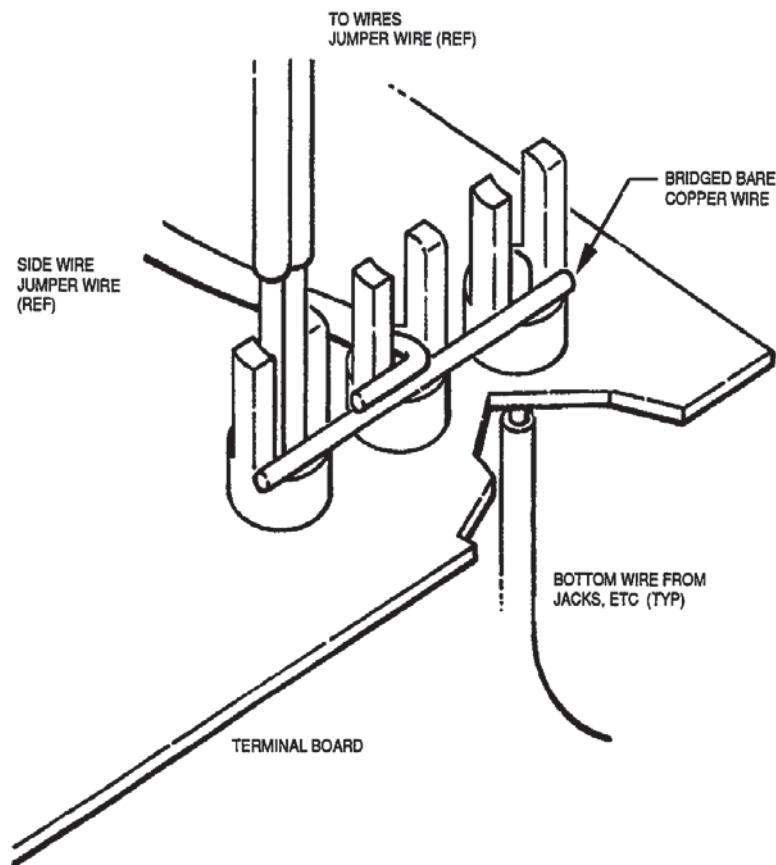


Figure 12. Bridge Bus Terminals

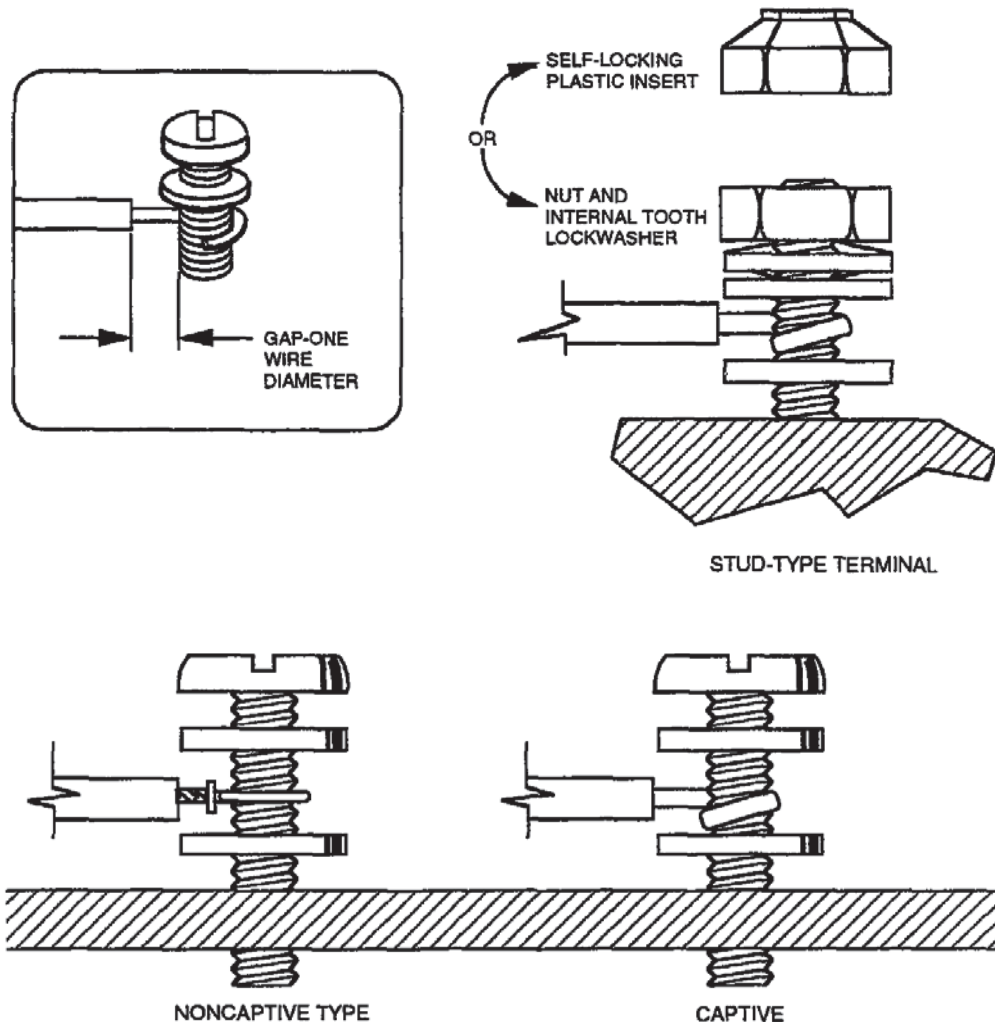


Figure 13. Captive and Noncaptive Nut and Screw Head Terminations

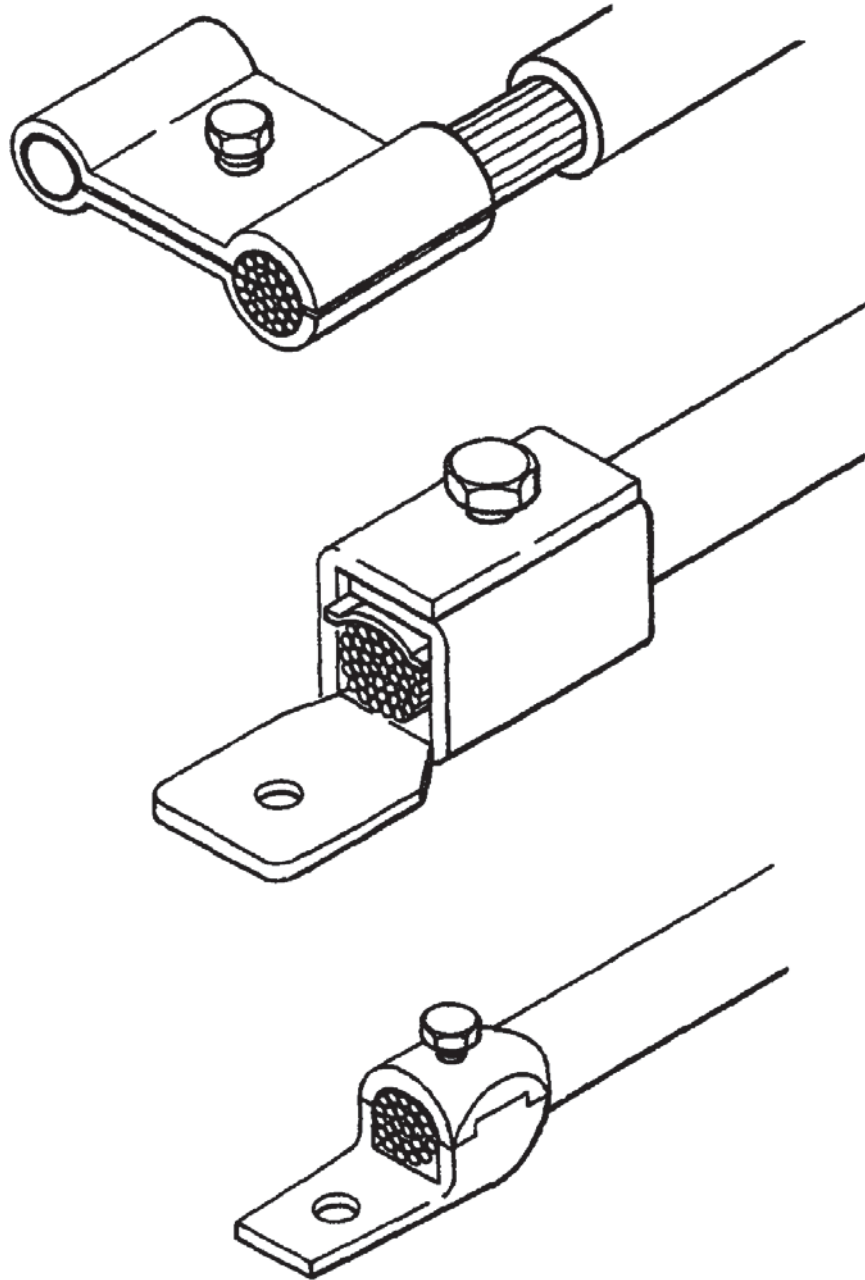


Figure 14. Clamp and Screw End Terminations

3.6.1.2 Clamp or Screw End

Clamp or screw end terminals (see [Figure 14](#)) shall be the proper size for the wire. Wire strands shall not be cut off to make it possible to put them into undersized terminals. Terminals shall not be overtightened, which could strip the threads or sever the wire strands.

3.6.2 Crimp Type

Crimp-type terminations shall be in accordance with NASA-STD-8739.4 and IPC/WHMA-A-620. Shield or coaxial ferrules of the completed termination shall not scratch, mar, compress, or otherwise distort the inner conductor insulation. 82K04459 lists tool, positioner, locator, or turret information for SAE AS 50151, MS27466, and/or MIL-DTL-38999 connectors; SAE AS 22520 provides similar information. (79K22638 provides additional guidance and information.)

3.6.3 Friction Type

Wirewrap tools and procedures shall be in accordance with SAE AMS 2695C.

3.6.4 Solder Type

All solder terminations, as well as component mounting on printed wiring boards, shall be in accordance with the following standards and shall meet the quality assurance requirements established by the standards where applicable.

- a. Electrical connections shall be soldered in accordance with IPC J-STD-001.
- b. Critical electrical connections exposed to vibration or thermal cycling shall be soldered in accordance with IPC J-STD-001S.
- c. Electrical connections shall be soldered in accordance with IPC J-STD-001S when the GSE interfaces directly with a flight item.

NOTE

Connections that depend on solder shall not be used to terminate ground conductors (see [3.6](#)).

3.6.4.1 Hand and Machine Soldering

Soldering tools and procedures shall be in accordance with IPC J-STD-001., For critical items exposed to vibration or thermal cycling, solder in accordance with IPC J-STD-001S.

3.6.4.2 Soldering Multiple Conductors in a Single Solder Cup

If the conductors are small enough to fit side by side in the solder cup, they shall be stripped and soldered in accordance with the applicable standard. If the conductors do not fit side by side, the solder cup shall not be reamed nor shall conductor strands be removed to decrease the size of the conductor. When the conductors to be soldered do not vary in size by more than four American

Wire Gage (AWG) wire sizes, each conductor shall be stripped and the strands combed out. The strands of all conductors shall be twisted together into a single wire and tinned. The resulting conductor shall not be larger than the recommended AWG wire rating of the solder cup.

3.6.5 Bonding and Grounding Type

All bonding and grounding terminations shall be in accordance with KSC-STD-E-0022 and KSC-E-166 for ground systems, KSC-STD-E-0012E for facility systems, and MIL-STD-464.

3.6.6 DIN Rail-Mounted Terminal Blocks

IEC 60715 specifies the requirements and standards for DIN rail mounts. IEC 60947-7-1 specifies the requirements and performance standards for terminal blocks mounted on DIN rails. All DIN rail-mounted assemblies shall comply with IEC 60715 and IEC 60947-7-1. In addition, all DIN rail-mounted terminal blocks shall be compatible with test point adapters or pluggable extension blocks to allow access to test points without disconnecting field wiring.

3.6.7 Wire Termination Inspection for Terminal Blocks

Wire termination for spring clip style terminal blocks shall be inspected for the following:

- a. No frayed or loose conductor strands.
 - (1) All conductors in a wire shall be captured by the spring clip feature.
 - (2) Conductors shall not exhibit fraying.
 - (3) Loose or broken conductor strands are not allowed.
- b. No exposed conductors beyond terminal block surface.
 - (1) Insulation shall extend below surface of terminal block.
 - (2) Conductors shall extend to the bottom of wire cavity in terminal block unless manufacturer recommended ferrules are used.
- c. Sufficient slack must exist such that the wire is not under tension when terminated.
 - (1) Wire shall not be bent at terminal block surface, reference permissible wire bend radius in manufacturer data sheet.

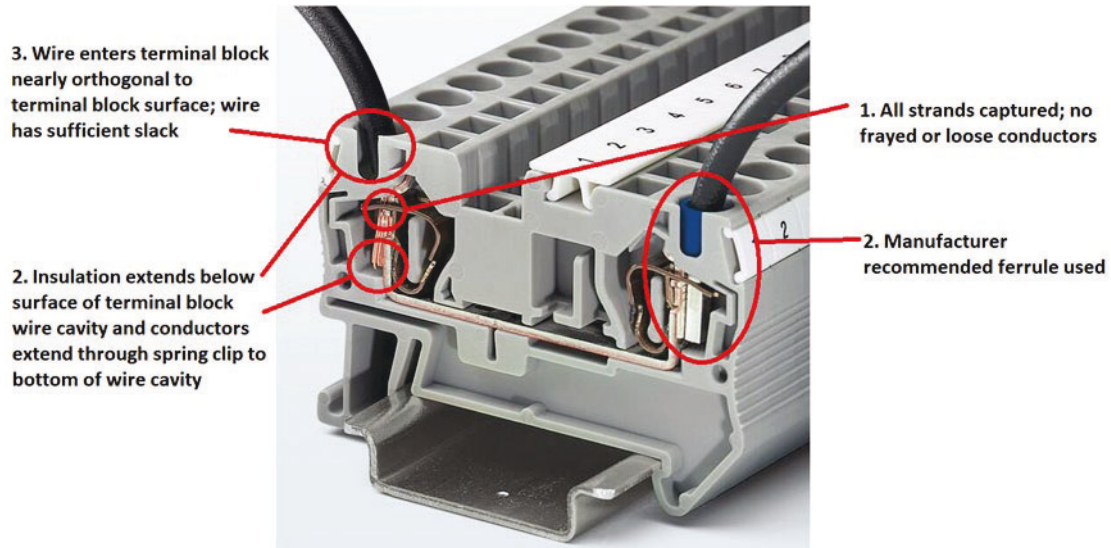


Figure 15. Proper Wire Termination on Spring Clip Style Terminal Blocks

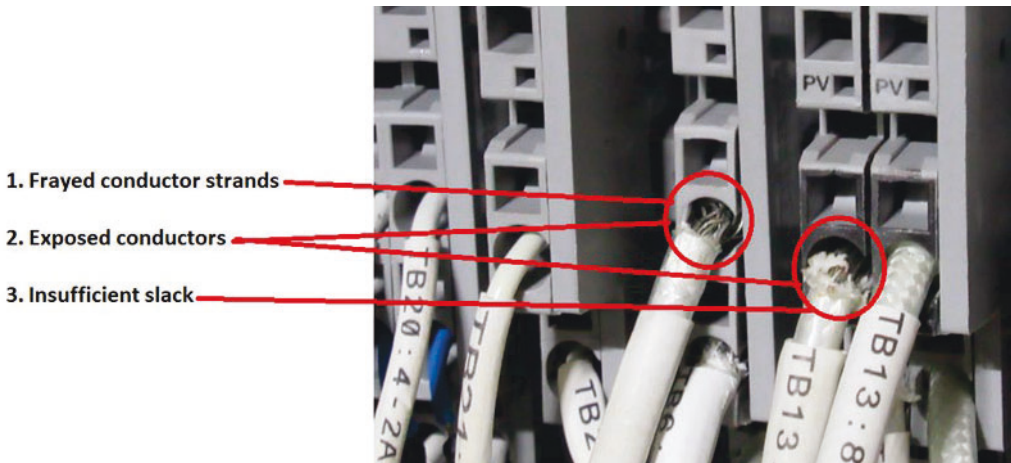


Figure 16. Discrepant Wire Termination on Spring Clip Style Terminal Blocks

3.6.8 Termination Ferrules

Termination ferrules prevent fraying of stranded wires after stripping insulation and conditions stripped end for consistent and reliable component termination.

Termination ferrules provide many advantages:

- Increased, long-term operational and contact reliability.
- Reduction in cable breakages.
- Increased vibration resistance.
- Permanently low contact resistance.
- Improves connection performance of stranded wire, especially for screw type and spring clip type terminals.

Termination ferrules shall be used to terminate a stranded wire to a device rated only for solid wire. Termination ferrules are highly recommended for high vibration environments.

Termination ferrules shall be crimped per UL508A, section 29.3.6 and IPC/WHMA-A-620. Destructive Crimp Pull test values for termination ferrules shall be per UL486F, Table 8. For self-adjusting ferrule crimpers with no calibration required by the manufacturer, passing pre and post destructive pull tests, documented at installation, is an acceptable crimper validation process to satisfy IPC/WHMA-A-620, Section 1.15.2.

3.7 Printed Wiring Boards

Fabrication and documentation of printed wiring boards shall be in accordance with IPC 6011, IPC 6012, IPC 2222, IPC 2221, IPC-HDBK-001, and the following paragraphs.

3.7.1 Material

Unless otherwise specified by the applicable engineering drawing, the board material shall be a 1.57 mm (0.062 in)-thick copper-clad laminate.

3.7.2 Construction

3.7.2.1 Circuit Pads

A pad of adequate size shall be provided at each point on a conductor that makes a connection with a component part. The pad size shall be such that, within the extremes of tolerance allowed on hole locations, no abutting portion of the attaching part will protrude beyond the border of the pad area. Terminal pads shall meet the same requirements as conductors for spacing. The component part termination hole should be located on the terminal pad so there is a minimum of 0.38 mm (0.015 in) of copper on all sides of the hole to permit a full 360-degree solder joint. For miniaturization, 0.25 mm (0.010 in) copper on all sides of the hole will be accepted, provided the

component lead diameter is no greater than 0.51 mm (0.020 in). Component lead holes shall not be drilled more than 0.38 mm (0.015 in) than the lead diameter.

3.7.2.2 Heat Sinks

The following paragraphs apply for both circuit board and chassis-mounted heat sinks for transistors and semiconductor rectifiers.

3.7.2.2.1 Electrical Insulation

When a heat sink is to be used with a semiconductor, the case and leads of the semiconductor shall be electrically insulated from the heat sink to preclude short-circuiting the power supply or damaging the semiconductor. Although individual heat sinks and duo sinks (for maintaining equal case temperatures on transistor pairs) are commercially available with a hard anodized finish for good electrical insulation, this oxide coating can be scratched when the semiconductor is installed into the heat sink. For this reason, high-purity beryllium oxide, mica, or Mylar sleeves and washers shall be used as necessary to insulate the semiconductor leads and case from the heat sink. These materials possess a high thermal conductivity and do not impair the effectiveness of the heat sink.

3.7.2.2.2 Thermal Resistance

Because the contacts between mated surfaces (even when machined smooth) are actually irregular and point to point with tiny air pockets acting as thermal insulators, a thin film of thermally conductive mounting compound shall be applied as necessary to both surfaces before mating to minimize thermal resistance between mating surfaces. Silicone grease (in accordance with SAE AS 8660) is recommended except in vacuum applications where the outgassing from silicone grease might be detrimental.

NOTE

A silicone compound cannot be used in lieu of a conventional solid electrical insulator. It should only be used as filler between the microstructure of mating surfaces.

3.7.2.3 Eyelets and Tubelets

Eyelets and tubelets shall not be used to make electrical connections on printed wiring boards.

3.7.2.4 Workmanship

Soldering and mounting of component parts shall be in accordance with 3.6.4. The completed board shall have a uniform appearance, a smooth and even texture, and shall be free of any contamination, oxide, blisters, and pits. Components shall not be placed across conductor lines without adequately protecting the contact area with insulation (see 3.8). Component parts

fabricated with welded leads, such as tantalytic capacitors, require the leads to be straight for a minimum of 0.80 mm (1/32 in) beyond the weld to prevent bending stress from being placed on the welded joint.

3.7.3 Cleaning

After the solder has solidified and cooled, flux and residue shall be carefully removed from each solder connection using a solvent as specified in IPC J-STD-001. The solvents are rated according to their potential effect on the materials commonly used in parts, should the solvents penetrate the seals. The user is responsible for determining whether a particular solvent is suitable and for making sure that it will not affect the sleeving or marking on the part.

NOTE

Do not clean printed circuit boards carrying aluminum electrolytic capacitors with Freon, trichloroethylene, carbon tetrachloride, or other chlorine or fluorine solvents. Aluminum electrolytic capacitors are subject to attack by these and other halogenated hydrocarbon solvents. Should these solvents seep into the capacitor through its seal, they will initiate corrosion that will cause the capacitor to fail after a few months. A supplemental epoxy barrier over the end disks or headers will keep these solvents from seeping into the capacitor. Acetone, alcohols, and mineral spirits are acceptable cleaners.

3.7.4 Rejection Criteria

A printed wiring board shall not exhibit the following characteristics:

- a. Separation of the conductor pattern from the base laminate of the board
- b. Separation of plating through holes or from the conductor pattern
- c. Metal, solder, or clinched leads that reduce the minimum spacing between conductors
- d. Pits or scratches sufficient to reduce the cross-sectional area of a conductor by more than 20 percent
- e. Cold or fractured solder joints or areas where the solder does not adhere to metal
- f. Damage to the board or parts caused by burns or heat
- g. Damage that makes it difficult to read color codes or labeling of parts on the board
- h. Undercutting of the conductor pattern that reduces the line width for the particular conductor by 10 percent or more

3.7.5 Inspection

Printed circuit boards shall be inspected for compliance with the standards listed in 3.6.4, where applicable, and within this section.

3.7.6 Conformal Coating

Unless otherwise specified on the engineering drawing, printed circuit boards shall be given a conformal coating after assembly and test. A single component polyurethane varnish in accordance with QPL-46058-87, Notice 1, type UR, is preferred. The conformal coating shall be applied in accordance with NASA-STD-8739.1. The following coating materials, or their equivalents, shall be used:

- a. Type 1A33 (available in aerosol) or
- b. Type 1A20 (Humiseal Division, Columbia Chase Corporation, 26-60 Brooklyn- Queens Expressway, P.O. Box 445, Woodside, NY 11377 [CAGE 99109])

3.7.7 Repair

Printed circuit boards shall be repaired in accordance with IPC J-STD-001 and as directed by the contract technical representative when repair has been authorized by the contracting officer. IPC 7711/7721 may be used as a guide.

3.7.7.1 Printed Wiring Boards Using Surface-Mount Technology (SMT)

The standards that prescribe NASA's requirements and procedures for hand and machine soldering of surface mount electrical connections are IPC J-STD-001 and IPC J-STD-001S for critical items exposed to vibration or thermal cycling. When invoked contractually, these standards establish workmanship standards for reliable SMT for flight hardware, mission-critical ground support equipment, and elements thereof. Refer to IPC J-STD-001 and IPC-J-STD-001S for standards and requirements for soldering SMT on printed circuit boards (including requirements for equipment, material, parts placement, soldering, cleaning, acceptance/rejection criteria, and rework).

3.8 Sealing and Insulating

3.8.1 Insulation

Equipment shall have adequate dielectric insulation between surfaces of current-carrying parts and those people can touch. Insulated sleeves shall be applied over pins and terminals of relays, connectors, and similar items that are not protected by insulated grommets or by potting. All routed conductors in harness or box assemblies shall be protected at abrasion points. The insulation of wires and cables shall be suitably protected in locations where they are exposed and susceptible to damage.

3.8.1.1 Heat-Reactive Tubing

Heat-reactive tubing shall not be used on components where the application of heat will damage the component.

Heat-reactive tubing for these applications shall be transparent, flexible sleeving in accordance with SAE AMS-DTL-23053. Heat-reactive tubing used for cable jackets shall be in accordance with 3.11.7.1.

The following types are preferred:

- a. SAE AMS-I-23053/2, class 2 (polyvinyl chloride, flexible, high temperature, and not crosslinked)
- b. SAE AMS-DTL-23053/5, class 2 (polyolefin, thin wall, and crosslinked)

3.8.1.1.1 Application

The procedure for applying heat-reactive tubing shall be as follows:

- a. Select tubing where the expanded size is larger than the object to be covered and the recovered size is smaller (see [Figure 17, View B](#)).
- b. Place the tubing over the object to be covered.
- c. Briefly expose the tubing to heat by using a portable hot-air gun or other approved method. The degree of heat and the exposure time will depend on the size and type of tubing.

CAUTION

Extreme care shall be exercised to ensure that the degree of heat used is not detrimental to the object being covered.

- d. The tubing quickly shrinks to a predetermined inside diameter and provides a griptight mechanical bond (see [Figure 17, View C](#)). The longitudinal shrinkage normally will be less than 10 percent.

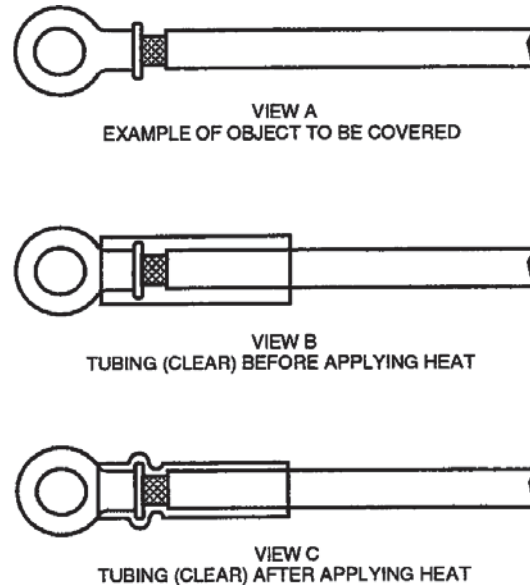


Figure 17. Application of Heat-Reactive Tubing

3.8.1.1.2 Visual Inspection

All objects covered with the tubing shall be visually inspected for shrinkage and bonding of the tubing.

3.8.1.2 Insulation Tubing

In accordance with SAE AMS-I-7444, insulation tubing shall be flexible polyvinyl chloride sleeving for applications where heat-reactive tubing is inappropriate. The tubing shall extend a distance equal to or greater than the tubing diameter above the stripped portion of the attached conductor. Lacing twine, in accordance with 3.5.8.1, shall be tied over the sleeving as necessary to prevent sliding.

3.8.1.3 Cold-Shrink Tubing

When specified in engineering drawings and instructions, connections exposed to unconditioned outside natural environments can be protected by using cold-shrink tubing (3M part numbers 46XX, 56XX, or 76XX, as appropriate), 3M cold-shrink protection kits (PN CPT-X), or connector insulators (PN 84XX-XX), and following the manufacturer's instructions. Cold shrink shall be applied only after final verification and connection.

3.8.2 Sealing Compound, Electrical

A sealing compound in accordance with SAE AS 8660 shall be used where affected parts are not sealed hermetically, are not protected by potting or molding compounds, or have possible corrosion or heat loss problems. The sealing compound is used for the following reasons:

- a. As a corrosion inhibitor on mating surfaces or connections where corrosion can result from galvanic action of dissimilar metals or exposure to corrosive liquids and/or vapors (e.g., battery terminals, bonding terminals, friction, and compression terminals)
- b. As a heat transfer abettor on mating surfaces or joints where heat-transfer loss can result from corrosion, voids, or noncontacting areas (e.g., semiconductors or resistors that use insulating or noninsulating hardware on heat sinks)

The compound shall be liberally applied to parts before mating or joining to fill the voids between the parts and seal the openings to the exterior of the joining area. This will prevent invasion of corrosives. The electrical contact resistance of a completed bond shall be no greater than an identical joint made without the compound. On insulating surfaces, the electrical insulating resistance shall be no less than the minimum allowable resistance for an identical joint without the compound.

3.9 Hazardproofing

For the purposes of this specification, hazardproofing means preventing ignition of hazardous fluids (liquids and gases) by electrically energized equipment. Hazardproofing at KSC shall be in accordance with KSC-STD-E-0002 and applicable sections of KSC-DE-512-SM.

Design for all new electrical equipment to be used in hazardous (classified) locations shall comply with the intent of the applicable guidelines of NFPA 70 (latest released edition), NFPA 430 (latest released edition), and NFPA 497 (current version at start of project unless otherwise stated in project documentation).

The lead design engineer shall coordinate the design and implementation of hazardproofing for electrically energized equipment with the NASA Fire and Rescue Office, the authority having jurisdiction (AHJ) over activities at KSC.

3.9.1 Intrinsically Safe Equipment

NEC-type (Underwriters Laboratories approved) equipment designed for use in hazardous atmospheres (without purge) shall be used when commercially available and shall be in accordance with NFPA 70 (Section 500.4) as required by the procuring activity.

3.9.2 Ignitionproofing

An enclosure that excludes ignitable atmospheres shall be considered to be ignitionproof.

3.9.2.1 Small Junction Boxes

Small junction boxes shall be made ignitionproof by encapsulation with a nonacetic acid, two-part room-temperature vulcanizing (RTV) compound.

3.9.2.2 Electrical Components

Limit switches, position indicators, valves, etc., shall be made ignitionproof if all voids within the enclosures are encapsulated with suitable compounds.

3.9.2.3 Electrical Connectors and Mated Cables

Connectors in accordance with SAE AS 50151, MIL-DTL-22992, and MIL-DTL-38999 and cables built in accordance with 3.11 shall be ignitionproofed as follows:

- a. Lubricate the rear threads with Molykote X-15, KEL-F-90, or an equivalent.
- b. Torque the rear coupling nut to the values given in Table I of 79K19600 or in Table 4 of SAE AIR6151 with the O-rings in place.
- c. Before mating, coat the front threads with one of the lubricants listed above.

Bayonet-coupled connectors, in accordance with MIL-DTL-26482H, are not recommended for hazardous locations. But if an interfacing component connector dictates that a bayonet-coupled connector be used, it shall be ignitionproofed by coating the entire mated plug and receptacle with a nonacetic acid RTV compound.

3.9.3 Purging and Pressurization

A hazardproofing purge is used to exclude combustible atmospheres from electrical enclosures that do not meet NFPA 70 requirements for use in such atmospheres. Once the enclosure has been purged, only positive pressure shall be required to be maintained within the enclosure.

Purging for environmental protection alone shall not be employed if adequate protection can be achieved by a simpler means (see 3.10.3).

All purging and pressurization shall be accomplished in accordance with KSC-STD-E-0002D and the following paragraphs.

3.9.3.1 Equipment

The equipment chosen shall meet the following criteria:

- a. New equipment enclosures shall be in accordance with NFPA 496 and shall withstand a gage pressure of 500 pascals (Pa) (2 inches of water) without leakage and without damage to the enclosure.
- b. Doors and/or removable access panels shall be of a design suitable for frequent opening and closing and shall be leaktight when closed.

- c. A humidity indicator that changes color to indicate changes in humidity shall be installed to indicate when the relative humidity in the enclosure exceeds 30 percent (when required by the procuring activity).
- d. A pressure monitoring assembly shall be installed in accordance with NFPA 496 when required by the procuring activity's technical representative.
- e. The purge inlet assembly shall be in accordance with 79K07491-3. The purge outlet assembly shall be in accordance with 79K07491-4 (where clearance is not restricted) and with 75M02047 (where clearance is restricted).

3.9.3.2 Purge Pressure

Enclosures shall be maintained so that they are sufficiently leaktight to prevent the purge pressure from dropping below a positive pressure of 25 Pa (0.1 in of water) during a flowing purge.

3.9.3.3 Flow Rate

Purging equipment shall be designed to maintain a flow rate of 0.2 liters per second (L/s) to 0.5 L/s (0.5 cubic foot per minute [ft³/min] to 1.0 ft³/min) of purge medium through the enclosure (to the atmosphere) under standard conditions.

3.9.3.4 Purge Media

The purge medium shall be one of the following:

- a. Compressed dry air
- b. Gaseous nitrogen in accordance with SE-S-0073

If compressed air is used, the dewpoint shall not exceed $-12.2\text{ }^{\circ}\text{C}$ ($10\text{ }^{\circ}\text{F}$), the oil content shall not exceed 3 parts per million by mass, and the particulate filtration shall be 20 μm absolute.

3.10 Corrosion Control

Electrochemical corrosion is the primary type of corrosion at KSC. Four conditions must exist before electrochemical corrosion can proceed: (1) there must be something that corrodes (the metal anode), (2) there must be a cathode, (3) there must be a continuous conductive liquid path (electrolyte, usually condensate and salt or other contaminants), and (4) there must be a conductor to carry the flow of electrons from the anode to the cathode. This conductor is usually in the form of an item that makes metal-to-metal contact such as a bolted or riveted joint.

Eliminating any one of the four conditions will stop corrosion (e.g., an unbroken coating on the surface of the metal will prevent the electrolyte from making contact with the cathode and anode and the current cannot flow; therefore, no corrosion will occur as long as the coating is unbroken).

In [Table 9](#), metals are grouped by their potential tendency for galvanic corrosion. Refer to KSC-TM-584 for a detailed discussion on the types and causes of corrosion and how corrosion can be prevented and removed.

3.10.1 Corrosion-Resistant Materials

Corrosion-resistant materials shall be used, including plastics where possible. Galvanized supports shall be specified for outside installations and for inside installations where corrosive agents are present. Fiberglass junction boxes and enclosures shall be used where feasible (see [3.1](#)).

3.10.2 Dissimilar Metals

Use of dissimilar metal couples shall be avoided. MIL-STD-889B, Notice 1, shall be used in determining the tendency for galvanic action between a combination of metals or alloys. When dissimilar metals are in direct contact, the more anodic material corrodes at an accelerated rate. Metals placed in contact during fabrication and assembly of GSE shall come from the same or an adjacent grouping. When it is not possible to separate items in different groups, the more easily replaceable items (handles, fasteners, etc.) shall be selected from the more active group. The following guidelines shall be used to minimize corrosion caused by the use of dissimilar metals:

- a. The anode shall be as large as feasible in relation to the cathode. When the anode is large with respect to the cathode, two advantages are realized. First, because the anode is being dissolved by the electrolyte, uniform corrosion takes place over a relatively large area at a relatively slower rate, thus increasing the service life of the anode. Second, the small cathode areas tend to become polarized by hydrogen gas or polarized by alkali or insoluble salts, thereby slowing or stopping the reaction.
- b. When dissimilar metals must come into contact, they shall be separated by using nonconductive barrier materials (such as nylon washers or barrier tape in accordance with A-A-59298A) or with a protective coating or plating (see [3.10.4](#)).
- c. Both the anode and the cathode shall be coated with the same material.
- d. When possible, fasteners dipped in zinc chromate primer shall be installed.
- e. The use of lock or toothed washers over plated or anodized surfaces shall be avoided (they break the protective coating) unless they are used to ensure a good electrical bond connection.
- f. When dry-film lubricants are used, use only dry-film lubricants that are graphite-free (MIL-PRF-46010F restricts the use of graphite as a material in the coating).

Table 9. Potential Tendency for Galvanic Corrosion

		Anode-Corroded End (Less Noble)										Cathode-Protected End (Noble)																						
CATEGORY	METAL OR ALLOY	1	1	2	3	3	4	5	5	6	7	8	8	9	10	10	11	11	11	12	13	14	15	15	16	17	18	19	20	20				
		Magnesium	Magnesium Alloy	Zinc	Clad 70 Al	Clad 7075 Al	Clad 6061 Al	Clad 2024 Al	3003 Al	6061-T6 Al	Cadmium	2024-T4 Al	Steel or Iron	Cast Iron	Chromium Iron (Active)	304 SS (Active)	316 SS (Active)	Lead-Tin Solders	Lead	Tin	Nickel (Active)	Hastelloy C (Active)	Hastelloy A (Active)	Brasses	Copper	Brasses	Silver Solder	Nickel (Passive)	304 SS (Passive)	316 SS (Passive)	Silver	Graphite	Platinum	
1	Magnesium	0	0	1	2	2	3	4	4	5	6	7	7	8	9	9	10	10	10	11	12	13	14	14	14	15	16	17	17	18	19	19		
1	Magnesium Alloy		0	1	2	2	3	4	4	5	6	7	7	8	9	9	10	10	10	11	12	13	14	14	14	15	16	17	17	18	19	19		
2	Zinc			0	1	1	2	3	3	4	5	6	6	7	8	8	9	9	9	10	11	12	13	13	13	14	15	16	16	17	18	18		
3	Clad 70 Al				0	0	1	2	2	3	4	5	5	6	7	7	8	8	8	9	10	11	12	12	12	13	14	15	15	16	17	17		
3	Clad 7075 Al					0	0	1	2	2	3	4	5	5	6	7	7	8	8	8	9	10	11	12	12	13	14	15	15	16	17	17		
3	Clad 6061 Al						0	1	2	2	3	4	5	5	6	7	7	8	8	8	9	10	11	12	12	13	14	15	15	16	17	17		
4	Clad 2024 Al							0	1	1	2	3	4	4	5	6	6	7	7	7	8	9	10	11	11	11	12	13	14	14	15	16	16	
5	3003 Al								0	0	1	2	3	3	4	5	5	6	6	6	7	8	9	10	10	10	11	12	13	13	14	15	15	
5	6061-T6 Al									0	1	2	3	3	4	5	5	6	6	6	7	8	9	10	10	10	11	12	13	13	14	15	15	
6	Cadmium										0	1	2	2	3	4	4	5	5	5	6	7	8	9	9	9	10	11	12	12	13	14	14	
7	2024-T4 Al											0	1	1	2	3	3	4	4	4	5	6	7	8	8	8	9	10	11	11	12	13	13	
8	Steel or Iron												0	0	1	2	3	3	3	4	5	6	7	7	7	8	9	10	10	11	12	12	12	
8	Cast Iron													0	1	2	2	3	3	3	4	5	6	7	7	7	8	9	10	10	11	12	12	
9	Chromium Iron (Active)														0	1	1	2	2	2	3	4	5	6	6	6	7	8	9	9	10	11	11	
10	304 SS (Active)															0	0	1	1	1	2	3	4	5	5	5	6	7	8	8	9	10	10	
10	316 SS (Active)																0	1	1	1	2	3	4	5	5	5	6	7	8	8	9	10	10	
11	Lead-Tin Solders																	0	0	0	1	2	3	4	4	4	5	6	7	7	8	9	9	
11	Lead																		0	0	1	2	3	4	4	4	5	6	7	7	8	9	9	
11	Tin																			0	1	2	3	4	4	4	5	6	7	7	8	9	9	
12	Nickel (Active)																				0	1	2	3	3	3	4	5	6	6	7	8	8	
13	Hastelloy C (Active)																					0	1	2	2	2	3	4	5	5	6	7	7	
14	Hastelloy A (Active)																						0	1	1	1	2	3	4	4	5	6	6	
15	Brasses																							0	0	0	1	2	3	3	4	5	5	
15	Copper																								0	0	1	2	3	3	4	5	5	
15	Brasses																									0	1	2	3	3	4	5	5	
16	Silver Solder																										0	1	2	2	3	4	4	
17	Nickel (Passive)																											0	1	1	2	3	3	
18	304 SS (Passive)																												0	0	1	2	2	
18	316 SS (Passive)																													0	1	2	2	
19	Silver																														0	1	1	
20	Graphite																															0	0	
20	Platinum																																0	0

Note: Numbers are qualitative only, the larger the number, the greater the tendency for galvanic corrosion.

3.10.3 Moisture Exclusion

Moisture shall be excluded from equipment enclosures by providing seals (see 3.8.2) or coatings (see 3.10.4), dehumidification (desiccants), vapor phase inhibitors, purges (see 3.9.3), or air conditioning or maintaining the temperature above the dewpoint (strip heaters). Equipment shall not be purged for environmental protection alone if there is another way to provide adequate protection.

3.10.4 Protective Coatings

Surfaces shall be protected with metallic, inorganic, or organic coatings as required (see 3.1 3.5.10, 3.7.6, 3.8, and 3.11.6.1).

3.10.5 Lubricants

Exposed bearing surfaces shall be protected with corrosion-inhibiting lubricants (see 3.3.1.6).

3.11 Cables, External

External cables include cables terminating between bulkhead plates, bulkhead plates to enclosures, or between enclosures, regardless of the environment. Cable and harness design, fabrication and assembly shall be in accordance with NFPA 70, 120E3100001 (for heavy duty), UL type 444 CMG (or higher, for light duty), 120E3100003, KSC-GP-864, NASA_STD_8739.4, ICP/WHMA-A-620, and applicable design drawings. 79K19600 may be used for legacy systems but is not recommended for new designs.

Because of the nature of business at KSC, some areas are considered (classified as) hazardous locations. NFPA 70, Section 500, defines Class I, Division 2, as a location:

- a. in which volatile flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors are handled, processed, or used, but in which the liquids, vapors, or gases will normally be confined within closed containers or closed systems from which they can escape only in case of accidental rupture or breakdown of such containers or systems or in case of abnormal operation of equipment, or
- b. in which ignitable concentrations of flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors are normally prevented by positive mechanical ventilation and which might become hazardous through failure or abnormal operation of the ventilating equipment, or
- c. that is adjacent to a Class I, Division 1, location, and to which ignitable concentrations of flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors above their flash points might occasionally be communicated unless such communication is prevented by adequate positive- pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

NFPA 70, Section 500, states “This classification usually includes locations where volatile flammable liquids or flammable gases or vapors are used but that, in the judgment of the authority having jurisdiction, would become hazardous only in case of an accident or of some unusual operating condition.” If cable or wiring is being fabricated for use in a Class I, Division 2, location, the cable/wire must be rated/certified for such use. Power-limited tray cable (PLTC), instrumentation tray cable (ITC), tray cable (TC), metal clad (MC) cables, and mineral insulated (MI) cables are approved and recommended for use in Class I, Div 2 locations. All tray cable (PLTC/ITC/TC) shall have an -ER designation for exposed run. See vendor specifications for information on Class I, Division 2, certification.

External cables terminating in outdoor environments (and hazardous locations) at KSC shall be comprised of mil-spec threaded connectors (D38999 /20 series or MIL-5015 3450 series are preferred), molding adapter, PLTC, ITC or TC, CPE or PVC jacketed with an overall shield. External cables transiting across outdoor to indoor locations require PLTC/ITC/TC overall shielded cable with a mold adapter (outside environment) and an EMI backshell (interior environment). All tray cable (PLTC/ITC/TC) shall have an -ER designation for exposed run. The use of bayonet-style connectors is not approved for new designs unless heritage equipment requires their use.

Molding and potting of electrical connectors is done to prevent damage, degradation, and deterioration of electrical connectors that are exposed to the environment and to ensure electrical integrity, improve robustness, and increase the connectors' useful life. Epoxy resin potting compositions and elastomeric compounds shall be used for molding and potting in accordance with section 3.11.6.

The base material of the connector will conform to the appropriate military or manufacturer specifications and the required connector will be as specified in the engineering documentation and drawings. When metal connectors are used, the preferred base material of the mold adapter mounted on each connector shall be the same material as connector to which it is being mounted. When dissimilar metals are used on the connector/mold adapter interface, the dissimilar metals shall be separated by a protective coating as specified in paragraphs 3.11.6.1.a and 3.10.2.b. When the base material of the connector and the mold adapter used in cable/harness fabrication are the same, the only other preparation/pretreatment that is required, other than those normally employed in the potting and molding process, is that the liquid locking compound shall be applied on the threads of the stainless steel connectors in accordance with paragraph 3.11.6.1 prior to screwing the stainless steel mold adapters onto the stainless steel connectors. This application of liquid locking compound will also help inhibit the galling effect that often occurs when stainless steel threaded interfaces are joined. Molding and potting are required for all outdoor applications where a connector's integrity could be compromised (1) by the environment or the effects of vibration, and (2) to inhibit gas migration, or (3) to provide additional strain relief and support. This includes molding and potting of exterior connectors on enclosures, junction boxes, and remote inputs/outputs (RIOs).

The use of plenum-rated and non-plenum-rated cable and wiring shall be in accordance with NFPA 70. According to the NEC, a plenum is "a compartment or chamber to which one or more air ducts are connected and that forms part of the air distribution system." To qualify as a plenum, the space above an acoustic tile ceiling or below a raised floor would have to extend above or below other rooms in the same building, respectively, or be open to ducts connecting it to other parts of the building. The concern is that during a fire, burning material in a plenum air space can create smoke and fumes that can travel through air ducts to the entire building. For this reason, there are codes to restrict the types of materials (such as wiring and cable) that can be placed in the plenum. According to the NEC, plenum-rated wire and cable must be used in plenum air spaces. Plenum-rated wire and cable have a fire-retardant insulation, which inhibits the propagation of fires and toxic fumes. The local fire marshal is the definitive source for determining the use of plenum-rated or non-plenum-rated cable and wiring. Contact the local fire marshal if questions arise regarding the use of plenum-rated wiring and or cables in a specific environment.

3.11.1 Standard Bulk Cable

Cable shall be in accordance with 120E3100001, KSC-GP-864, MIL-DTL-17H, 82K03878, or the applicable design drawings. KSC-SPEC-E-0031 and KSC-SPEC-E-0024 may be used for legacy systems but is not recommended for new designs.

Bulk cables shall be inspected before fabrication (despooling), potting and molding (cable ends), and installation. All inspections shall be performed on the entire periphery of cable, under adequate light and, when necessary, with the use of a mirror. A 10× magnifier shall be used if a discrepancy is suspected. Scrapes, scuffs, inclusions, discontinuities, and minor abrasions that do not expose shield strands are acceptable and shall not be cause for rejection. Pinholes, voids, gouges, or any other discrepancy that exposes the cable overall shield braid are not acceptable and shall be cause for engineering evaluation or initiation of a Product Nonconformance Report (PNCR).

3.11.2 Unique Bulk Cable

Unique bulk cable is defined as a cable designed and fabricated combining multiple conductors and/or cable types. Unique bulk cable shall be complete with polyester tape, foil shielding tape, braided shield and jacket combined to form a single, jacketed, shielded cable. Individual cables within the unique bulk cable shall conform to PLTC/ITC/TC or CMG ratings as appropriate. All tray cable (PLTC/ITC/TC) shall have an -ER designation for exposed run.

3.11.2.1 Preferred Cable Construction

Conductor material, plating, stranding, insulation, and inner shielding shall be per 120E3100001 Section 2.2

Pressure sensitive polyester adhesive tape shall be per L-T-100 Type 1 (or equivalent).

Shielding foil tape shall be a general purpose shielding film/foil laminate (Neptape 1055 or equivalent).

Braided shield shall be tinned copper braid, round configuration, 95% coverage per AA59569. When joining of conductive braided shielding is required, instructions per 3.11.2.3 shall be followed.

The heat-shrinkable tubing used for cable jackets shall be black, flexible sleeving in accordance with SAE AMS-DTL-23053. The following types are preferred.

- a. SAE AMS-DTL-23053/1, class 1 or 2 (polychloroprene and flexible)
- b. SAE AMS-DTL-23053/5, class 1 or 3 (polyolefin, thin wall, flexible, and crosslinked)
- c. SAE AMS-DTL-23053/15 (polyolefin, thick wall, coated, and crosslinked)

3.11.2.2 Fabrication Procedure

Small lengths of unique conductor-grouping bulk cable shall be fabricated according to the following procedure:

- a. Select a shield whose diameter is larger than the outside diameter of the wire bundle. The length of the shield should be specified about 10 percent longer than the cable length to allow for possible shortening of the shield that can result from braid expansion if the outside diameter has been slightly miscalculated.
- b. Use a cable jacket with a recovered diameter slightly smaller than the calculated overall diameter of the conductor bundle with the overall shield applied. The length specified should be 10 percent greater than the cable length to allow for shrinkage that can result from heating.
- c. Cut the conductor sets 1.15 times the required cable length to compensate for a shortening of the length that can result from twisting and end damage.
- d. For short cables (4,500 mm [15 ft] or less), hand-twisting of the multiple conductor bundle shall be accomplished without tangling. The lay shall be unidirectional right-hand with a length of 8 to 16 times the outside diameter of the multiple. The individual conductors or the conductor sets shall be relieved as the multiple is twisted so the sets will not be twisted. For cables over 4,500 mm, a simple fixture can be made that prevents tangling and gives a uniform twist (as shown in [Figure 18](#)).
- e. Apply one layer with 50% overlap of polyester tape from one end of cable to another.
- f. Cut the overall braided shield to the dash-number length plus about 10 percent. Lay the braided shield out straight on the floor or long workbench and run a fish tape through the length of the shield. Secure the end of the fish tape to one end of the conductor multiple and pull the multiple through the shield. Personnel should be stationed along the shield to stroke the shield as the multiple goes through. When finished, the shield should be stroked from the center outward in both directions to form the shield tightly around the multiple.
- g. Cut the polychloroprene or other approved jacket material to the dash-number length plus about 10 percent. Lay the jacket out straight on the floor or long workbench and run the fish tape through the length of the tubing. Secure the end of the fish tape to one end of the multiple and overall shield. (If the fish tape is still secured to the multiple, the tape can be wrapped around the shield at the secured end to prevent it from slipping back.) Then pull the cable through the sleeve with personnel stationed along the jacket to ensure the shield does not bind or catch in the jacket.
- h. The heat-shrinking process may be done in a number of ways (heat gun with wraparound shield, cylindrical open-ended over, etc.); but, whichever method is used, the heat should be applied evenly around the circumference of the cable and should progress slowly from one end to the other or from the center to each end in turn, making sure the tubing is completely shrunken as the process moves along the cable. A slight back-and-forth motion with a heat gun is sometimes desirable to start the process downstream to prevent wrinkles and distortion due to abrupt shrinking at one point.

- i. Cut off one end of the cable as close as possible to any damaged conductors or shield or tubing ends. Measure the cable and add 150 mm to 300 mm (6 in to 12 in) to the dash-number length. Cut the cable at this point; the cable is now ready for termination.

3.11.2.3 Overall Braided Shield Splicing

When joining conductive braided shielding (such as QQ-B-575B/A-A and ASTM B conductive braided shields) is required, perform the following.

- a. Overlap at least 6 inches of the conductive braid.
- b. Secure the 6 inches by weaving 26 AWG QQW-343 or A-A-59551 Buss Wire and trimming the ends to eliminate sharp edges which may later perforate if facing towards the inside (usually installed length wise of the cable oriented). Buss Wire P/N QQW343S26S1T
- c. Further secure with half-lapped layer copper tape which ensures conductivity between both sides of the junction (EMI shielding).

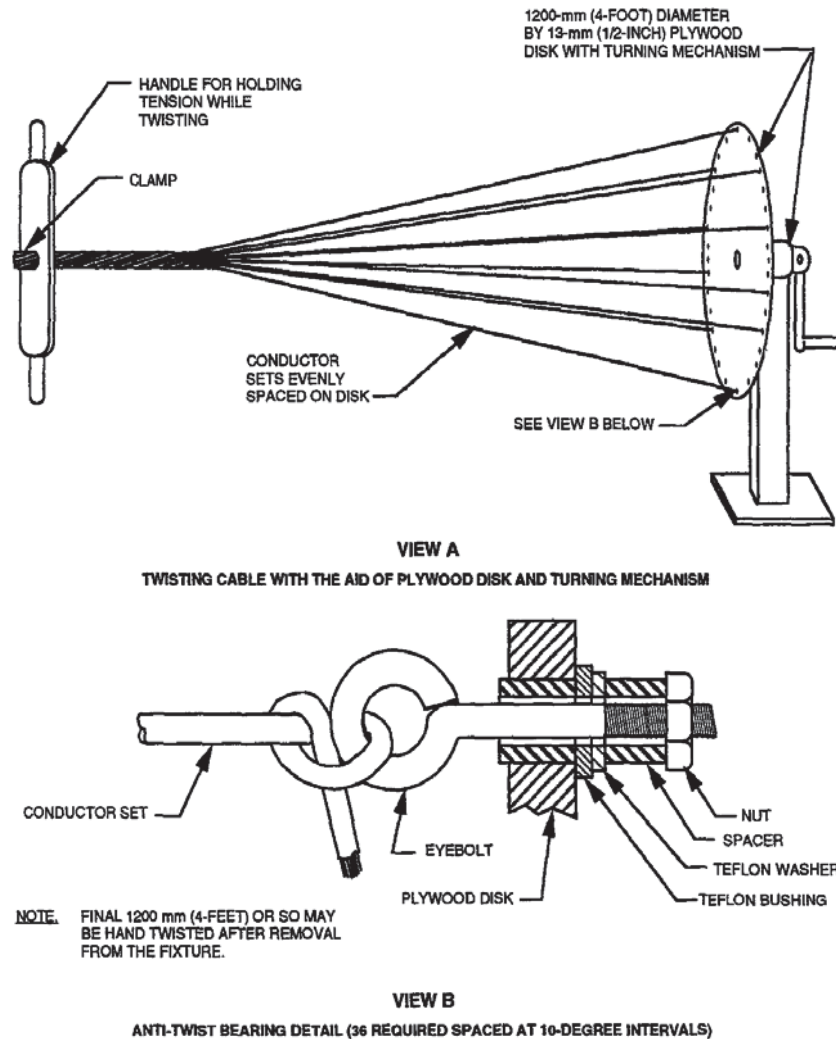


Figure 18. Unique Bulk Cable Fabrication

3.11.3 Connectors

SAE AS 50151, MIL-C-22992, MIL-DTL-38999, and MIL-DTL-26482 connectors (or commercial equivalent) shall be 100-percent inspected in accordance with NASA-STD-8739.4 before they are mated or used in GSE flight interface equipment, cables, or harnesses. Installed connectors shall be inspected for damage, clocking, contact alignment, and spacing in accordance with NASA-STD-8739.4 before and after potting and molding operations and just prior to final acceptance. Connector substitutions shall be in accordance with 120E3100003 or KSC-GP-864. 79K19600 may be used for legacy systems but is not recommended for new designs. All other connectors shall be visually inspected for damage, proper clocking, and contact alignment and spacing.

3.11.3.1 D-Subminiature (DB) Connectors

MIL-DTL-24308F (nonenvironmental), MIL-DTL-83513F (polarized shell), and MIL-DTL-55302F (printed circuit subassembly) DB connectors shall be 100-percent inspected and tested in accordance with MIL-STD-202G and EIA-364 before they are mated or used in GSE cables or harnesses. Installed connectors shall be visually inspected again for damage, clocking, contact alignment, and spacing prior to connector mates.

DB connectors are used in many computer, audio/video, and data applications. The official name is D-subminiature, but many people call them “D-sub” or just “DB.” The connectors get their name from their trapezoidal shape that resembles the letter “D.” Most DB connectors have two rows of pins. Common types of D-sub connectors are DB9 and DB25 (Figure 19), used on personal computers (PCs) for serial and parallel ports. DB connectors use thumbscrews to secure the connectors.

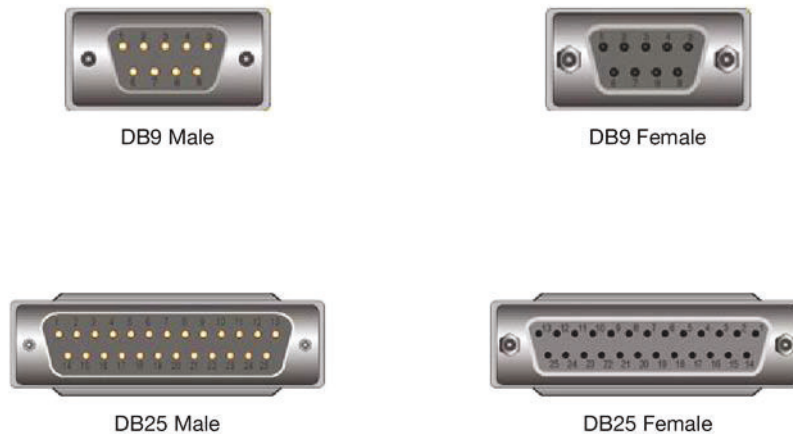


Figure 19. DB9 and DB25 Connectors

High-density (HD) DB-style connectors (Figure 20) look just like regular DB connectors; however, HD DB connectors have pins that are slightly smaller and placed closer together. HD connectors often have three rows of pins instead of two. The most common HD connector is the HD15, which is found on PC video cards and monitors. HD connectors use thumbscrews to secure the connectors.



Figure 20. DB15 Connectors

Another type of DB or D-sub connector is the MD, or micro DB connector (Figure 21). Micro DB connectors are slimmer than standard D-sub, with pins even smaller than the ones used on HD connectors. The MD is also commonly called a “half-pitch” DB connector. MD connectors are often used in Small Computer System Interface (SCSI) applications, and the most popular types are the MD50 and MD68 connections. MD connectors can use latch clips or thumbscrews as anchoring mechanisms.

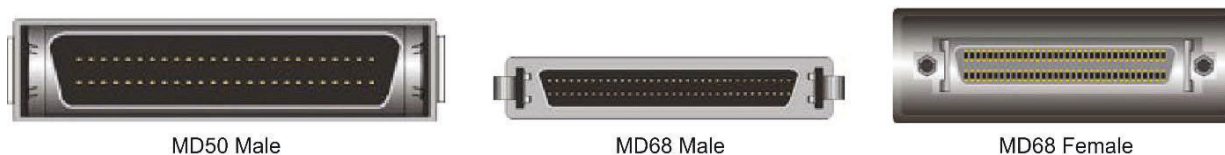


Figure 21. MD50 and MD68 Connectors

D-sub connectors are usually described by the total number of pins that they can hold. In some cases, a DB25 connector may only have four or five pins loaded into it; however, it is still called a “DB25” connector and not a “DB4” or “DB5.” Another example is the HD15 connector used by monitors—most monitor cables are only loaded with 14 pins, but the connector is still called an HD15 connector.

3.11.4 Jacket Removal

The removal of outer jackets of insulation, when required, shall be accomplished by a method that will prevent damage to metallic shields or individual conductor insulation. Insulation shall have a neat, unfrayed appearance.

3.11.5 Conductor and Shield Termination

Conductor terminations shall be as specified in 3.6. Conductors within each individual shielded group shall be terminated in accordance with wiring diagrams on a row-by-row basis. Shield terminations for cables and cable harnesses shall be in accordance with 79K04613, 79K07416, 82K03874, paragraph 3.5.12 of this specification, and applicable engineering drawings and documentation. The shield termination hardware shall be in accordance with 3.5.12.2.1.

3.11.6 Potting and Molding

Prior to potting or molding, the cable assembly shall be checked for workmanship and for electrical continuity and leakage between circuits as specified in 3.12. Unless otherwise specified, potting, molding, and inspection of electrical connectors and cables shall be in accordance with KSC-STD-132. Cable jackets shall be inspected in areas to be potted or molded in accordance with criteria listed in 3.11.1. Potting and molding operations shall be performed in accordance with applicable portions of 79K14177 and as specified in engineering drawings and documentation. Before potting, backshells shall be torqued to values specified in 120E3100003 (79K19600 may be used for legacy systems but is not recommended for new designs).

3.11.6.1 Overall Shields Surrounding the Entire Cable Core

- a. Overall shields shall be terminated to each connector backshell 360 degrees at both ends of a cable, grounded at each terminal distributor, and at any other practicable points. The intent of the 360-degree overall shield is to create a “Faraday cage” around the conductive core to protect it from external electromagnetic radiation and keep its own associated signals and electromagnetic energy inside the cable. At cable junction points where grounding is not feasible, electrical continuity of the overall shields shall be maintained through the junction. See [Figure 22](#) for a diagram of 360-degree shielding using mold adapters when potting and molding in accordance with [3.11.6](#) of this specification. Molding adapters shall be used for 360-degree overall shield terminations when specified in engineering drawings and documentation. COTS electromagnetic interference (EMI) backshells that employ compression-type fittings shall be used for 360-degree overall shield termination when specified in engineering drawings and documentation. Using mold adapters that are not the same base metal as the connectors they are being installed on results in dissimilar metal couples and shall be avoided outside of conditioned areas. Steps shall be taken to mitigate the corrosive effects of dissimilar metal pairs wherever encountered. In accordance with SAE AIR6151 and Table 1 of 120E3100003. Liquid locking compound shall be applied to the last two accessory threads closest to the face of the connector prior to installing 120E0600001 or KT02415 mold adapters. Apply only enough liquid locking compound to coat the last two threads 360°. Excess locking compound shall be wiped away. The mold adapter shall be installed and torqued to the required value in Table 1 of 120E3100003.
- b. In accordance with TM 584, paragraph 4.2.5, and MIL- STD-889, Section A.3.9, additional protection for contact of dissimilar metals at the connector/mold adapter interface can be achieved by applying a sealing compound in addition to the primer. This process is outlined in KSC-E-166, Installation and Assembly of Electrical GSE, and should be followed when cable/harness assemblies using dissimilar metal couples are installed in the field.
- c. When stainless steel mold adapters are used in conjunction with stainless steel connectors, the connector/mold adapter interface shall be treated as follows during the fabrication process. Liquid locking compound shall be applied to the last two accessory threads closest to the face of the connector prior to screwing each stainless-steel mold adapter to the back of each stainless steel connector. Apply only enough liquid locking compound to coat the last two threads 360°. Excess locking compound shall be wiped away. The mold adapter shall be installed and torqued to the required value in Table 1 of 120E3100003.

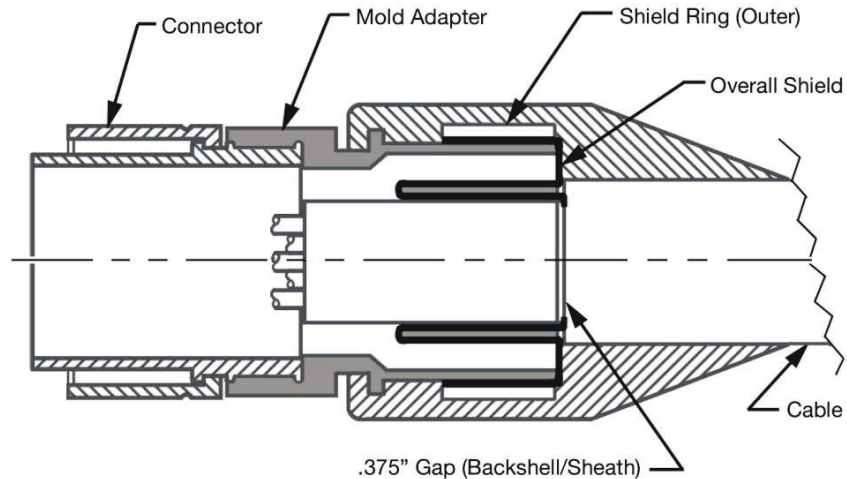


Figure 22. 360-Degree Overall Shield Termination Using a Mold Adapter

3.11.6.1.1 Tinel-Lock Rings

Tinel-Lock rings (shown in Figure 23) shall be used for 360-degree overall shield terminations when specified in engineering drawings and documentation. Tinel-Lock rings are made from a special shape memory metal that shrinks uniformly when heated. Tinel-Lock rings are used to terminate copper cable braid directly onto the rear of a connector backshell adapter. The adapter entry size and ring designator must be selected to suit the cable diameter and braid type. The resulting 360-degree terminations withstand severe shock, vibration, temperature cycling, and corrosion.


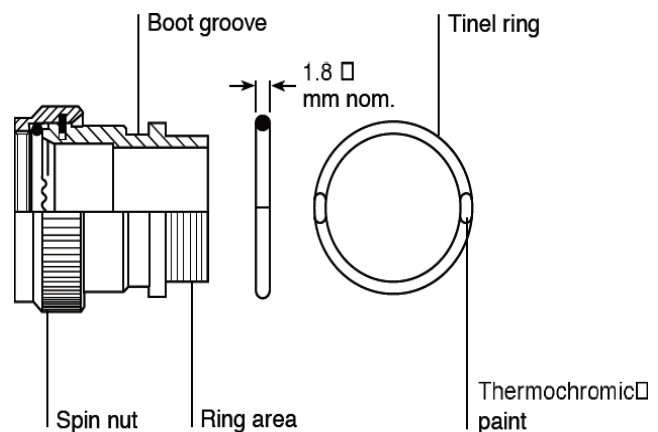


Figure 23. Tinel-Lock Rings and an Example of One Type of Adapter

Tinel rings are installed manually using either a bench or portable, handheld resistance heating tools designed specifically to install Raychem Tinel-Lock ring screened terminations (see [Figure 24](#) and [Figure 25](#)). The rings are marked with thermochromic paint, which changes color when the correct temperature for installation is reached. The operator positions the Tinel-Lock on the terminations, with at least one of the patches of thermochromic paint visible. The Tinel-Lock ring is then clamped in the jaws to start the installation. Installation is complete when the thermochromic paint turns black.

This normally takes 3 seconds to 12 seconds, depending on ring size, braid type, etc.

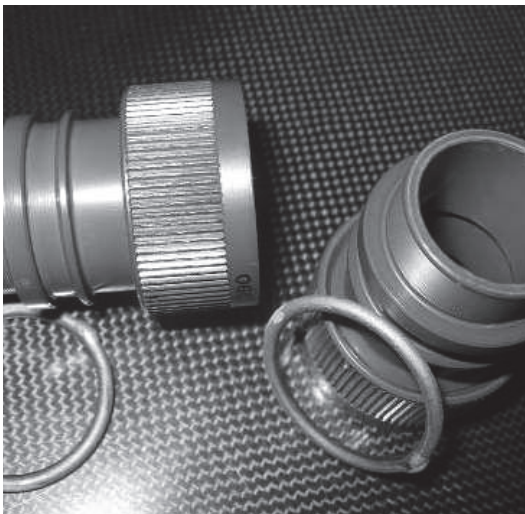

Raychem Tinel-Lock Bench-Style
Resistance Heating Tool



Raychem Tinel-Lock Handheld-Style
Resistance Heating Tool

Figure 24. Tinel-Lock Ring Resistance Heating Tools

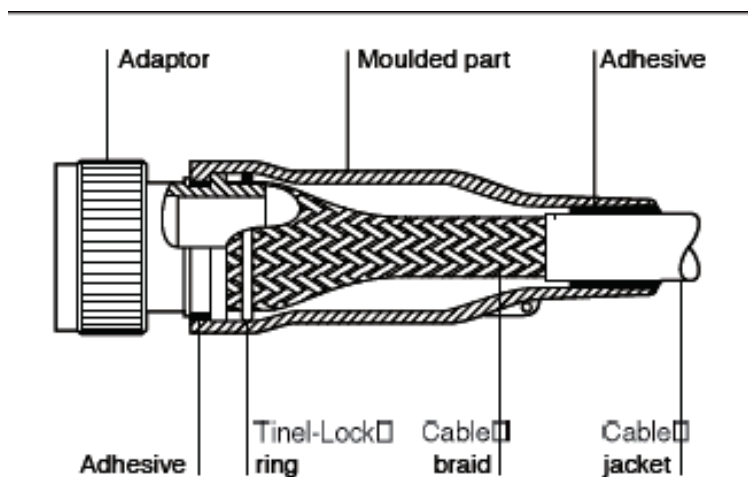


Figure 25. Typical Installation of Tinel-Lock Ring

3.11.6.1.2 EMI/RFI Foil Tape and Wire Mesh

Highly conductive foil tapes and conductive meshes are available in copper, aluminum, or tinned copper and provide an alternative, economical shielding solution for EMI and radio frequency interference (RFI) by providing a low impedance connection between a braided cable shield and the metal connector backshell in molded cables. An effective EMI shielded assembly is achieved without soldering the mesh or tape to the shield braid or backshell by wrapping the tape or mesh around the overall cable shield and connector backshell using an overlap wrapping method.

Conductive foil tape or conductive mesh shall be used for 360-degree termination of overall shields to connector backshells when specified in engineering drawings and documentation.

3.11.6.1.3 Exterior Cable Runs

The overall shield shall be immediately terminated to ground at the terminal distributor when the cable run exposes the shield to lightning-induced voltages and currents. On new designs, this shall be accomplished by terminating the shield to a MIL-DTL-22992, SAE AS 50151, or MIL-DTL-38999 connector with a conductive shell and 360-degree shield termination feature. Because many existing cables were not fabricated in this manner, the cable/distributor interface must be grounded as described below (see [Figure 8](#) through [Figure 10](#)):

- a. When the cable terminates in an exterior-type, heavy-duty (MIL-DTL-22992) connector, enough contacts shall be provided for the overall shield to be terminated on a connector contact. The overall shield shall be terminated with a shield terminal and connected to the last pin or socket in the connector. In the mating terminal distributor harness connector, the wire shall be connected to the last pin or socket and terminated under one of the screws on the connector mounting flange using an internal tooth lock washer in accordance with AIA/NAS NASM35333 under a lug in accordance with SAE AS 25036.
- b. When the cable terminates in an interior-type (e.g., MIL-DTL-26482, SAE AS 50151, or MIL-DTL-38999) connector, the overall shield shall be connected to the cable connector shell as shown in [Figure 10](#) (e.g., MIL-DTL-26482-type connectors have conductive shells). When this method of shield termination is employed, the mating harness connector and connector mounting plate must be solidly grounded to the terminal distributor.
- c. When the cable terminates on a terminal strip, the overall cable shield shall be terminated directly to the outer TD enclosure through the use of a conductive cable gland or shield ground bus in the TD enclosure cabinet (see [Figure 8](#) through [Figure 10](#)).

3.11.7 Cable Jacket Repair

Damage to the cable sheath shall be repaired without affecting the serviceability of the cable when the overall shield braid and the conductors underneath have not been harmed. When the integrity of the overall shield or conductor core is lost, the cable shall be replaced or spliced (see [3.11.8](#)).

3.11.7.1 Sleeves

The cable repair material shall consist of a heat-shrinkable sleeve coated on the inside with an adhesive that will melt and flow as the sleeve shrinks and will provide an environmentally sealed and electrically insulated connection. SAE AMS-DLT-23053 establishes the requirements for electrical insulating sleeving that will shrink to a predetermined size when heat is applied. A cable jacket repair tape shall be used to repair the cable in place or when a tubular sleeve cannot be fitted. Each end of the tape repair shall be overwrapped with vinyl electrical tape.

The damaged area shall be cleaned and abraded to remove dirt and improve adhesion; then the repair sleeve or tape shall be installed according to the manufacturer's instructions.

3.11.7.2 Approved Products

The following products, or their equivalents, are approved for use:

- a. **Heavy-wall cable sleeve:** Tyco Electronics (formerly known as Raychem) type WCS, type WCSM, or SST-FR (Tyco Electronics, 8000 Purfoy Rd., Fuquay-Varina, NC 27526 [CAGE 06090])
- b. **Light-wall cable sleeve:** Tyco Electronics (formerly known as Raychem) type TCS, TCS2, or STW (Tyco Electronics, 8000 Purfoy Rd., Fuquay-Varina, NC 27526 [CAGE 06090])
- c. **Cable Jacket Repair Tape:** 3M Company, Scotch Cable Jacket Repair Tape 2234 (3M Electrical Markets Div, 6801 River Pl Blvd, Austin, TX 78726 [CAGE 53387])

3.11.8 Splicing

Cables shall only be spliced with the approval of the contracting officer.

3.11.8.1 Procedure

Cable splicing shall be accomplished as follows:

- a. Strip the cable insulation to the required length, being careful to maintain the integrity of the overall shield. For multiconductor cables, plan the entire procedure so the splice sleeves will be staggered to reduce the diameter of the completed splice as much as possible.
- b. Slip the cable repair sleeve, in accordance with 3.11.7, over one cable end. The cable sleeve shall be sized to slip over the completed splice bundle and overlap the cable ends by a minimum of 150 mm (6 in).
- c. Place the shield braid and shield braid terminators over the cable ends if required by step g.

- d. Select the properly sized splice sleeve (see 3.5.11) for the conductor to be spliced. Splices made in accordance with NAS 1744 and SAE AS 81824 are preferred when environmental sealing and size considerations are important. Crimped splices are preferred over soldered splices when there is enough space to use crimping tools.
- e. Strip the conductor insulation for one-half the length of the splicing sleeve in accordance with 3.5.6.
- f. Install the splicing sleeve on the conductor using the approved tooling (see 4.3.2). Repeat the above steps for all conductors when required. Stagger the splices on a multiconductor cable to reduce the diameter of the bundle.
- g. Terminate the shield braid according to one of the following methods:
 - (1) For a cable with an (unspliced) wire bundle diameter less than 30 mm (1.2 in), use a shield braid terminator (SAE AS 83519A-A1 or NASA- approved). Before beginning the splicing operation, slide a properly sized shield terminator over each of the cable ends to be spliced. Then slide a section of tubular shield braid in accordance with A-A-59569B over one cable end, which is sized to fit over the completed splice bundle, and overlap the shield braid on the cable ends. After the conductor splices have been completed and inspected, slide the shield over the splices and terminate it to the original shielding according to the manufacturer's instructions. This is the preferred method for use in confined areas where it is difficult to operate the tooling.
 - (2) For a cable with an (unspliced) wire bundle diameter of 38 mm (1.5 in) or less, connect the shield braids using shield rings in accordance with 75M13676 or wing shield terminators (SAE AS 83519A-A1 or NASA-approved). Prior to splicing, slide the shield rings and braid over the cable ends. When the splicing operation is complete, slide the new section of the shield braid over the splice and crimp it to the old braid using the shield rings.
 - (3) For larger diameter cables where shield rings and/or shield terminators are not available, bridge the gap with open-weave shielding braid tape, Scotch no. 23, or equal. Install one half-lapped layer of the tape across the splice bundle, making sure it laps at least 25 mm (1 in) over the cable shield at each end. Tack-solder each end to hold them in place. Wick as much solder at the juncture as possible, being careful not to melt the conductor insulation underneath. Shield rings and/or shield terminators shall be used when available.
- h. Test the cable and verify compliance as specified in Section 3.12.
- i. Clean and abrade the outer cable jackets to remove foreign substances and ensure a proper bond. Position the cable sleeve across the splice bundle and shrink the sleeve to fit. A bead of sealant will be visible around the edge of the sleeve after shrinking when a proper seal has been made.

3.11.8.2 Approved Products

The following products, or an equivalent, are approved for use:

- a. Shield terminators in accordance with SAE AS 83519A-A1 and/or NASA- approved methods
- b. Tyco Electronics (formerly known as Raychem) shield braid terminators, series D-123 (Tyco Electronics, 8000 Purfoy Rd., Fuquay-Varina, NC 27526 [CAGE 06090])
- c. Scotch no. 24 electrical shielding tape (Electrical Specialties Division/3M, 225-4N 3M Center, St. Paul, MN 55144 [CAGE 20999])

3.11.9 Thermal Protection

Thermal protection of cable assemblies shall be in accordance with applicable installation or engineering drawings. Thermal blankets (jackets/sleeves) shall be in accordance with SAE AS1072. The following methods shall be used to apply thermal protection. When the application of thermal protection requires the removal of cable identification labels, the labels shall be reinstalled in a highly visible and permanent manner using metal tags with 6.5 mm (0.25 in) characters.

3.11.9.1 Application

Thermal protection application shall be accomplished as follows (metalized tape width for cable diameters less than (0.5 in) shall be coordinated with engineering documentation):

- a. **Method 1:** Apply a half-lapped layer of 50 mm (2 in)-wide heat-reflective, metallized glass-cloth tape.
- b. **Method 2:** Apply a base layer of half-lapped, 50 mm (2 in)-wide thermal-barrier tape or, if called out, thermal blanket. Cover with one layer of heat-reflective tape according to Method 1.
- c. **Method 3:** Apply a base of two half-lapped layers of 50 mm (2 in)-wide thermal-barrier tape. Cover with one layer of heat-reflective tape according to Method 1.
- d. **Method 4:** Apply a base of two half-lapped layers of 50 mm (2 in)-wide thermal-barrier tape. Cover with two layers of half-lapped 50 mm-wide heat-reflective, metallized glass-cloth tape according to Method 1.

NOTE

When more than one layer of tape is used, each successive layer shall be wrapped in the direction opposite of the preceding layer.

3.11.9.2 Approved Products

The following products, or their equivalents, are approved for use:

- a. High-temperature, metallized glass-cloth tape: Scotch type 363 (Industrial Tape and Specialties Division/3M, 3M Center, St. Paul, MN 55144 [CAGE 52132]).
- b. Thermal-barrier tape: Scotch type AZ 1367 (Industrial Tape and Specialties Division/3M, 3M Center, St. Paul, MN 55144 [CAGE 52132]); or 91111 Thermo- Trex High Temperature Silica Tape (TPC Wire & Cable Corp., 9600 Valley View Road, Macedonia, OH 44056 [CAGE 1GLC4]).
- c. Panduit stainless-steel tie MLTxH-LP (x = bundle diameter in inches) requires GS4MT installation tool and PME acid etching pen or IMP 250 indenter marker (Panduit Corporation, 17301 Ridgeland Street, Tinley Park, IL 60477 [CAGE 06383]).
- d. Thermal blanket: Fyrejacket sleeving (40010XXX10S) and Fyretape (Federal-Mogul Systems Protection Group, Bentley Harris Protection Products, 241 Welsh Pool Road, Exton, PA 19341 [CAGE 81851]).

3.11.9.3 Splicing, Fyrejacket Sleeving

For long-run cables requiring Fyrejacket sleeving, segments may be spliced together using the following procedure.

- a. Fold back existing Fyrejacket onto itself 3 inches
- b. Butt the new Fyrejacket up to the existing sleeving
- c. Tape new Fyrejacket with polyester type 1, L-1-T-100, to hold in place
- d. Un-roll existing folded sleeving back over new sleeving
- e. Trim excess fiber glass at end of existing fire sleeving after it is in place
- f. Tape the end of the existing Fyrejacket with 4 wraps of Silicone Fusion Tape, P/N 608036
- g. Inspect workmanship, Quality

3.12 Cable Checkout Post-Fabrication

At the completion of fabrication, all multiconductor electrical cable assemblies shall meet the Continuity, Dielectric Withstanding Voltage (DWV) and Insulation Resistance (IR) test requirements detailed in NASA-STD-8739.4, and as detailed below, as a precondition for their acceptance and installation in ground support equipment hardware. The order of the tests shall be continuity, DWV and IR to mitigate the risk of overstress due to continuity defects and to detect any latent defects.

At a minimum, the above-mentioned electrical acceptance tests on potted and potted/molded-type connectors shall be performed before the potting operation and after final assembly.

RF cable assemblies shall be given, as a minimum, continuity, DWV and IR per Sections 3.12.1–3.12.3, along with additional testing (insertion loss, VSWR, TDR) specified in the engineering documentation.

Cable assemblies, as defined herein, consist of cables with prefabricated terminations on one or both ends. Prior to tests, all wiring shall be inspected to verify proper workmanship and positioning for adequate clearances and stress relief. The fabricating agency shall retain and make available all test results as part of an acceptance data package (ADP) and shall certify that every cable assembly meets or exceeds all testing requirements specified.

3.12.1 Cable Continuity Test

All cable assemblies shall be tested for point-to-point electrical continuity using a calibrated meter or other measuring device approved by the contracting officer or designated NASA technical representative.

- a. The meter shall be set at the lowest ohm scale applicable to the readings.
- b. Each conductor shall be tested.
- c. Value not to exceed 2 ohms or 1 ohm plus the maximum specified resistance of wire, whichever is greater.
- d. Hand test probes shall not be used directly in the cable or harness connectors.

3.12.2 Cable Dielectric Withstanding Voltage (DWV) Test

All cable assemblies shall be DWV (Hipot) tested per NASA-STD-8739.4, Section 18.3.4, using a 1500Vdc. DWV (Hipot) tester shall be calibrated and serviceable. Adapter cables shall be utilized for all cable assemblies. The following parameters shall be used:

- a. Voltage Potential: 1500 Vdc (If The Service Rating Of The Connector Or Cable Is Below 1500 Vdc, The Designated Nasa Technical Representative Shall Be Notified)
- b. Rise Time: 3 seconds (500 Vdc/sec)
- c. Dwell Time: 2 seconds
- d. Leakage Current: 1.0 mA

The voltage potential shall be applied to all test points items detailed in NASA-STD-8739.4 (as applicable).

WARNING

Operators shall use appropriate safety precautions when working with high voltages.

3.12.3 Cable Insulation-Resistance Tests

All cable assemblies shall be Insulation Resistance (IR) tested per NASA-STD-8739.4, Section 18.3.5. IR tester shall be calibrated and serviceable. Adapter cables shall be utilized for all cable assemblies.

- a. Insulation resistance value shall be \geq to 100 MOhms for cables less than 10 feet, \geq to 10 MOhms for greater than 10 feet.
- b. At humidity levels greater than 80%, derating these values shall be evaluated by engineering and documented.

The voltage potential shall be applied to all test points items detailed in NASA-STD-8739.4 (as applicable).

WARNING

Operators shall use appropriate safety precautions when working with high voltages

3.12.4 Radio Frequency Cable Tests

The following standard tests shall be performed for radio frequency and video cables. Alternate procedures may be used with the approval of the contracting officer or as specified in design drawings or specifications.

3.12.4.1 Continuity Tests

The continuity tests for coaxial, twin-axial, triaxial, and balanced-pair (T43) cables shall be performed as specified in 3.12.1.

3.12.4.2 Insulation-Resistance Test

3.12.4.2.1 Coaxial Cable

The insulation-resistance test shall be performed by applying the ohmmeter leads of a high-input impedance volt-ohmmeter (set on $R \times$ highest range) to the inner and outer conductor of the connector ferrule.

If the meter indicates off-scale high or infinite resistance, the testing shall proceed as follows (shield-to-shield and shields-to-connector-body also apply to the test):

- a. Connect the voltmeter and 125 VDC source in series.
- b. Set the meter on the 5 V range and check to see that the meter has 11 M Ω input resistance on this scale.

With connectors installed, the coaxial cable shall have a resistance exceeding 500 M Ω indicated on the meter as 2.7 V or less. The insulation resistance from shield to shield and from shields to connector body may be as low as 100 M Ω (12.4 V on the 50 V scale).

The insulation-resistance test shall be performed in accordance with MIL-DTL-17, paragraph 4.8.5, and as specified by the cable and/or test equipment manufacturer.

3.12.4.2.2 Twin-Axial Cable and Balanced Pairs (T43, Cat5e, or Cat6)

The insulation-resistance tests for twin-axial cable and balanced pairs (T43, Cat5e, or Cat6) shall be as described in [3.12.3](#)

3.12.4.3 Time Domain Reflectometer (TDR) Test

The purpose of the TDR test is to obtain the return loss-versus-distance profile of the cable system. A radio frequency pulse is transmitted down the cable and the energy reflected back from any discontinuities or impedance variation is detected and displayed. The distance to the discontinuity determines the time it takes for the reflected energy to return to the (reference) detector and the magnitude of the reflected signal is a function of the return loss (reflection coefficient) at the point of the discontinuity (reflection point). From this, the magnitudes and locations of discontinuities (faults such as breaks, misalignments, corrosion, etc.) can be determined and the necessary corrective actions taken. A rise on the display indicates an increase in impedance (a broken wire or frayed shield); a dip on the display indicates a drop in impedance (a short) (refer to [Figure 26](#) and [Figure 27](#) for examples; the actual presentation may vary depending on the instrument used).

When specified on engineering documentation/drawings, time domain reflectometer (TDR) testing shall be conducted using a TDR that delivers a sine-shaped, controlled-bandwidth signal and has outputs for an X-Y recorder. A pulse width of 10 nanoseconds or less shall be used to test cables less than 90 m (300 ft) in length. Shorting plugs should be used wherever possible during the test.

3.12.4.3.1 Coaxial Cable TDR Testing

The following steps shall be performed:

- a. Connect the coaxial cable to the TDR with the opposite end open circuited and adjust the scope display to obtain both entrance and exit discontinuity spikes (see [Figure 26](#) View D).
- b. Short the opposite end of the cable and verify that a negative spike occurs equal to and located at the exact former rise point of the positive spike.
- c. Open the opposite end and take a graphic readout on the recorder. Record the length/division setting on the printout.

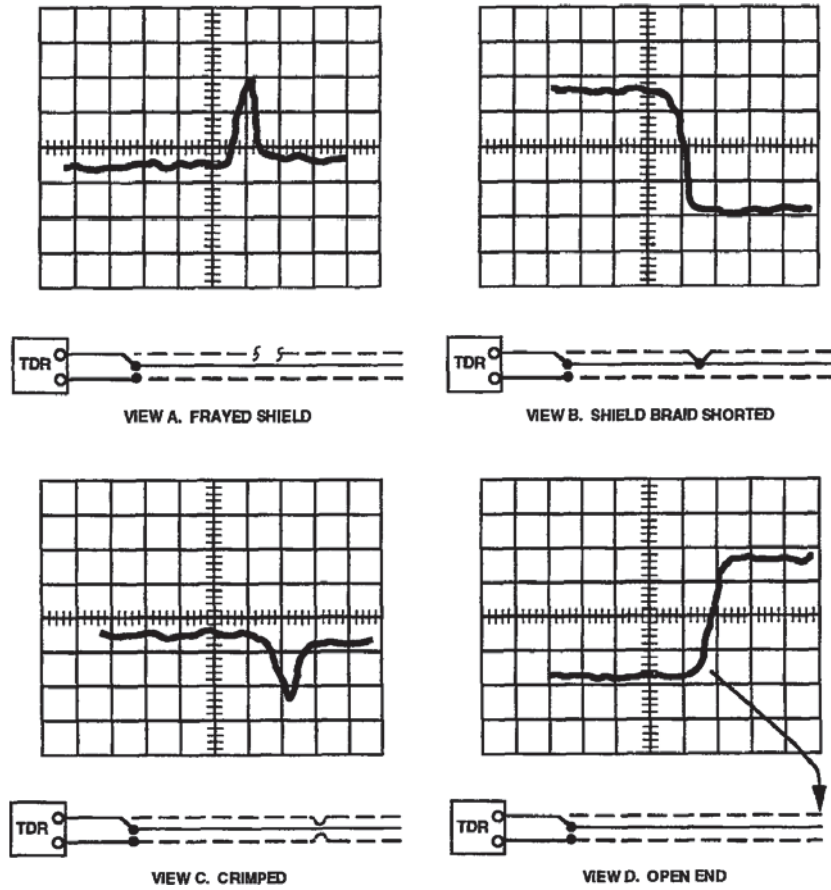


Figure 26. TDR Traces for Coaxial Cable

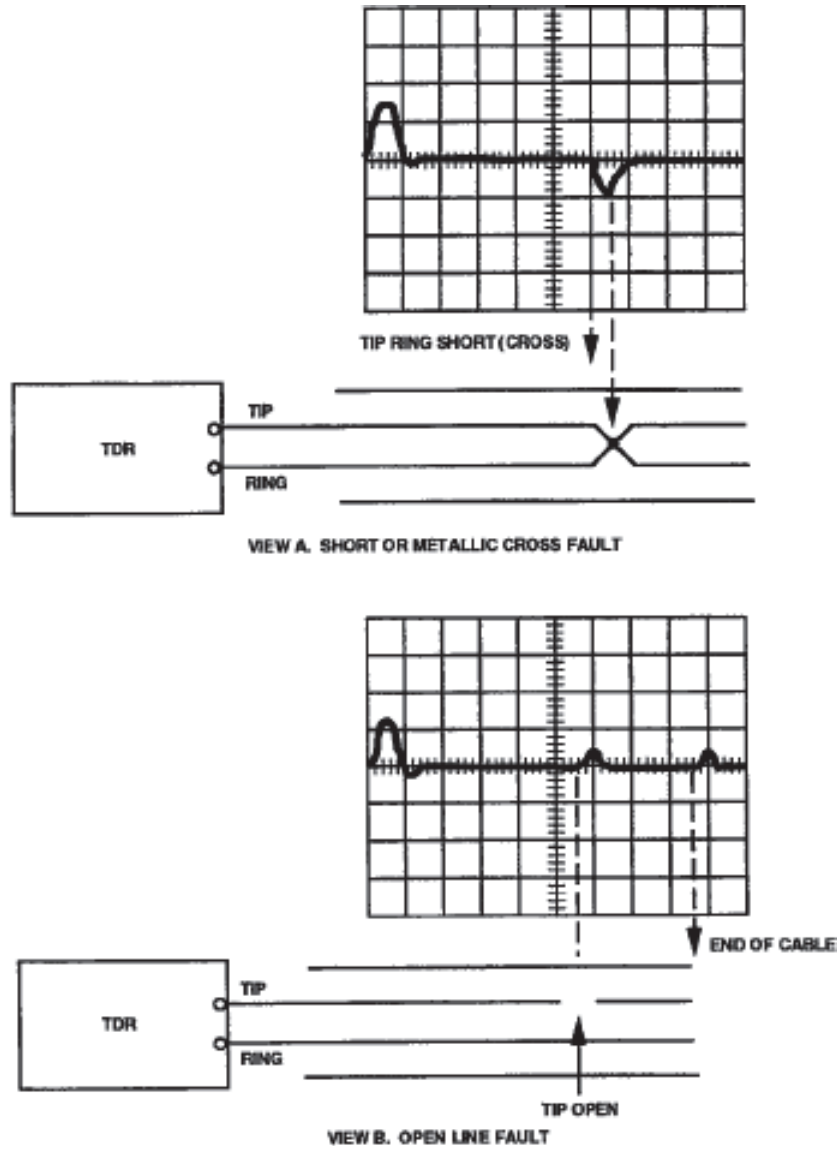


Figure 27. TDR Fault Traces for Twin-Axial Cable (Sheet 1 of 2)

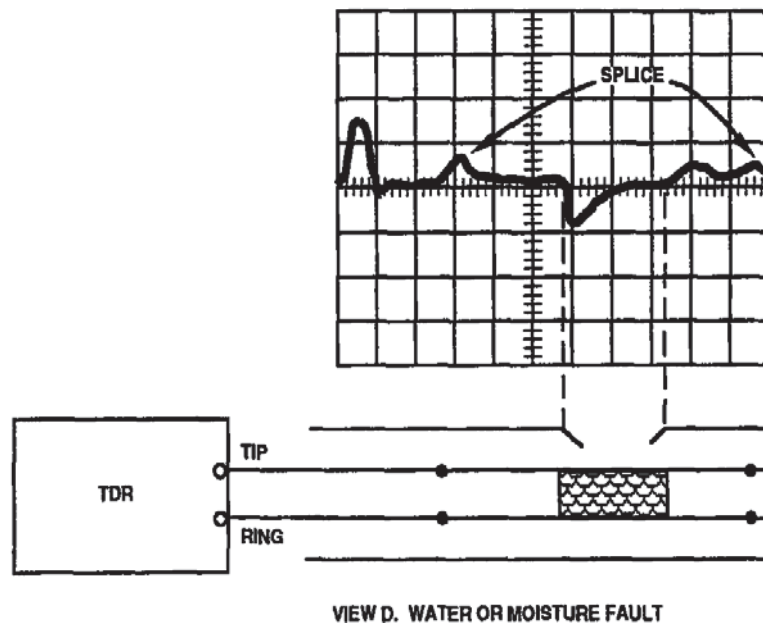
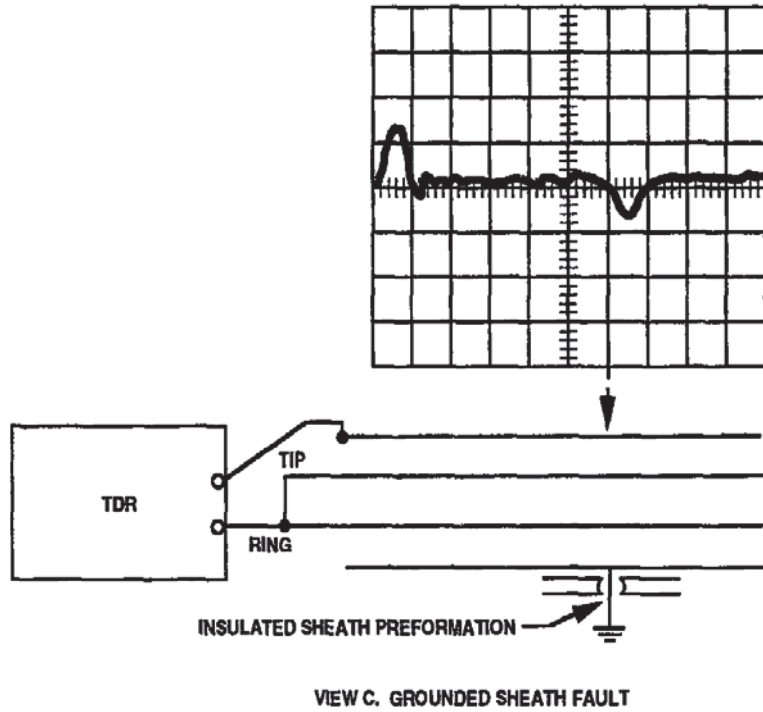


Figure 27. TDR Fault Traces for Twin-Axial Cable (Sheet 2 of 2)

3.12.4.3.2 Twin-Axial Cable or Balanced Pairs (Cat5e, Cat6, or T43) TDR Testing

The following steps shall be performed:

- a. With conductors connected to the TDR and the opposite end open, adjust the scope time scale to obtain both discontinuity spikes (see [Figure 27](#), View B).
- b. Short the conductors at the opposite end and verify that a negative spike occurs equal to and located at the exact former rise point of the position spike.
- c. Remove the short and take a graphic readout of the open end and record the length/division setting.
- d. Connect the TDR to one conductor (tip) and shield and display the discontinuity spikes with the opposite end open.
- e. Place the short on the opposite end and verify the location and presence of the negative spike.
- f. Repeat steps c and e.
- g. Repeat steps d, e, and f for the other conductor (ring).

3.12.4.3.3 Triaxial Cable TDR Test

Numerous commercial bench and handheld TDR testers are available for troubleshooting and fault detection in triaxial cables. For test setups and instructions, refer to the manufacturers' user's guides for specific testers.

3.13 Mineral-Insulated (MI) Cable

MI cable shall be installed in accordance with NFPA 70, Article 332. Termination procedures shall be in accordance with 79K06110.

3.14 Transducers

Sensors, transducers, and signal conditioners for use in GSE systems shall be selected as specified in KSC-NE-9187.

3.15 Electromagnetic Interference Tests

Specific ground support electronic equipment may require testing for electromagnetic interference. This equipment shall be in accordance with KSC-STD-E-0022 and MIL-STD-461. The contract technical representative shall identify this equipment and specify how the equipment must be tested for conducted and radiated emissions.

3.16 Fabrication Process Waste Disposal

Controls of waste materials generated during the fabrication process shall conform to CFR Title 40, Parts 260–282; Florida Administrative Code (FAC) Florida Department of Environmental Protection (FDEP), Division 62; KNPR 8500.1; and the following rules:

- a. No person shall collect, transport, store, recycle, use, or dispose of waste materials generated during the fabrication process in any manner that endangers the public health or welfare or the environment.
- b. These waste materials shall not be discharged into soils, sewers, drainage systems, septic tanks, surface waters or ground waters, water courses, or marine waters.
- c. Care shall be taken not to mix the wastes generated during fabrication.
- d. Containers/tanks used for waste disposal shall be labeled with the type of waste they contain.
- e. Wastes generated during the fabrication process shall be kept to a minimum through careful planning of the amounts of material needed.
- f. It is the user's obligation to properly store all hazardous materials and inform the local emergency planning organization of the quantity on hand and its location.
- g. Each user shall maintain records on the weight of hazardous material used and what happened to the material; i.e., whether it was consumed in the product, released into the environment (spilled or released through air emissions, land discharge, water discharge, or underground injection), used to generate energy onsite, used to generate energy offsite, recycled offsite, recycled onsite, treated offsite, or treated onsite.

3.17 Fiber-Optic Cables

The following paragraphs provide requirements for termination and cabling of both single-mode and multi-mode fiber in accordance with NASA-STD-8739.5. Facilities, equipment, and materials used in the fabrication, assembly, and installation of fiber-optics shall comply with this specification and the requirements of NASA-STD-8739.5. Terms related to fiber-optic cables are defined in 6.2 and additional information may be found in TIA-440-B.

3.17.1 Optical-Fiber End Preparation

The supplier's engineering documentation shall define the parts, tooling, equipment, and procedures used in preparing the fiber-optic cable for termination. All parts, materials, and tooling and equipment shall be verified for compliance to the engineering documentation before fabrication activities begin.

- a. Cables shall be prepared for termination in a fashion that will allow for the fiber to be exposed without sustaining damage or contamination.
- b. All outer protective materials shall be removed, in the proper dimensions, in accordance with the supplier's engineering documentation.

- c. The use of chemical strippers (e.g., acetone) for removal of certain buffer materials is acceptable. Chemically stripped fiber ends shall be thoroughly cleaned to remove any residual chemical stripping compounds and buffer materials immediately after stripping. This process shall be documented by the supplier. All necessary safety precautions shall be observed.
- d. All parts that come into contact with the adhesives, including all dispenser parts and mixing pans, as well as the fiber and connector to be bonded, must be thoroughly cleaned with appropriate solvents before bonding.
- e. The optical fiber shall be further prepared if warranted by the specific application, fiber construction, or process requirement. The supplier's engineering documentation shall specify any additional requirements.
- f. Procedures for collecting, controlling, and disposing of fiber-optic waste shall be documented. Fiber-optic waste is a safety concern and shall be handled as such during disposal. Incineration is the recommended method of safe disposal.
- g. Inspection techniques that produce core illumination shall be used.
- h. The connector endface may be finished either by polishing or cleaving provided that the process is compatible with the quality requirements established by the supplier's engineering documentation for the finished product.

3.17.2 Cleaning

Specific procedures shall be developed, documented, and maintained for cleaning, drying, and examining parts. Prior to use, the appropriate engineering activity shall verify the compatibility of the solvents used for cleaning the assembly and all materials, including epoxies. If not terminated immediately, prepared cable components shall be protected from contamination.

Fiber-optic terminations to be cleaned shall be handled in a manner that will not degrade or damage the termination. Cleaning processes shall not degrade the optical characteristics of the termination. Cleaning shall ensure removal of dirt, oil, grease, and particulate matter. Terminations shall be cleaned within a time frame that allows all contaminants to be removed.

Cleaning solvents shall be of the type specified in the engineering documentation. Manual cleaning of fiber terminations shall be performed using a solvent and a wipe or swab. The wipe or swab shall be nonabrasive, lint-free, and manufactured either by soxhlet extraction to remove oils, resins, or other contaminants, or by another means that would produce only a small amount of nonvolatile residue.

3.17.3 Splicing

Fiber-optic cables shall be prepared for splicing in accordance with 3.17.1. Cleaved fiber ends must be clean, fragment-free, and crack-free with minimum chips or other defects as shown in NASA-STD-8739.5, Appendix A. Fiber cable shall have an endface angle as required by the engineering documentation. Equipment used shall meet the criteria in NASA-STD-8739.5.

Splices should be of the construction, weight, and physical dimensions specified by engineering documentation. The design should (1) meet the requirements for optical, mechanical, and environmental performance as specified by engineering documents and NASA-STD-8739.5; (2) provide tensile strength continuity between spliced cables without the cable tensile load being applied to the splice junction; and (3) provide cable stress relief and environmental sealing between the cables and splice to prevent external contaminants from entering. The stress relief should provide protection from both cable tensile forces and cable axial compressive forces. The use of splice trays is recommended for multiple splices.

All splice parts of the same type should be physically and functionally interchangeable without the need to modify them or the splicing equipment. When dissimilar metals are used in contact with each other, protection against electrolysis and corrosion should be provided. Metal spraying or metal plating of dissimilar base metals to provide similar or suitable abutting surfaces is permitted. Seals should provide isolation from humidity and/or contamination for splice interior parts.

3.17.3.1 Presplicing Examination

Prior to splicing, the fiber shall be examined to ensure there is no contamination, blockage of the internal fiber channel, unacceptable conditions as shown in NASA-STD-8739.5, Appendix A, as applicable, or other areas of nonconformance to the specific requirements of the engineering documentation.

3.17.3.2 Splicing Method

Splices shall be made using the appropriate method as described in the following paragraphs, or as specified in the engineering documentation.

3.17.3.2.1 Fusion Splicing

Fusion splicing shall be performed in accordance with engineering documentation. Completed fusion splices shall be able to withstand a minimum 4.45 N (1 lb) pull test, or as specified in the engineering documentation.

3.17.3.2.2 Mechanical Splicing

Mechanical splicing shall not be used for cables intended for use in spaceflight operations. Mechanical splicing of fiber optics shall be performed in accordance with engineering documentation.

3.17.3.2.3 Chemical Splicing

Chemical splicing shall only be used for temporary joining of fiber optics (i.e., testing).

3.17.3.3 Splice Requirements

Completed splices shall meet the following minimum requirements:

3.17.3.3.1 Location

Splices shall not be located in areas where the cable is flexed except when a splice is recoated and re-jacketed in accordance with the manufacturer's original specifications.

3.17.3.3.2 Protection

Splices shall be protected. If a splice enclosure cannot be used for a specific application, engineering documentation shall provide for other means of protection.

3.17.3.3.3 Strength Member

Strength members shall be secured to splice enclosures, or other means of protection, to prevent mechanical stress on the optical fiber.

3.17.4 Fiber-Optic Cable Assemblies

A fiber-optic cable assembly consists of a prepared fiber-optic cable, connector, and associated hardware. Materials used shall be in accordance with NASA-STD-8739.5.

3.17.4.1 Cable Assembly

Fiber-optic cables shall be prepared for the connector assembly in accordance with the procedures outlined in 3.17.1. Cables shall be identified in such a way to distinguish these cables from wire or coaxial cables. Cable connectors shall be permanently marked with mating connector designation within 15 cm (6 in) of the connector body, or as stated in the engineering documentation.

3.17.4.1.1 Preassembly Verification

Prior to assembly, prepared fiber-optic cables shall be subject to documented in-process peer verification for (1) correct dimensions for the cable stripping; (2) damage to a strength member; (2) cracks, nicks, cuts, or other damage to cable components in the termination area, including optical fiber; (4) wicking or damage to the chemical strip; and (5) cleanliness as defined in 3.17.2. Any other verifications defined in the engineering documentation shall also be performed.

3.17.4.1.2 Preassembly Examination

Prior to assembly, prepared fiber-optic connector parts shall be examined for (1) blockage in the internal fiber channel (the prepared fiber shall not be used to check for blockage); (2) cleanliness as defined in 3.17.2; and (3) cracks or deformities on the connector ferrule.

3.17.4.2 Completed Cable Assemblies

The connector should be of the construction, weight, and physical dimensions specified by engineering requirements. The design should (1) meet the requirements for optical, mechanical, and environmental performance as specified by engineering requirements; (2) provide stress relief for the cable and environmental sealing between the cables and connector to prevent external contaminants from entering. The stress relief and connector/cable attachment method should provide protection from both cable tensile forces and cable axial compressive forces.

All connector parts of the same type should be physically and functionally interchangeable without the need to modify such items or the termination equipment. A complete mated connector design should be comprised only of parts from the same manufacturer to prevent problems with the connectors mating. If dissimilar metals are used in contact with each other because no alternate exists, protection against electrolysis and corrosion shall be provided. Metal spraying or metal plating of dissimilar base metals to provide similar or suitable abutting surfaces is permitted.

Seals should be used to isolate connector interior parts from humidity and/or contamination.

Engineering documentation shall address the maximum allowable connector coupling loss, connector mate durability, staking and torque values, and the minimum cable bend radii.

For inspection purposes, clear heat-shrinkable sleeving is recommended. Completed cable assemblies shall be inspected to verify the following conditions:

- a. The strength member, when visible, is uniformly distributed and securely attached to the connector.
- b. The heat shrinkable sleeving and/or crimp sleeve is positioned properly.
- c. The connector endface geometry is compliant with engineering documentation.
- d. The connector endface meets requirements in accordance with NASA-STD-8739.5, Appendix A1, or the engineering documentation.
- e. The length of the connector ferrule is compliant with engineering documentation.
- f. The strain relief device is properly positioned and attached in accordance with the engineering documentation.
- g. Cleanliness meets the requirements defined in 3.17.2.
- h. Cable axial alignment with the connector is within 5 cm (2 in) of the termination or in accordance with the engineering documentation.
- i. The assembly is free of nicks/cuts exposing underlying elements.
- j. The assembly is free of kinks or twists.
- k. The proper cable designation marking is shown.

3.17.5 Fiber-Optic Assemblies

Fiber-optic assemblies include such devices as electro-optical components, couplers, dividers, wavelength multiplexers, and splice enclosures. The optical fibers found in these devices consist of the fiber (core and cladding) and the coating surrounding the fiber. Optical fibers differ from fiber-optic cables which may have a buffer, loose tube, strength members, and outer jacket as additional protective sheathing.

3.17.5.1 Fiber-Optic Connector Termination

The optical fiber shall be prepared in accordance with 3.17.1.

3.17.5.1.1 Preassembly Verification

Prior to assembly, prepared optical fibers shall be subject to a documented, in-process, peer verification for (1) correct stripping dimensions; (2) cracks, nicks, cuts, or other damage to the coating and fiber; (3) chemical strip wicking or damage; and (4) cleanliness as defined in 3.17.2. Any other verifications (e.g., to verify heat-shrinkable sleeving dimensions or crimp sleeve requirements) required by engineering documentation shall be performed.

3.17.5.1.2 Preassembly Examination

Prior to assembly, fiber-optic connector parts shall be examined for (1) blockage in the internal fiber channel (the prepared fiber shall not be used to check for blockage), (2) cleanliness as defined in 3.17.2, and (3) cracks or deformities on the connector ferrule.

3.17.5.2 Post-Fiber-Optic-Connector-Termination Inspection

Terminated fiber-optics shall be inspected to verify that (1) the heat-shrinkable sleeving and/or crimp sleeve is positioned properly; (2) the connector endface geometry is compliant with engineering documentation; (3) the connector endface requirements are in accordance with NASA-STD-8739.5, Appendix A, or engineering documentation; and (4) the strain relief is properly positioned in accordance with the engineering documentation.

When inspecting optical fiber, inspection techniques that produce core illumination shall be used.

3.17.5.3 Fiber-Optic Routing

The optical fiber shall not be routed over sharp edges or corners unless appropriate protection is provided. The minimum bend radius of the routed optical fiber shall be in accordance with engineering documentation. The optical fiber shall be tied down (e.g., lacing cord) in accordance with the engineering documentation to prevent subsequent damage due to processing, handling, and operational environments. The ties shall not pinch, deform, or otherwise stress the optical fiber. The ties shall be loose enough to allow the fibers to move slightly due to thermal expansion and contraction. Overly tight ties can cause microbending of the fiber and affect performance or reliability. Conduits should be used to route optical fibers through areas where access is limited or restricted. Staking or conformal coating shall not be applied to optical fiber unless specifically required in the engineering documentation.

3.17.6 Testing

3.17.6.1 Fiber-Optic Splices

Splices shall be verified. Optical time domain reflectometry (OTDR), as well as other appropriate test procedures from NASA-STD-8739.5, Appendix B, should be used after the completion of the splicing operation to ensure that loss characteristics are consistent with the loss allowances established by design and operation engineering documentation. Records of testing shall be maintained with the assembly/subassembly documentation. NASA-STD-8739.5, Appendix B, provides a list of available test and verification documents.

3.17.6.2 Fiber-Optic Cable Assemblies

All completed cable assemblies shall be tested to ensure that measured optical performance (e.g., insertion loss or return loss) meets or exceeds the performance requirements in the engineering documentation. Records of testing shall be maintained with the assembly or subassembly documentation. NASA-STD-8739.5, Appendix B, provides a list of available test and verification documents.

Upon completion of initial testing (in accordance with the paragraph above), the cable assemblies shall be subjected to workmanship temperature cycling or preconditioning as identified in the engineering documentation. Cable assemblies shall be retested and, in addition, examined for the following:

- a. Cracks in the fiber endface using normal inspection techniques. The fiber-optic cable assembly shall be inspected without touching the fiber as part of the examination.
- b. Pistoning of the fiber in the connector.
- c. Cracks in the epoxy bond line at the endface.
- d. Shrinkage of the outer jacket. Other cable components shall also be evaluated for shrinkage. An unacceptable amount of shrinkage shall be defined by an excessive optical loss value as specified in the engineering documentation.

3.17.6.3 Fiber-Optic Assemblies

All finished fiber-optic assemblies shall be tested to ensure that measured optical performance meets the performance requirements in the engineering documentation. Records of testing shall be maintained with the assembly or subassembly documentation. NASA-STD-8739.5, Appendix B, provides a list of available test and verification documents.

Upon completion of initial testing (in accordance with the paragraph above), the fiber-optic assemblies shall be subjected to workmanship temperature cycling or preconditioning as identified in the engineering documentation. Fiber-optic assemblies shall be retested and, in addition, examined for the following:

- a. Cracks in the fiber endface. The examination shall be done using direct and back lighting. The optical fiber shall be back-lit using an incoherent, low-intensity light source from the opposite end of the fiber, without touching the fiber as part of the examination. When the opposite end of the fiber is not accessible, inspection techniques that produce core illumination shall be used.
- b. Pistoning of the fiber in the connector or termination.
- c. Cracks in the epoxy bond line at the endface.
- d. Shrinkage of the buffer or outer jacket.

3.17.6.4 Optical Time-Domain Reflectometer (OTDR) Test

In accordance with NASA-STD-8739.5, the optical performance (e.g., insertion loss or return loss) of completed fiber-optic cable assemblies, fiber-optic splices, and fiber-optic assemblies shall be measured to ensure that it meets or exceeds the performance requirements in the engineering documentation. An OTDR test using fiber-optic test procedures (FOTP) outlined in Appendix B of NASA-STD-8739.5 (i.e., TIA-455-78-B) shall be used for the verification.

3.17.6.5 OTDR Basic Theory of Operation

An OTDR sends short pulses of light into a fiber. Light scattering occurs in the fiber due to discontinuities such as connectors, splices, bends, and faults. An OTDR uses the effects of Rayleigh scattering and Fresnel reflection to measure the fiber's condition, but the power level of the Fresnel reflection is tens of thousands of times higher than that of the backscatter. Rayleigh scattering occurs when a pulse travels down the fiber and small variations in the material, such as discontinuities in the index of refraction, cause light to be scattered in all directions. However, the phenomenon in which small amounts of light are reflected directly back toward the transmitter is called backscattering. Fresnel reflections occur when the light traveling down the fiber encounters abrupt changes in material density that may occur when there is an air gap at connections or breaks. A very large amount of light is reflected, as compared with the Rayleigh scattering. The strength of the reflection depends on the degree of change in the index of refraction.

An OTDR detects and analyzes the backscattered signals. The signal strength is measured for specific intervals of time and is used to characterize events. The OTDR calculates distances to events as follows:

$$\text{Distance} = \frac{c}{n} \times \frac{t}{2}$$

Where:

c = speed of light in a vacuum (2.998×10^8 m/s)

t = time delay from the launch of the pulse to the reception of the pulse

n = index of refraction of the fiber under test (as specified by the manufacturer)

OTDRs are microprocessor-based diagnostic tools that can be PC-based, bench-type, or hand-held models. Depending on the model, the basic setup and flow of data will be as shown in Figure 28.

Refer to the manufacturer's instructions or user's guide for proper setup and operation of individual OTDRs.

Users rely on optical time-domain reflectometry to characterize optical fiber and optical connection properties in the field. An OTDR transmits an optical pulse through an installed optical fiber. The OTDR measures the fraction of light that is reflected due to Rayleigh scattering and Fresnel reflection. By comparing the amount of light scattered back at different times, the OTDR can determine fiber and connection losses.

When several fibers are connected to form an installed cable plant, the OTDR can characterize optical-fiber and optical-connection properties along the entire length of the cable plant. A fiber-optic cable plant consists of optical fiber cables, connectors, splices, mounting panels, jumper cables, and other passive components. A cable plant does not include active components such as optical transmitters or receivers.

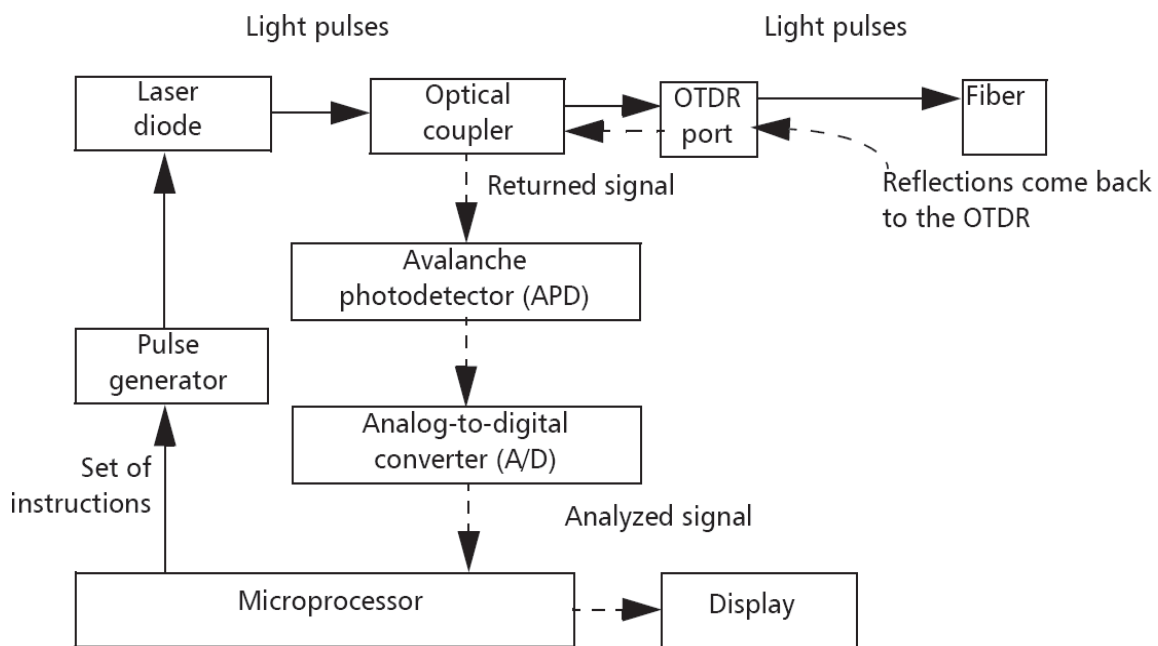


Figure 28. Typical OTDR Block Diagram

The OTDR displays the backscattered and reflected optical signal as a function of length. The OTDR plots half the power in decibels (dB) versus half the distance. Plotting half the power in decibels and half the distance corrects for round-trip effects. By analyzing the OTDR plot, or trace, users can measure fiber attenuation and transmission loss between any two points along the cable plant. Users can also measure insertion loss and reflectance of any optical connection. In addition, users can locate fiber breaks or faults with the OTDR trace.

Figure 29 shows an example OTDR trace of an installed cable plant. OTDR traces can have several common characteristics. An OTDR trace begins with an initial input pulse. This pulse is a result of Fresnel reflection occurring at the connection to the OTDR. Following this pulse, the OTDR trace is a gradual down-sloping curve interrupted by abrupt shifts. Periods of gradual decline in the OTDR trace result from Rayleigh scattering as light travels along each fiber section of the cable plant. Periods of gradual decline are interrupted by abrupt shifts called point defects. A point defect is a temporary or permanent local deviation of the OTDR signal in the upward or downward direction. Point defects are caused by connectors, splices, or breaks along the fiber length. Point defects, or faults, can be reflective or nonreflective. An output pulse at the end of the OTDR trace indicates the end of the fiber cable plant. This output pulse results from Fresnel reflection occurring at the endface of the output fiber.

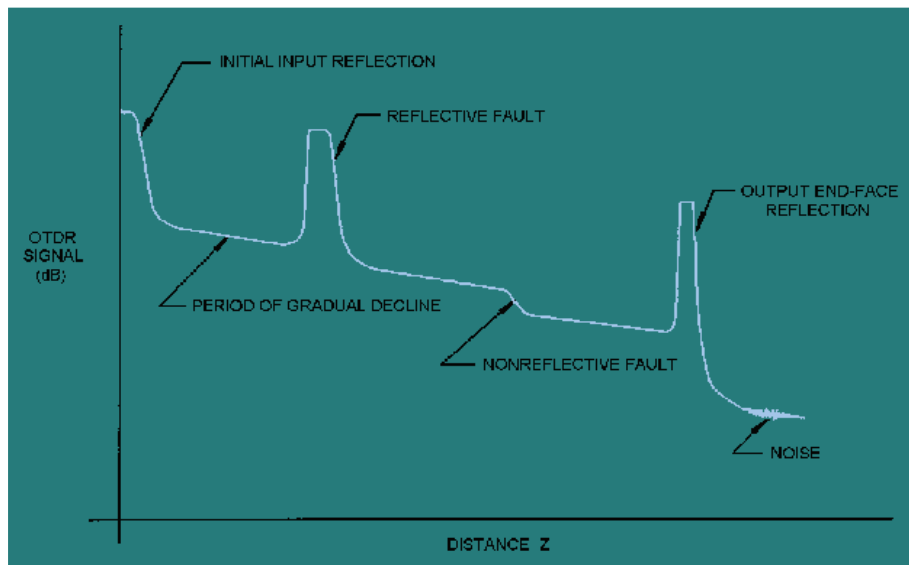


Figure 29. OTDR Trace of an Installed Cable Plant

3.17.6.5.1 Attenuation

The test method for measuring the attenuation of an installed optical fiber using an OTDR is specified in TIA/EIA-455-78-B. The accuracy of this test method depends on the user entering the appropriate source wavelength, pulse duration, and fiber length (test range) into the OTDR. In addition, the effective group index of the test fiber is required before the attenuation coefficient and accurate distances can be recorded. The group index (N) is provided by fiber manufacturers or is found using TIA-455-133-A. If the test parameters are entered correctly, OTDR fiber attenuation values will closely coincide with those measured by the cutback technique. Test personnel can connect the test fiber directly to the OTDR or to a dead-zone fiber. This dead-zone fiber is placed between the test fiber and OTDR to reduce the effect of the initial reflection at the OTDR on the fiber measurement. The dead-zone fiber is inserted because minimizing the reflection at a fiber joint is easier than reducing the reflection at the OTDR connection.

Figure 30 illustrates the OTDR points for measuring the attenuation of the test fiber using a dead-zone fiber. Fiber attenuation between two points along the test fiber is measured on gradual down-sloping sections on the OTDR trace. No point defects should be present along the portion of fiber being tested.

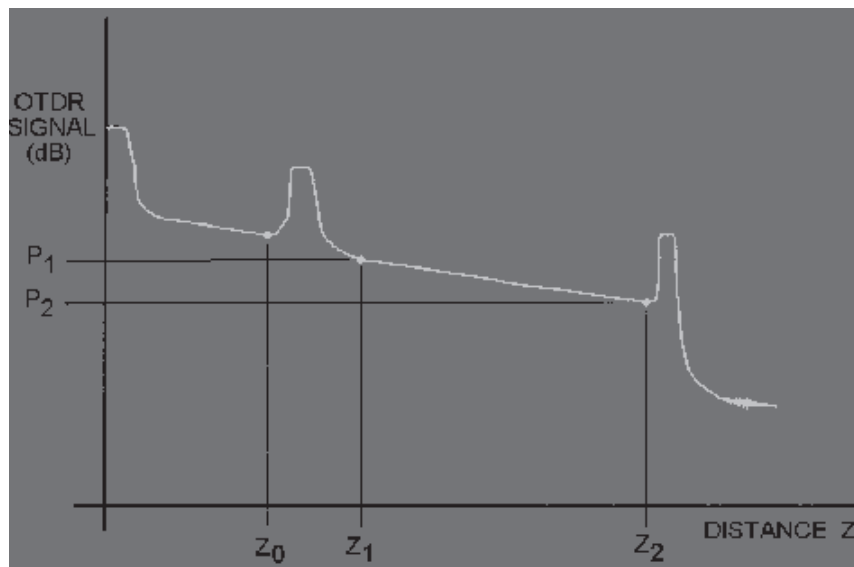


Figure 30. OTDR Measurement Points for Measuring Fiber Attenuation, Using Dead-Zone Fiber

OTDRs are equipped with either manual or automatic cursors to locate points of interest along the trace. In Figure 30 a cursor is positioned at a distance z_0 on the rising edge of the reflection at the end of the dead-zone fiber. Cursors are also positioned at distances z_1 and z_2 . The cursor positioned at z_1 is just beyond the recovery from the reflection at the end of the dead-zone fiber. Since no point defects are present in Figure 30 the cursor positioned at z_2 locates the end of the test fiber. Cursor z_2 is positioned just before the output pulse resulting from Fresnel reflection occurring at the end of the test fiber.

The attenuation of the test fiber between points z_1 and z_2 is $(P_1 - P_2)$ dB. The attenuation coefficient (α) is

$$a = \frac{(P_1 - P_2)}{(z_2 - z_1)} \text{ dB/km}$$

The total attenuation of the fiber including the dead zone after the joint between the dead-zone fiber and test fiber is

$$\text{Attenuation} = (P_1 - P_2) \frac{(z_1 - z_0)}{(z_2 - z_1)} \text{ dB}$$

If fiber attenuation is measured without a dead-zone fiber, z_0 is equal to zero ($z_0 = 0$). At any point along the length of fiber, attenuation values can change depending on the amount of optical power backscattered due to Rayleigh scattering. The amount of backscattered optical power at

each point depends on the forward optical power and its backscatter capture coefficient. The backscatter capture coefficient varies with length depending on fiber properties. Fiber properties that may affect the backscatter coefficient include the refractive index profile, numerical aperture (multimode), and mode-field diameter (single mode) at the particular measurement point. The source wavelength and pulse width may also affect the amount of backscattered power.

By performing the OTDR attenuation measurement in each direction along the test fiber, test personnel can eliminate the effects of backscatter variations. Attenuation measurements made in the opposite direction at the same wavelength (within 5 nm) are averaged to reduce the effect of backscatter variations. This process is called bidirectional averaging. Bidirectional averaging is possible only if test personnel have access to both fiber ends. OTDR attenuation values obtained using bidirectional averaging should compare with those measured using the cutback technique in the laboratory.

3.17.6.5.2 Point Defects

Point defects are temporary or local deviations of the OTDR signal in the upward or downward direction. A point defect, or fault, can be reflective or nonreflective. A point defect normally exhibits a loss of optical power. However, a point defect may exhibit an apparent power gain. In some cases, a point defect can even exhibit no loss or gain. Figure 29 (shown previously) illustrates a reflective fault and a nonreflective fault, both exhibiting loss. Figure 31 shows a nonreflective fault with apparent gain and a reflective fault with no apparent loss or gain.

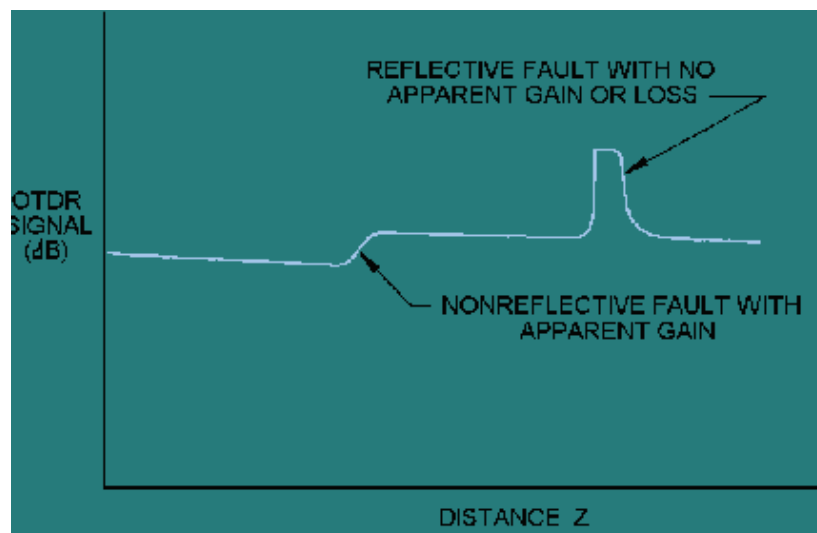


Figure 31. OTDR Trace Showing a Nonreflective Fault with Apparent Gain and a Reflective Fault with No Apparent Loss or Gain

Point defects are located and measured using TIA/EIA-455-78. Test personnel must enter the appropriate input parameters including the source wavelength, the pulse duration, and the fiber or cable group index into the OTDR. The nature of fiber point defects depends on the value of each parameter entered by the user. The pulse duration usually limits the length of the point defect while other input parameters, such as the wavelength, can vary its shape. If the length of the fiber point defect changes with the pulse duration, then the OTDR signal deviation is in fact a

point defect. If the length remains the same, then the OTDR signal deviation is a region of high fiber attenuation. Regions of high fiber attenuation are referred to as attenuation nonuniformities.

Fiber point defects occur from factory fiber splices or bends introduced during cable construction or installation. For shipboard applications, manufacturers are not allowed to splice fibers during cable construction. Fiber joints are natural sources of OTDR point defects. However, fiber breaks, cracks, or microbends introduced during cable installation are additional sources of point defects.

Point defects that occur at fiber joints are relatively easy to identify because the location of a fiber joint is generally known. A reflective or nonreflective fault occurs at a distance equal to the location of the fiber joint. In most circumstances, an optical connector produces a reflective fault, while an optical splice produces a nonreflective fault.

Reflective and nonreflective faults occurring at distances other than fiber joint locations identify fiber breaks, cracks, or microbends. A fiber break produces a reflective fault because fiber breaks result in complete fiber separation. Fiber cracks and microbends generally produce nonreflective faults.

A point defect may exhibit apparent gain because the backscatter coefficient of the fiber present before the point defect is higher than that of the fiber present after. Test personnel measure the signal loss or gain by positioning a pair of cursors, one on each side of the point defect.

Figure 32 illustrates the positioning of the cursors for a point defect showing an apparent signal gain. The trace after the point defect is extrapolated as shown in Figure 32. The vertical distance between the two lines in Figure 32 is the apparent gain of the point defect.

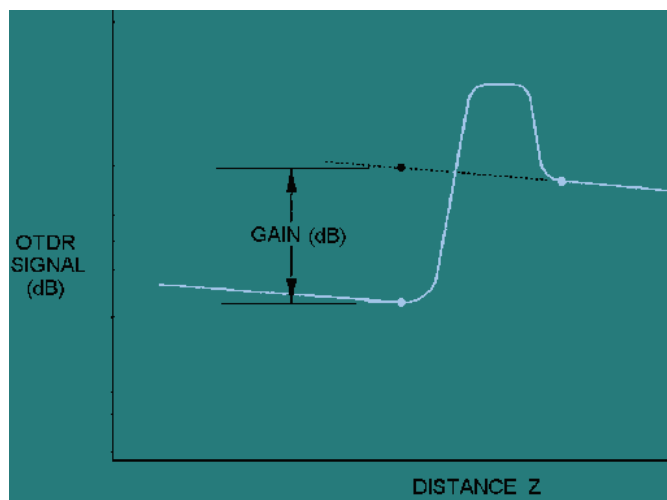


Figure 32. Extrapolation for a Point Defect Showing an Apparent Signal Gain

Point defects exhibiting gain in one direction will exhibit an exaggerated loss in the opposite direction. Figure 33 shows the apparent loss shown by the OTDR for the same point defect shown in Figure 32 when measured in the opposite direction. Bidirectional measurements are conducted to cancel the effects of backscatter coefficient variations. Bidirectional averaging

combines the two values to identify the true signal loss. Bidirectional averaging is possible only if test personnel have access to both ends of the test sample.

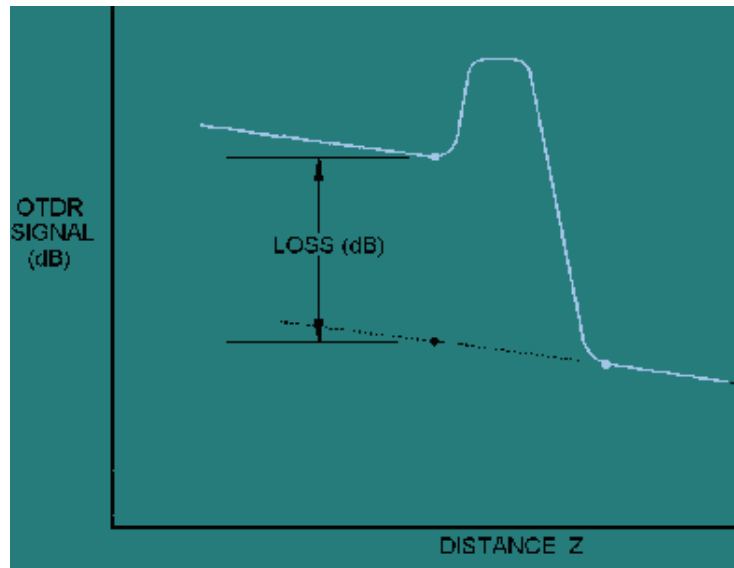


Figure 33. Exaggerated Loss Obtained at Point Defects Exhibiting Gain in One Direction by Conducting the OTDR Measurement in the Opposite Direction

OTDRs can also measure the return loss of a point defect. However, not all OTDRs are configured to make the measurement. To measure the return loss of a point defect, the cursors are placed in the same places as for measuring the loss of the point defect. The return loss of the point defect is displayed when the return loss option is selected on the OTDR. The steps for selecting the return loss option depend upon the OTDR being used.

3.17.7 Fiber-Optic Cable Assembly Installation

Fiber-optic cable assemblies should not be combined in the same wiring bundle as wire or coaxial cable assemblies. Care must be taken to prevent damage to fiber-optic cable assemblies during the installation process. Fiber-optic cables shall only be installed by trained and certified fiber-optic personnel. Training and certification shall be in accordance with NASA-STD-8739.5.

3.17.7.1 Tensile Load and Vertical Rise

The maximum installation tensile load, the maximum use tensile load, and the maximum vertical rise for cable assemblies installed in raceways, trays, ducts, or conduits and multifiber cables shall be specified on the engineering documentation.

3.17.7.2 Installation Bend Radius

The minimum bend radius experienced during installation (short-term) shall not be less than 10 times the cable diameter unless specified on the engineering documentation or in accordance with manufacturer's specifications.

3.17.7.3 Installed Bend Radius

The minimum installed (long-term) bend radius shall not be less than 15 times the cable diameter unless specified on the engineering documentation or in accordance with manufacturer's specifications.

3.17.7.4 Cable Tying

For installation, fiber-optic cable assemblies shall be tied in accordance with the engineering documentation. The minimum long-term bend radius shall not be violated at connector backshells. Tie-downs shall be tight enough to capture the fiber-optic cable but shall not deform the cable outer jacket. The ties shall not pinch, deform, kink, or otherwise stress the cable assembly.

3.17.7.5 Dust Caps

Dust caps shall be installed on all connectors when not in use.

3.17.7.6 Premating Inspection

Fiber-optic cable connector or termination endfaces shall be examined before they are mated and, if necessary, cleaned in accordance with 3.17.2.

3.17.7.7 Connector Torque

Fiber-optic connectors shall be torqued in accordance with engineering documentation.

3.17.7.8 Sharp Edges

Fiber-optic cable assemblies shall not be routed over sharp edges or corners unless appropriate protection is provided.

3.18 Ethernet

Ethernet is currently used in the Premise Distribution System (PDS) at KSC. There are plans to integrate as many systems as possible onto a redundant Ethernet transport using both copper and fiber cabling. KSC-STD-E-0021 lists the requirements for the PDS. Design and installation of Ethernet cabling, assemblies, and equipment should comply with KSC-STD-E-0021.

3.18.1 Ethernet Naming Conventions

The IEEE naming convention for Ethernet cables is as follows:

- a. The first number (10, 100, 1000) indicates the transmission speed in megabits per second (Mbps).
- b. The second term indicates transmission type: BASE = baseband; BROAD = broadband.

- c. The last number indicates segment length. A 5 means a 500 m segment length from the original Thicknet.
- d. In newer IEEE standards, letters replace numbers. For example, in 10BASE-T, the T means unshielded twisted-pair cables; in 100BASE-T4, the T4 indicates four such pairs.

3.19 Electrical Assembly Cleanliness

Electrical assemblies shall be visually clean from debris consisting of, but not limited to, wire insulation, wire clippings, tie wraps, cutting fluid, dust, and metallic shavings. Inspections for debris should occur prior to fabrication and assembly and upon completion of fabrication activities. Inspection for debris shall be thorough, including, but not limited to, behind removable panels, within channels and bracing, in gasket materials, beneath mounted equipment. Movement of assemblies can reveal debris that has been hidden, some tilting and rotation post machining can release chips that have been trapped within an assembly and is encouraged. Debris shall be removed upon discovery to prevent spread of contamination throughout an assembly. Machining operations on electrical assemblies and enclosures require extra attention to capture chips and shavings. The use of masking materials, suction, containment vessels, and diligence during machining will prevent debris from accumulating within an assembly. Removal of debris can be accomplished by use of vacuum and wiping with lint free rags, the use of isopropyl alcohol as a solvent is acceptable but may damage some materials and should be evaluated prior to use. Shop air can be used during and after machining of raw parts but should not be used within an assembly that chips could migrate and impair system functionality. Electrical assemblies should be covered when grinding/cutting/drilling or similar activities are being performed in the vicinity to prevent metallic debris and contamination.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for Inspection and Test

The supplier is responsible for the performance of all inspection and test requirements specified herein. Except as otherwise specified, suppliers may use their own facilities or any other commercial inspection and test facilities and services acceptable to the Government. Inspection and test records shall be kept complete and, upon request, shall be made available to the contracting officer. The Government reserves the right to perform any of the inspections and tests set forth in the specification where such inspections are deemed necessary to ensure supplies and services conform to the prescribed requirements.

4.2 Certification of Personnel

All contractors and subcontractors are required to provide personnel who have the experience, knowledge, and demonstrable ability required to perform the various tasks that constitute an assigned job. Certification shall be required for individuals performing skilled tasks including, but not limited to, welding, riveting, soldering, potting and molding, and quality control. Before

work begins, a representative of the contracting officer shall verify the qualifications of the contractor or subcontractor personnel by one or more of the following means:

- a. Reviewing personal resumes that shall include information on the companies the employee worked for, a brief description of the work performed for each company, and a description of any NASA specifications or procedures used in the work.
- b. Verifying that employees with no previous background in the type of work required have successfully completed a training program/school of instruction for that type of work. The program shall be operated by the contractor and shall include familiarization with NASA specifications and procedures.
- c. Verifying that employees who have previous experience have successfully completed a testing program.
- d. Witnessing or approving the preparation of work samples.

4.3 Certification of Tooling and Test Equipment

Measuring and test equipment (MTE) is integral to all measurement processes and must be selected, calibrated, and used in a controlled manner to ensure correct and adequate measurement results. MTE shall be calibrated by a calibration service provider, either on-Center or outside of KSC, who has established and maintains a calibration system that is compliant with the requirements of KNPR 8730.1. If an item is tested in a measurement process and the MTE used is found to be out of calibration, then the MTE will be immediately recalibrated and the as-found results examined for out-of-tolerance conditions. If documentation cannot be located to prove that the tooling, measuring, or test equipment that was used on a particular item was properly calibrated at the time it was used, or the results of recalibration of MTE indicate an out of tolerance condition that could impact the item or process for which it was used, the integrity of the item or process for which the discrepant MTE was used will be considered suspect.

Appropriate actions will be taken to document and assess the potential process escape. If the MTE is verified as being insufficiently calibrated for the item/process used, then rework and retesting of the item will be accomplished and properly documented. If no out-of-tolerance condition affecting the item/process is verified, then the result of the assessment will be properly documented and no rework or retest is required. MTE shall be checked and calibration verified prior to use. If an item of MTE is dropped, struck, otherwise damaged, or if it is possibly out of calibration, it shall be checked before it is used again. If it is found to be out of calibration, the MTE shall not be used until it has been recalibrated.

4.3.1 Soldering Tools

Soldering tools shall be in accordance with IPC J-STD-001 or IPC J-STD-001S.

4.3.2 Crimping Tools

Crimping tools used in installation procedures shall be checked prior to the beginning of the initial production. The tools shall be inspected for wear and clearances between dies and limits.

The clearances and dimensions shall conform to the respective standards of applicable specifications (such as SAE AS 22520). Tools for crimping terminals and conductor splices (in accordance with SAE AS 7928A and SAE AS 81824), as well as shield ferrules (in accordance with SAE AS 21608 and 75M13676), shall be in accordance with NASA-STD-8739.4 and IPC/WHMA-A-620 as follows (79K22638 provides additional guidance and information):

- a. Type I (for uninsulated terminals and splices):
 - (1) Class 1: use only military-standard-approved tools
 - (2) Class 2: use tools recommended by the manufacturer or approved by the contracting officer
- b. Type II (for insulated terminals and splices):
 - (1) Class 1: use only military-standard-approved tools
 - (2) Class 2: use tools recommended by the manufacturer or approved by the contracting officer

4.3.3 Crimping Tools, Special

Special tools for crimping, insertion, removal, or other uses pertaining to Class 2 terminals (other than those conforming to SAE AS7928A, SAE AS 81824, or SAE AS 21608) shall be as specified herein or as approved by the contracting officer.

4.3.4 Torque Wrenches

Unless otherwise specified, torque shall be applied to fasteners using torque wrenches that are in accordance with ASME B107.300-2010. The torque wrench shall be chosen so the torque values for a particular fastener will be between 20 percent and 80 percent of the full-scale torque.

Unless otherwise specified, the calibration of a torque wrench shall be checked before it is used for the first time. A dated certification of these calibrations shall be attached to the wrench.

Torque-presetting wrenches shall be adjusted/calibrated, checked, and sealed with a suitable tamperproof material. The torque to which the wrench is set shall be clearly marked on the wrench. For critical applications, the torque wrench calibration may be checked before daily use and at the end of the day. Documenting this verification with a note in the Work Authorization Document (WAD) will reduce the need for extensive document searches to verify the certification in the event a torque wrench fails.

4.3.5 Wire Stripping Tools

Wire stripping tools shall be in accordance with IPC/WHMA-A-620.

4.3.6 Solderless Wrap Tools

Solderless wrap tools and inspection intervals shall be in accordance with SAE AMS 2695C.

4.3.7 Test Equipment

Electronic equipment (such as voltmeters and oscilloscopes) used to verify the performance of items during assembly and test shall be calibrated before they are used for the first time and at intervals not to exceed 12 months. Personnel should verify electronic test equipment has a valid calibration sticker prior to each use.

4.4 Electrical Equipment Checkout

Prior to use, fabricated electrical assemblies, panels and enclosures shall be inspected for workmanship using criteria from previous sections of this specification. Unless otherwise required by applicable checkout procedure documents, equipment shall be checked for the following:

- a. Electrical continuity
- b. Electrical isolation
- c. Function (applied) to equipment containing electrical- or mechanical-action components

CAUTION

The person conducting the test should verify if any lockout/tagout procedures have been or need to be implemented as required by NPR 8715.3C and/or OSHA Standard 29 CFR 1910.147. Do not fasten or touch a probe or clip to any pin of any connector (including cable connectors) of the equipment being checked. A breakout box or adapter test fixture (or mating contact) shall be mated to the connector to make all electrical measurements.

NOTE

Prior to any test, all test fixtures and mating connectors shall be inspected and approved by the contracting officer. All pilot lamps or other sensitive items shall be removed for continuity and isolation tests, with all power OFF and disconnected from other equipment/systems.

4.4.1 Sequence of Tests

The following sequence of equipment checkout tests shall be followed:

- a. Perform a continuity check on all normally closed connecting points.
- b. Perform isolation checks on all normally open points.

- c. Operate equipment or components and perform a continuity check on all normally open circuits, circuits having definite resistances, or circuits having a resistance change by operation.
- d. Operate equipment or components and perform isolation checks on all normally closed circuits supposedly opened by operation.

4.4.2 Continuity Tests

During continuity tests, circuit breakers to which a power source is connected shall be in the OFF (open) position unless otherwise directed by a checkout procedure. Continuity tests of all wiring connections and verification of all termination points shall be made as follows:

- a. The contractor shall test each cable, wire bundle, or electrical assembly for electrical continuity according to the wire running list or schematic.
- b. The equipment approved by the contracting officer shall be used for continuity verification. This includes COTS testers as well as commercial or custom-made automatic testers.
- c. Continuity checks shall be made between all points shown as closed circuits on the electrical advanced schematic. The measuring device shall be capable of detecting a difference of 10 percent of the resistance value to be tested or equal to the tolerance required if less than 10 percent.
 - (1) The measuring device shall be set at the lowest ohm scale applicable to the readings (that is, $R \times 1$ for a 0Ω reading and others accordingly so that a 10-percent deviation is detectable). The verification of test equipment shall be performed just before the first reading. The verification shall be repeated whenever test equipment readings vary due to a reason such as the device having weak batteries. The meter shall be “zeroed” each time its range is changed during a test.
 - (2) Each conductor of an assembly shall be tested for minimum resistance based on the length and type of cable.
 - (3) Exposed metal shall be checked for continuity to the alternating current ground power line.

4.4.3 Isolation Checks

Isolation checks shall be made between all circuits that are shown on the advanced electrical schematics as normally open or that can be opened by manually, electrically, or mechanically operated components. All normally open circuits shall be checked to all other normally open points and to the chassis. Equipment or parts shall be operated as required to open all normally closed circuits to check the points for isolation. Isolation checks shall be made on equipment having electrical components and shall be as follows:

- a. The contractor shall test each cable, wire bundle, or electrical assembly for isolation using a standard ohmmeter set on a range of 1 M Ω or higher. Unless otherwise specified, isolation shall be more than 10 M Ω , or infinity.
- b. Insulation tests shall be performed on each cable, wire bundle, or exposed metal areas (ground potential) of panels, chassis, etc. See 3.12 for cable checkout. Chassis or other exposed metal normally at ground potential shall be tested to the power input line, aboveground transformer windings, and all other aboveground wiring with a minimum 10 M Ω reading, unless otherwise specified. This will ensure minimal ground fault currents due to failed or insufficient insulation.
- c. An insulation-resistance tester having a test potential of 500 VDC shall be used on all equipment having parts capable of withstanding 500 V between any possible erroneous connections.
- d. Equipment having sensitive devices (e.g., circuit cards) not capable of withstanding 500 V shall be removed or tested using 28 VDC in series with a voltmeter whose 50 V scale has a resistance of 1 M Ω . A circuit under test having a leak of 27 M Ω or less will cause the meter to register 1 V or more, indicating an unacceptably low value for isolation resistance. When checking aboveground wiring to the chassis, the wiring should be jumpered together as a common electrical point versus the chassis metal.

4.4.4 Functional Checks

When required by contract, functional checks shall be made on all checkout panels, distributors, and components that can be operated manually, electrically, or mechanically. If a malfunction is discovered, the checkout shall be stopped until the malfunction is corrected.

4.5 Completion of Tests

At the completion of tests and all work relating thereto, all parts of fabrication and equipment shall be thoroughly cleaned. All painted surfaces marred during installation shall be painted to match the original finish.

4.6 Manufacturing Instructions/Documentation

Normally, it is unnecessary to provide additional instructions to qualified or certified technicians. However, it is advisable to use reference material and other workmanship-related information for selecting connector/contact tools, performing connector assembly procedures, and selecting retention tools. Where requested by contract, a test procedure shall be submitted prior to testing, and data sheets shall be retained or submitted after testing is successfully completed.

4.7 Commercial Off-the-Shelf (COTS) Concept

NASA-STD-5005 establishes the general characteristics and requirements for performance, design, test, safety, reliability, maintainability, and quality assurance for facilities, systems, and equipment intended for use at KSC, NASA, or other KSC-responsible locations. It specifies the minimum requirements to provide simple, robust, safe, reliable, maintainable, environmentally

compatible, and cost-effective facilities and GSE to support space vehicle launch operations. Design requirements specific to KSC are listed in KSC-DE-512-SM.

COTS equipment, parts, items, or components shall be used to the maximum extent possible when (1) they satisfy the hardware function, (2) they will not degrade the safety or reliability of the flight or ground system, and (3) they provide a cost savings that will exceed possible cost increases due to unique maintenance or logistics requirements, modifications, or an increase in the complexity of the interfacing equipment. In all cases, exact materials of construction and applicable specifications shall be determined to evaluate how well the material meets its requirements. Any additional qualifying tests and inspections shall be indicated in the engineering documentation. Control documents may be created for proposed parts that lack such documentation.

4.7.1 Modified Off-the-Shelf (MOTS) Items

A MOTS item is a COTS item that must be altered to be integrated into or meet the needs of a system or application. The modification may be cosmetic (i.e., changing the protective finish or external color), electromechanical (i.e., altering the physical configuration of equipment by adding to, deleting from, or modifying originally issued parts), or software-based (i.e., modifying the original operational code or language). MOTS items must receive revised part numbers (P/Ns) from the original COTS item and are typically unique to the system requesting the modification.

Fabrication of MOTS items may void the original COTS item warranty and reduce or eliminate the vendor's liability. After modification, MOTS items must undergo additional testing to verify their functionality, reliability, and safety. Additional testing must validate and document that all NASA, KSC, and system requirements have been met.

5. PREPARATION FOR DELIVERY

ASTM D 3951-98 and customer/engineering requirements establish minimum requirements for packaging of supplies and equipment, exclusive of ammunition, explosives, or hazardous materials, as covered in CFR Title 49, Transportation.

MIL-STD-2073-1 outlines standard processes for the development and documentation of military packaging, as distinct from commercial packaging. This standard covers methods of preservation to protect materiel against environmentally induced corrosion and deterioration, physical and mechanical damage, and other forms of degradation during storage, multiple handling, and shipment of materiel in situations when commercial packaging cannot meet known distribution and environmental requirements. A decision chart is included in MIL-STD-2073-1 for determining the applicability of commercial or military packaging practices.

Marking for shipment and storage shall be in accordance with MIL-STD-129.

For hazardous materials, packing and marking must comply with the hazardous materials regulations in CFR Title 49, Transportation.

Personnel responsible for storing, preserving, identifying, and shipping electrical GSE must comply with Federal and local regulations governing the shipping and handling of hazardous materials where applicable. Standard commercial packaging and specialized military packaging as outlined in ASTM D 3951-98 and MIL-STD-2073-1, respectively, should be used in storing, preserving, identifying, and shipping electrical GSE.

6. NOTES

6.1 Intended Use

This document is intended to define detailed parts, materials, and process requirements and to ensure that essential requirements are included in the fabrication of electrical and electronic control and monitoring equipment associated with GSE used to support the transporting, receiving, handling, assembly, test, checkout, service, and launch of space vehicles and payloads at KSC.

6.2 Definitions

For the purpose of this document, the following definitions shall apply:

100BASE-T: standard “Fast Ethernet” based on twisted pair copper wire transmitting 100 Mbps. 100BaseT4/T2 (Cat3 cabling). T4 indicates four twisted pairs; T2 indicates two twisted pairs.

10BASE-T: standard “plain vanilla” Ethernet based on unshielded twisted pair wire.

bridging router: router that automatically forwards a message it does not understand.

cleave: the process of separating an optical fiber by a controlled fracture of the glass for the purpose of obtaining a fiber end that is flat, smooth, and perpendicular to the fiber axis.

CSMA/CD: Carrier Sense Multiple Access Collision Detection that is an arbitration mechanism for competing Ethernet messages.

ground support equipment: equipment necessary to support the transporting, receiving, handling, assembly, test, checkout, servicing, and launch of space vehicles and payloads.

multimode optical fiber: an optical fiber that will allow more than one bound mode to propagate.

protocol: agreed-upon format for transmitting or storing data.

single-mode optical fiber: an optical fiber in which only the lowest order bound mode (which may consist of a pair of orthogonally polarized fields) can propagate at the wavelength of interest.

socket: (1) a hollow piece or part into which something fits, the socket for a pin to mate in a receptacle connector, the socket used on a torque wrench to fit a specific sized nut or bolt, etc.

(2) (Ethernet usage) roughly analogous to a port and is a communication endpoint for a TCP or UDP connection. Sockets can also be used for interprocess communication on a single computer, and multiple sockets can be made to communicate with one another. Sockets are bidirectional, which means that both sides of the connection can send and receive information.

twisted pair: standard wire format for Ethernet cables.

NOTICE. The Government drawings, specifications, and/or data are prepared for the official use by, or on behalf of, the United States Government. The Government neither warrants these Government drawings, specifications, or other data, nor assumes any responsibility or obligation, for their use for purposes other than the Government project for which they were prepared and/or provided by the Government, or any activity directly related thereto. The fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded, by implication or otherwise, as licensing in any manner the holder or any other person or corporation nor conveying the right or permission to manufacture, use, or sell any patented invention that may relate thereto.

Custodian:

NASA – John F. Kennedy Space Center
Kennedy Space Center, Florida 32899

Preparing Activity:

John F. Kennedy Space Center
Engineering Directorate
Electrical Division

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document or to amend contractual requirements.

I RECOMMEND A CHANGE:

1. DOCUMENT NUMBER

KSC-E-165 Revision F

2. DOCUMENT DATE

September 29, 2021

3. DOCUMENT TITLE

Electrical Ground Support Equipment Fabrication, Specification for

4. NATURE OF CHANGE (Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME (Last, First, Middle Initial)

b. ORGANIZATION

c. ADDRESS (Include Zip Code)

d. TELEPHONE (Include Area Code)

7. DATE SUBMITTED

8. PREPARING ACTIVITY

a. NAME (Last, First, Middle Initial)

Denson, Erik C.

b. ORGANIZATION

Engineering Directorate,
Electrical Division

c. ADDRESS (Include zip code)

Kennedy Space Center, FL 32899